

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643896

Luminaire Tested: ML5615LSWFL559FS1E - 594WB - 900LM - 2700K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643896
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-55)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSWFL559FS1E - 594WB - 900LM - 2700K
Description: ML56 RR, 55D TIR OPTIC, 5" WHITE GIMBAL TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1137.0 lumens
Efficiency: N/A
Efficacy: 108.3 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.88
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643896
CATALOG NUMBER: ML5615LSWFL559FS1E - 594WB - 900LM - 2700K

Luminous Intensity Polar Plot

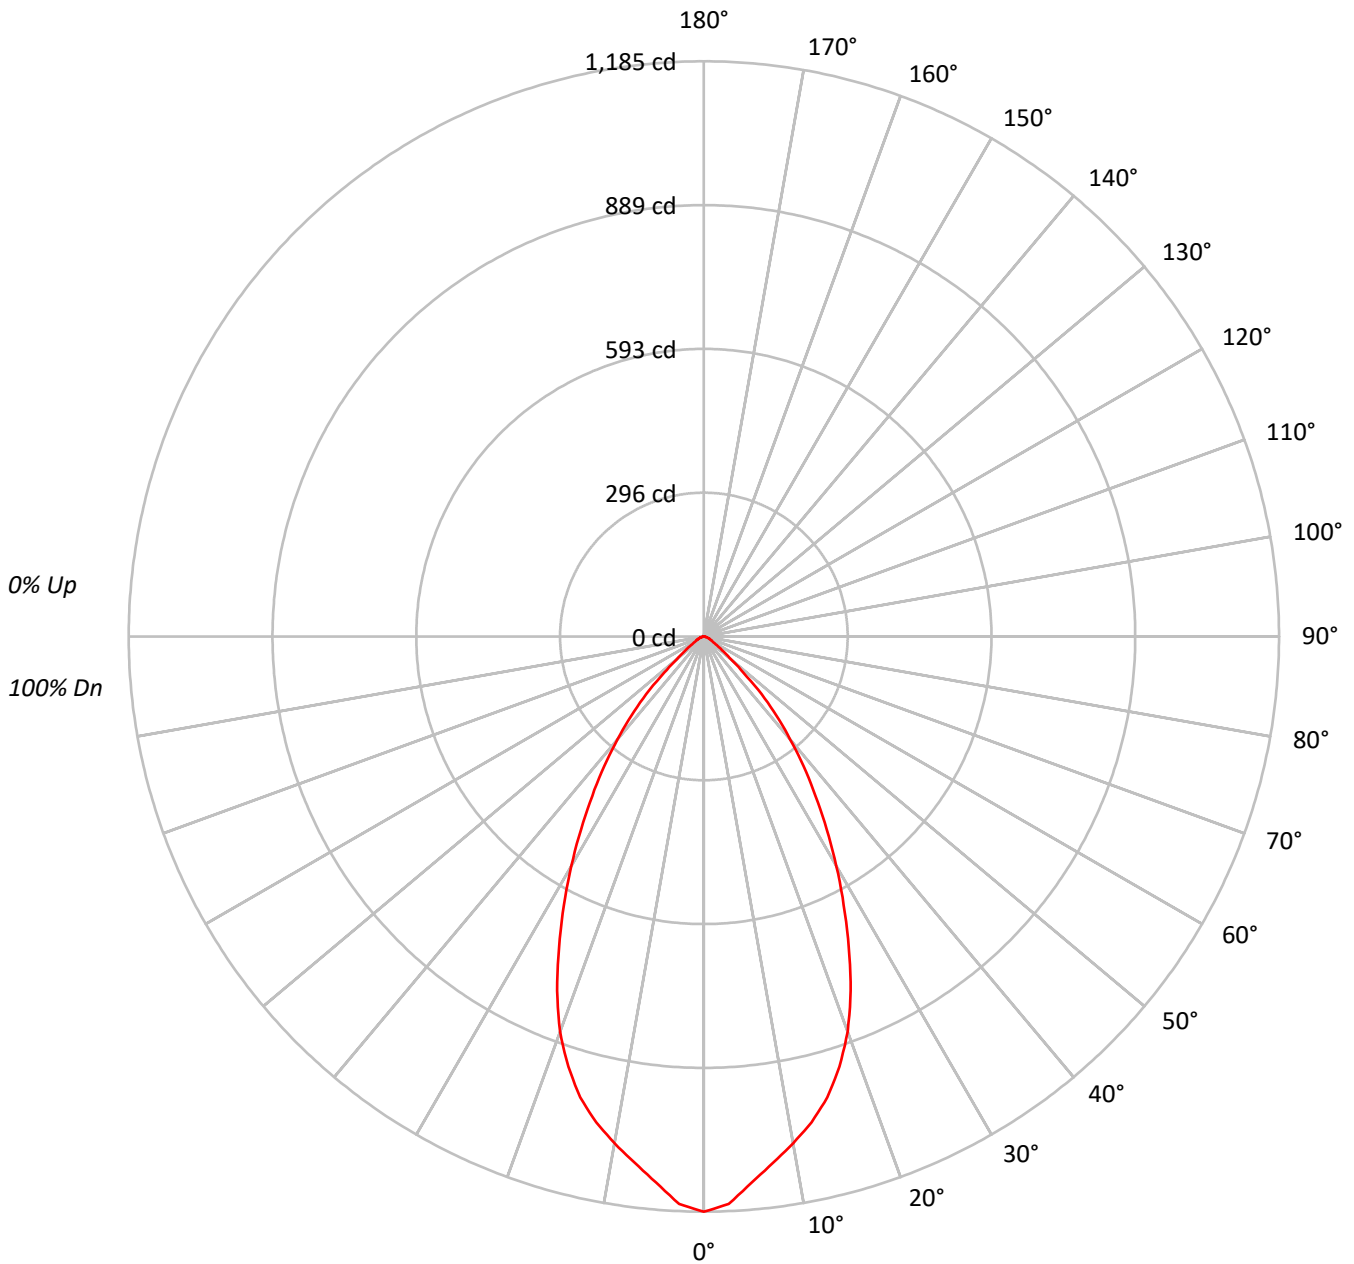



TEST NUMBER: P643896
 CATALOG NUMBER: ML5615LSWFL559FS1E - 594WB - 900LM - 2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100	
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	97	95	94	92			92	
2	107	101	97	93	105	100	96	92	96	93	90	93	91	88	91	88	87	85			85	
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78	
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72	
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66	
6	85	75	69	64	83	74	68	64	73	68	64	71	67	63	70	66	63	61			61	
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			57	
8	76	66	59	55	75	65	59	55	64	59	55	63	58	54	62	58	54	53			53	
9	72	62	56	51	71	61	55	51	60	55	51	59	54	51	59	54	51	49			49	
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	47	46			46	

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	93553
5°	89473
10°	84976
15°	80344
20°	72759
25°	61502
30°	49770
35°	38644
40°	28545
45°	18755
50°	8965
55°	4817
60°	3316
65°	2615
70°	2308
75°	1525
80°	909
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 18755 cd/sqm



TEST NUMBER: P643896

CATALOG NUMBER: ML5615LSWFL559FS1E - 594WB - 900LM - 2700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	105.7	9.3
10°-20°	273.6	24.1
20°-30°	322.7	28.4
30°-40°	251.2	22.1
40°-50°	128.3	11.3
50°-60°	35.0	3.1
60°-70°	14.4	1.3
70°-80°	5.5	0.5
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	702.0	61.7
0°-40°	953.2	83.8
0°-60°	1116.5	98.2
0°-90°	1137.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1137.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1185	
5°	1129	106
15°	983	274
25°	706	323
35°	401	251
45°	168	128
55°	35	35
65°	14	14
75°	5	6
85°	0	1
90°	0	



TEST NUMBER: P643896

CATALOG NUMBER: ML5615LSWFL559FS1E - 594WB - 900LM - 2700K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1185.1
2.5°	1170.1
5°	1129.1
7.5°	1093.1
10°	1060.1
12.5°	1025.1
15°	983.1
17.5°	929.1
20°	866.1
22.5°	790.1
25°	706.1
27.5°	624.1
30°	546.0
32.5°	471.0
35°	401.0
37.5°	337.0
40°	277.0
42.5°	221.0
45°	168.0
47.5°	110.0
50°	73.0
52.5°	50.0
55°	35.0
57.5°	26.0
60°	21.0
62.5°	17.0
65°	14.0
67.5°	12.0
70°	10.0
72.5°	7.0
75°	5.0
77.5°	3.0
80°	2.0
82.5°	1.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)