

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643942

Luminaire Tested: ML5615LSWFL559FS1E - 692H - 900LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643942
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-61)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSWFL559FS1E - 692H - 900LM - 3000K
Description: ML56 RR, 55D TIR OPTIC, 6" HAZE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1159.2 lumens
Efficiency: N/A
Efficacy: 110.4 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.89
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643942
CATALOG NUMBER: ML5615LSWFL559FS1E - 692H - 900LM - 3000K

Luminous Intensity Polar Plot

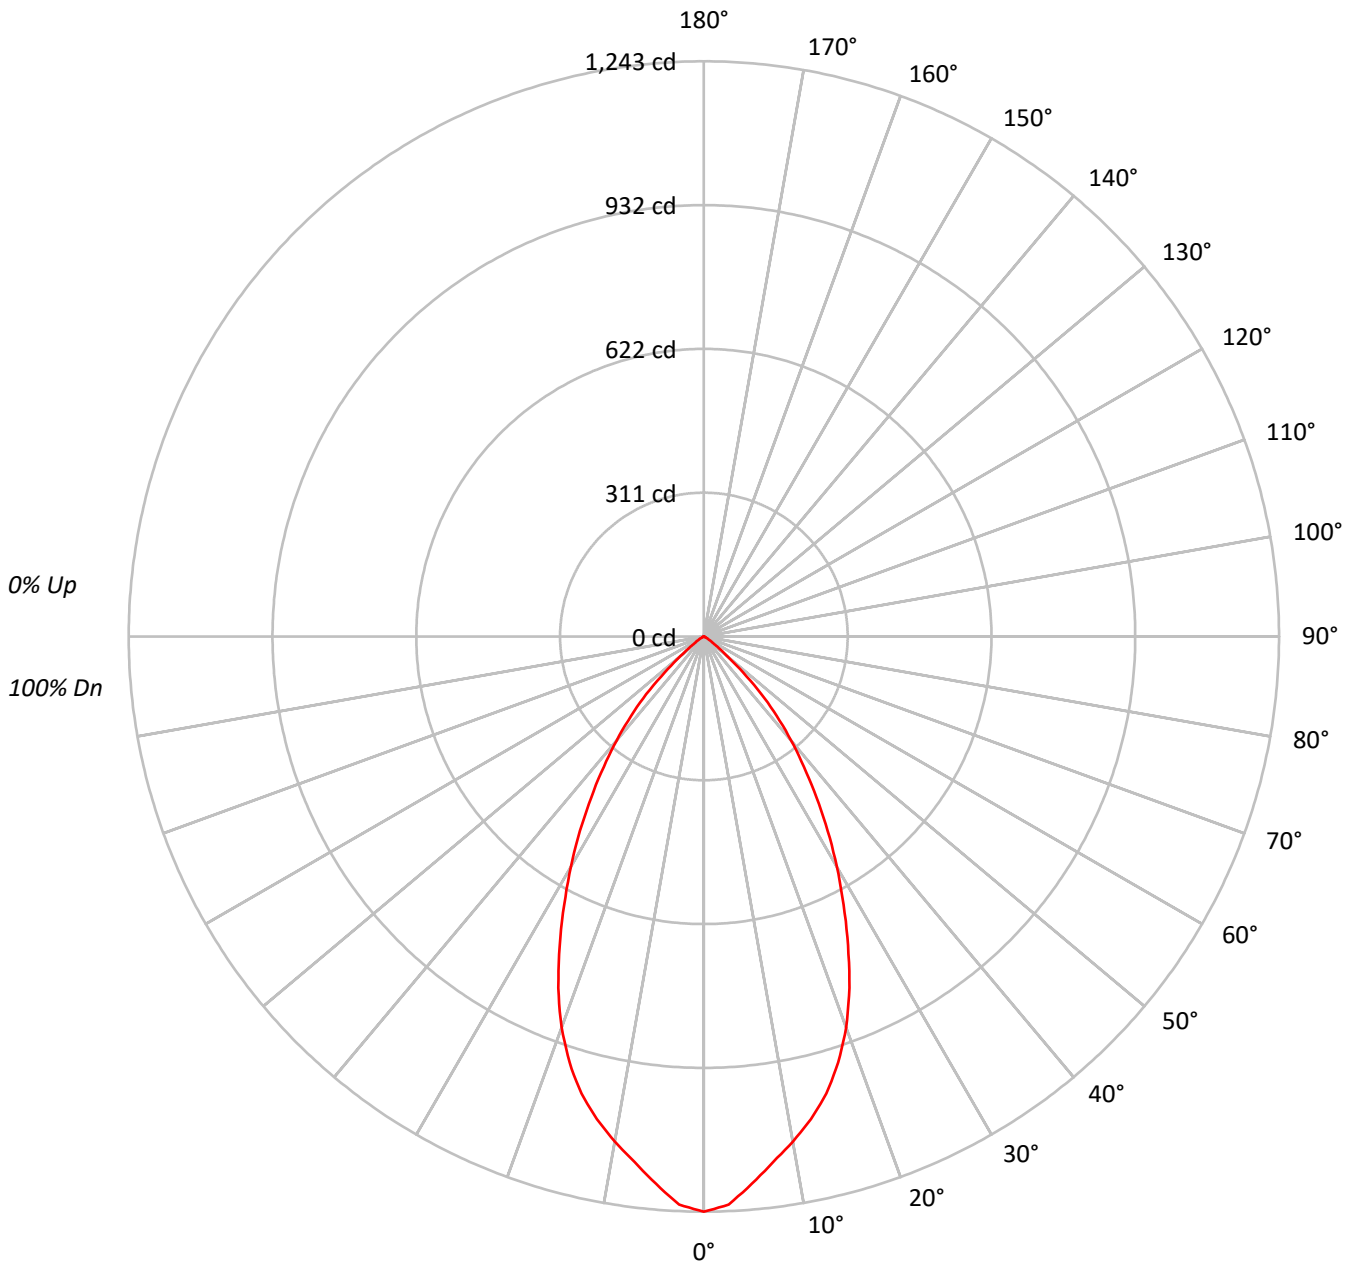



TEST NUMBER: P643942

CATALOG NUMBER: ML5615LSWFL559FS1E - 692H - 900LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	113	110	108	105	111	108	106	104	104	102	101	100	99	98	97	96	95	93					93			
2	107	102	98	94	105	100	97	93	97	94	91	94	92	89	91	89	87	86					86			
3	101	95	89	85	99	93	88	85	91	87	83	88	85	82	86	83	81	79					79			
4	96	88	82	78	94	87	81	77	85	80	76	83	79	75	81	77	74	73					73			
5	91	82	76	71	89	81	75	71	79	74	70	77	73	70	76	72	69	67					67			
6	86	76	70	66	84	76	70	65	74	69	65	73	68	64	71	67	64	62					62			
7	81	71	65	61	80	71	65	60	69	64	60	68	63	60	67	63	59	58					58			
8	77	67	61	56	76	66	60	56	65	60	56	64	59	56	63	59	55	54					54			
9	73	63	57	52	72	62	56	52	61	56	52	60	56	52	60	55	52	50					50			
10	69	59	53	49	68	59	53	49	58	53	49	57	52	49	56	52	49	47					47			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	68147
5°	65353
10°	61694
15°	58054
20°	52470
25°	44567
30°	36347
35°	28375
40°	20989
45°	13645
50°	5620
55°	2160
60°	1020
65°	272
70°	160
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13645 cd/sqm



TEST NUMBER: P643942

CATALOG NUMBER: ML5615LSWFL559FS1E - 692H - 900LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	110.9	9.6
10°-20°	284.7	24.6
20°-30°	336.8	29.1
30°-40°	265.2	22.9
40°-50°	133.5	11.5
50°-60°	24.6	2.1
60°-70°	3.0	0.3
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	732.4	63.2
0°-40°	997.6	86.1
0°-60°	1155.8	99.7
0°-90°	1159.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1159.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1243	
5°	1188	111
15°	1023	285
25°	737	337
35°	424	265
45°	176	134
55°	23	25
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P643942

CATALOG NUMBER: ML5615LSWFL559FS1E - 692H - 900LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1243.1
2.5°	1228.7
5°	1187.6
7.5°	1145.4
10°	1108.3
12.5°	1068.2
15°	1022.9
17.5°	965.3
20°	899.4
22.5°	822.2
25°	736.8
27.5°	653.5
30°	574.2
32.5°	498.1
35°	424.0
37.5°	355.0
40°	293.3
42.5°	232.6
45°	176.0
47.5°	114.2
50°	65.9
52.5°	36.0
55°	22.6
57.5°	15.4
60°	9.3
62.5°	4.1
65°	2.1
67.5°	1.0
70°	1.0
72.5°	1.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)