

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643993

Luminaire Tested: ML5615LSWFL559FS1E - 693SNB - 1200LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643993
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-65)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSWFL559FS1E - 693SNB - 1200LM - 3500K
Description: ML56 RR, 55D TIR OPTIC, 6" SATIN NICKLE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1496.6 lumens
Efficiency: N/A
Efficacy: 111.7 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.89
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643993
CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1200LM - 3500K

Luminous Intensity Polar Plot

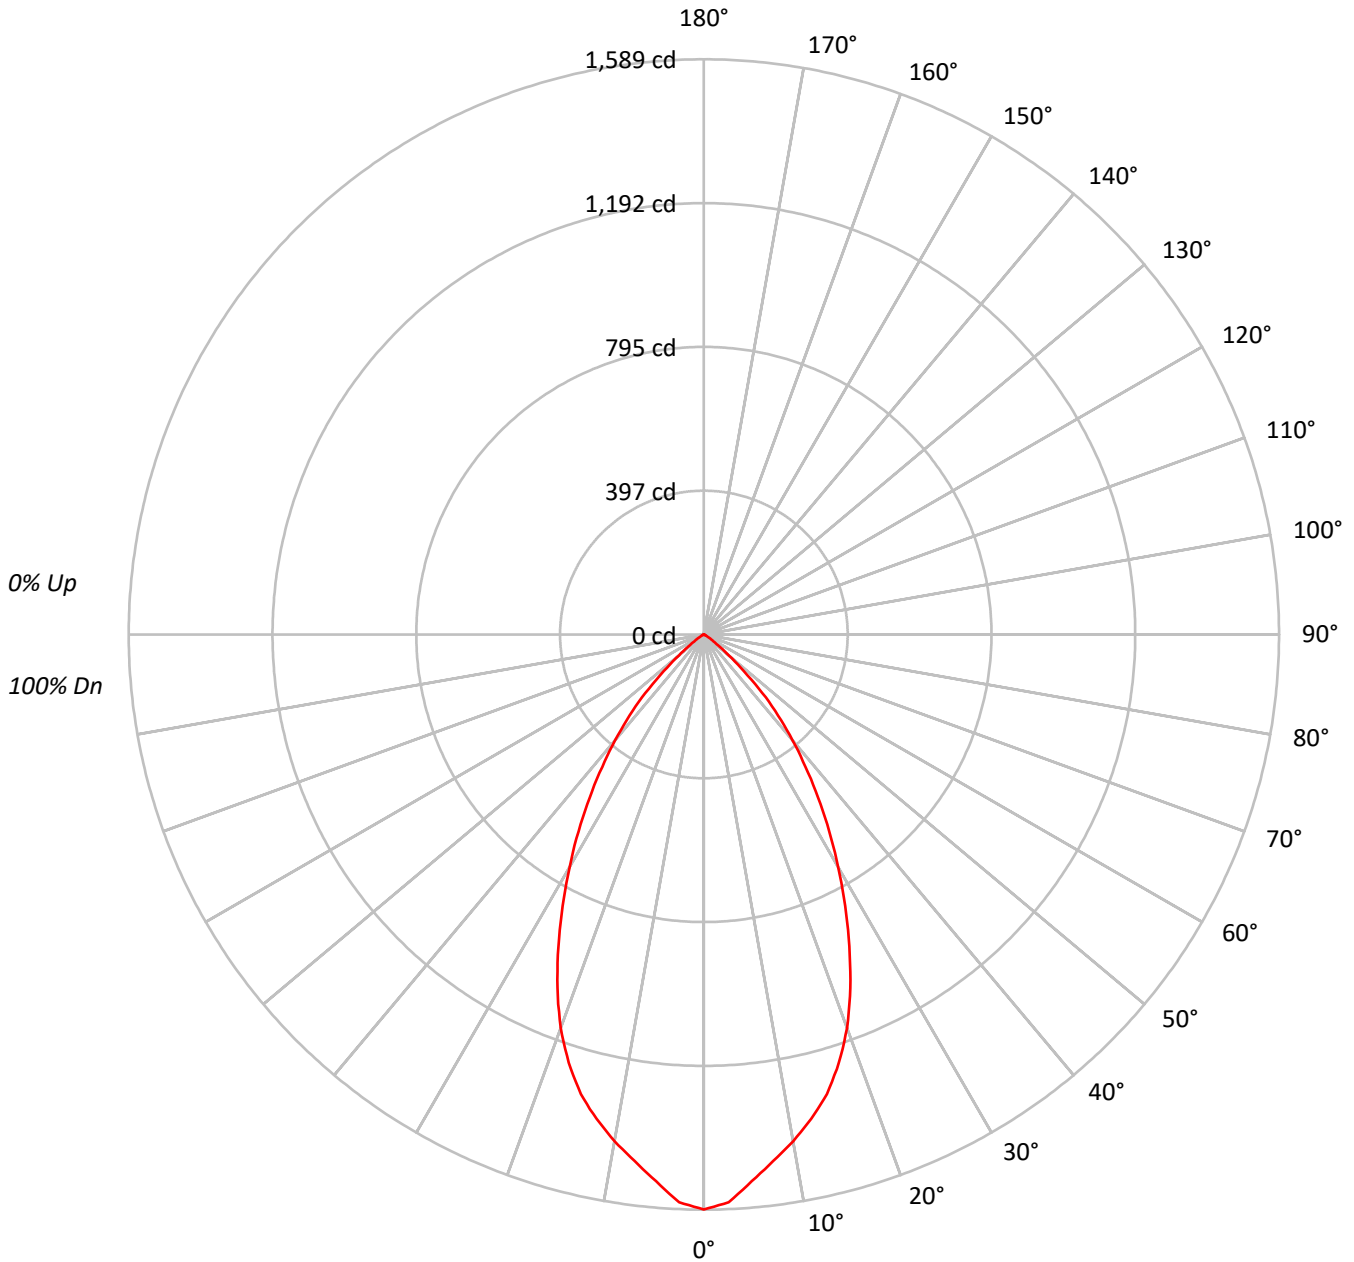



TEST NUMBER: P643993

CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1200LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	108	105	111	108	106	104	104	102	101	100	99	98	97	96	95	93			
2	107	102	98	94	105	100	97	93	97	94	91	94	92	89	91	89	87	86			
3	101	95	89	85	99	93	88	85	91	87	83	88	85	82	86	83	81	79			
4	96	88	82	78	94	87	81	77	85	80	76	83	79	75	81	77	74	73			
5	91	82	76	71	89	81	75	71	79	74	70	77	73	69	76	72	69	67			
6	86	76	70	65	84	75	70	65	74	69	65	72	68	64	71	67	64	62			
7	81	71	65	60	80	71	65	60	69	64	60	68	63	60	67	63	59	58			
8	77	67	61	56	76	66	60	56	65	60	56	64	59	56	63	59	55	54			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50			
10	69	59	53	49	68	59	53	49	58	52	49	57	52	49	56	52	48	47			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	87087
5°	83447
10°	79123
15°	74597
20°	67480
25°	57505
30°	46976
35°	36781
40°	27273
45°	17731
50°	7642
55°	2810
60°	1316
65°	350
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 17731 cd/sqm



TEST NUMBER: P643993

CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1200LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	141.9	9.5
10°-20°	365.8	24.4
20°-30°	434.4	29.0
30°-40°	343.7	23.0
40°-50°	174.5	11.7
50°-60°	32.7	2.2
60°-70°	3.7	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	942.0	62.9
0°-40°	1285.7	85.9
0°-60°	1492.9	99.8
0°-90°	1496.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1496.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1589	
5°	1516	142
15°	1314	366
25°	951	434
35°	550	344
45°	229	174
55°	29	33
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P643993

CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1200LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1588.6
2.5°	1569.8
5°	1516.4
7.5°	1466.9
10°	1421.4
12.5°	1370.6
15°	1314.4
17.5°	1240.9
20°	1156.7
22.5°	1057.7
25°	950.7
27.5°	845.1
30°	742.1
32.5°	644.5
35°	549.6
37.5°	461.3
40°	381.1
42.5°	303.5
45°	228.7
47.5°	149.8
50°	89.6
52.5°	48.1
55°	29.4
57.5°	20.1
60°	12.0
62.5°	5.3
65°	2.7
67.5°	1.3
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)