

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643999

Luminaire Tested: ML5615LSWFL559FS1E - 693SNB - 1500LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643999
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-65)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSWFL559FS1E - 693SNB - 1500LM - 4000K
Description: ML56 RR, 55D TIR OPTIC, 6" SATIN NICKLE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1979.8 lumens
Efficiency: N/A
Efficacy: 115.8 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.89
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 17.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643999

CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1500LM - 4000K

Luminous Intensity Polar Plot

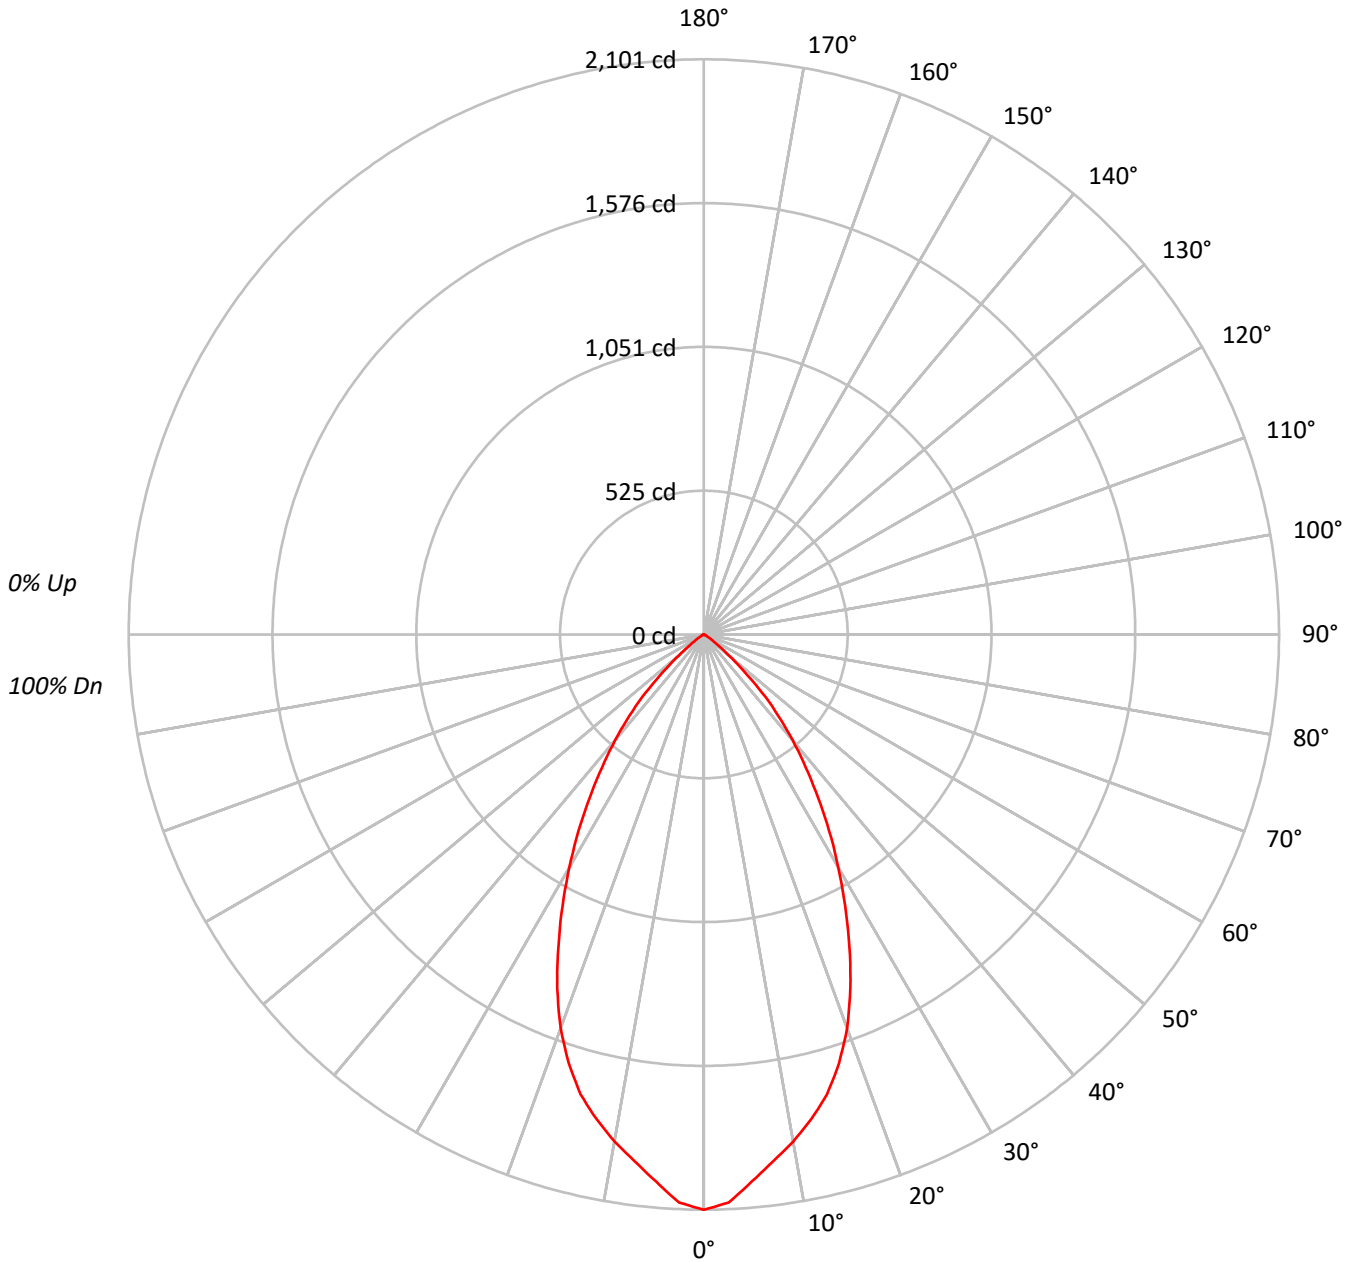



TEST NUMBER: P643999

CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1500LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	108	105	111	108	106	104	104	102	101	100	99	98	97	96	95	93																			
2	107	102	98	94	105	100	97	93	97	94	91	94	92	89	91	89	87	86																			
3	101	95	89	85	99	93	88	85	91	87	83	88	85	82	86	83	81	79																			
4	96	88	82	78	94	87	81	77	85	80	76	83	79	75	81	77	74	73																			
5	91	82	76	71	89	81	75	71	79	74	70	77	73	69	76	72	69	67																			
6	86	76	70	65	84	75	70	65	74	69	65	72	68	64	71	67	64	62																			
7	81	71	65	60	80	71	65	60	69	64	60	68	63	60	67	63	59	58																			
8	77	67	61	56	76	66	60	56	65	60	56	64	59	56	63	59	55	54																			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50																			
10	69	59	53	49	68	59	53	49	58	52	49	57	52	49	56	52	48	47																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	115199
5°	110384
10°	104669
15°	98684
20°	89258
25°	76069
30°	62142
35°	48653
40°	36075
45°	23452
50°	10106
55°	3718
60°	1743
65°	454
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 23452 cd/sqm



TEST NUMBER: P643999

CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1500LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	187.6	9.5
10°-20°	483.9	24.4
20°-30°	574.6	29.0
30°-40°	454.7	23.0
40°-50°	230.8	11.7
50°-60°	43.2	2.2
60°-70°	5.0	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1246.1	62.9
0°-40°	1700.8	85.9
0°-60°	1974.8	99.7
0°-90°	1979.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1979.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2101	
5°	2006	188
15°	1739	484
25°	1258	575
35°	727	455
45°	302	231
55°	39	43
65°	4	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P643999

CATALOG NUMBER: ML5615LSWFL559FS1E - 693SNB - 1500LM - 4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	2101.4
2.5°	2076.6
5°	2005.9
7.5°	1940.4
10°	1880.3
12.5°	1813.1
15°	1738.8
17.5°	1641.5
20°	1530.0
22.5°	1399.1
25°	1257.6
27.5°	1117.9
30°	981.7
32.5°	852.6
35°	727.0
37.5°	610.2
40°	504.1
42.5°	401.5
45°	302.5
47.5°	198.1
50°	118.5
52.5°	63.7
55°	38.9
57.5°	26.5
60°	15.9
62.5°	7.1
65°	3.5
67.5°	1.8
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)