

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P683859

Luminaire Tested: CJB6099FS1EMW-5000K

Issue Date: 5/9/2023

Test Information

Test Method: LM-79-2019
Report Number: P683859
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2304-981-18)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 5/9/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: CJB6099FS1EMW-5000K
Description: 6IN J-BOX LED DOWNLIGHT WITH SELECTABLE CCT
Light Source: (1) 5000K CCT, 91 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 900.0 lumens
Efficiency: N/A
Efficacy: 97.8 lumens/watt
Spacing Criteria (0/90/45): 1.27 / 1.27 / 1.37
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 9.2
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P683859
CATALOG NUMBER: CJB6099FS1EMW-5000K

Luminous Intensity Polar Plot

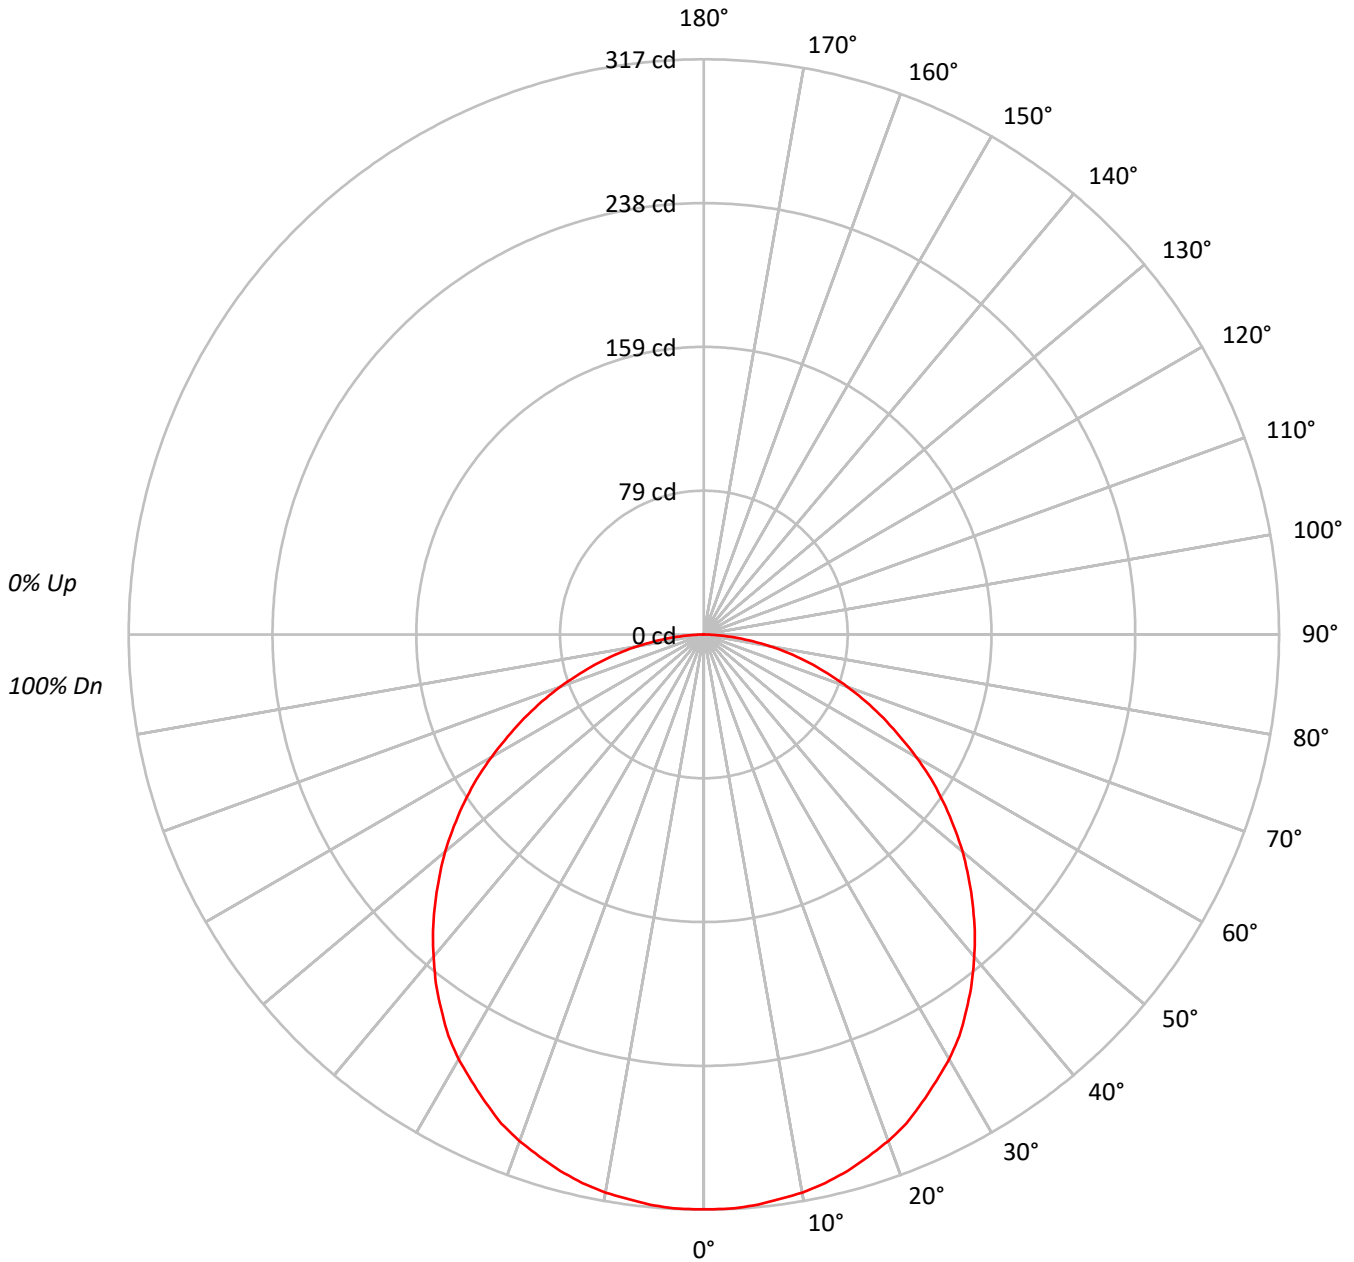



TEST NUMBER: P683859

CATALOG NUMBER: CJB6099FS1EMW-5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	109	104	100	96	106	102	98	94	97	94	91	93	91	88	90	88	86	84																			
2	99	91	84	78	96	89	82	77	85	80	75	82	77	73	79	75	72	70																			
3	90	79	71	65	88	78	70	64	75	68	63	72	67	62	70	65	61	59																			
4	82	70	62	55	80	69	61	54	67	59	54	64	58	53	62	57	52	50																			
5	76	63	54	47	74	62	53	47	60	52	46	58	51	46	56	50	45	43																			
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	51	45	40	38																			
7	65	51	43	36	63	51	42	36	49	41	36	48	41	36	46	40	35	33																			
8	60	47	38	32	59	46	38	32	45	37	32	44	37	32	42	36	32	30																			
9	56	43	35	29	55	42	35	29	41	34	29	40	34	29	39	33	29	27																			
10	53	40	32	26	52	39	32	26	38	31	26	37	31	26	36	30	26	24																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	17367
5°	17384
10°	17384
15°	17372
20°	17332
25°	17215
30°	17110
35°	16891
40°	16588
45°	16234
50°	15872
55°	15397
60°	14812
65°	14165
70°	13480
75°	12709
80°	11586
85°	9561

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16234 cd/sqm



TEST NUMBER: P683859
 CATALOG NUMBER: CJB6099FS1EMW-5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	30.0	3.3
10°-20°	86.4	9.6
20°-30°	131.2	14.6
30°-40°	157.9	17.5
40°-50°	161.6	18.0
50°-60°	144.0	16.0
60°-70°	108.1	12.0
70°-80°	63.4	7.0
80°-90°	17.4	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	247.6	27.5
0°-40°	405.5	45.1
0°-60°	711.1	79.0
0°-90°	900.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	900.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	317	
5°	316	30
15°	306	86
25°	285	131
35°	252	158
45°	209	162
55°	161	144
65°	109	108
75°	60	63
85°	15	17
90°	0	



TEST NUMBER: P683859
CATALOG NUMBER: CJB6099FS1EMW-5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	316.8
2.5°	316.8
5°	315.9
7.5°	314.1
10°	312.3
12.5°	309.6
15°	306.1
17.5°	301.6
20°	297.1
22.5°	291.7
25°	284.6
27.5°	277.4
30°	270.3
32.5°	262.2
35°	252.4
37.5°	242.5
40°	231.8
42.5°	221.0
45°	209.4
47.5°	197.8
50°	186.1
52.5°	173.6
55°	161.1
57.5°	148.6
60°	135.1
62.5°	121.7
65°	109.2
67.5°	96.6
70°	84.1
72.5°	71.6
75°	60.0
77.5°	48.3
80°	36.7
82.5°	25.1
85°	15.2
87.5°	5.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670246102 / DESKTOP-IQ7I0JM

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)