

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: LUMIERE

Report Number: P221064

Luminaire Tested: **9004-W1-FL-LED2797-M-BK-L2-UNV**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-79-08  
Report Number: P221064  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29497)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: LUMIERE  
Catalog Number: 9004-W1-FL-LED2797-M-BK-L2-UNV  
Description: LUMIERE LANTERRA 9004 LED WALL LUMINAIRE, FLUSH LENS, MEDIUM FLOOD OPTIC, BLACK HOUSING.  
Light Source: (1) 2700K CCT, 97 CRI LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1525.4 lumens  
Efficiency: N/A  
Efficacy: 75.9 lumens/watt  
Spacing Criteria (0/90/45): 0.43 / 0.43 / 0.44  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct


Input Watts (W): 20.1  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P221064

CATALOG NUMBER: 9004-W1-FL-LED2797-M-BK-L2-UNV

### Luminous Intensity Polar Plot

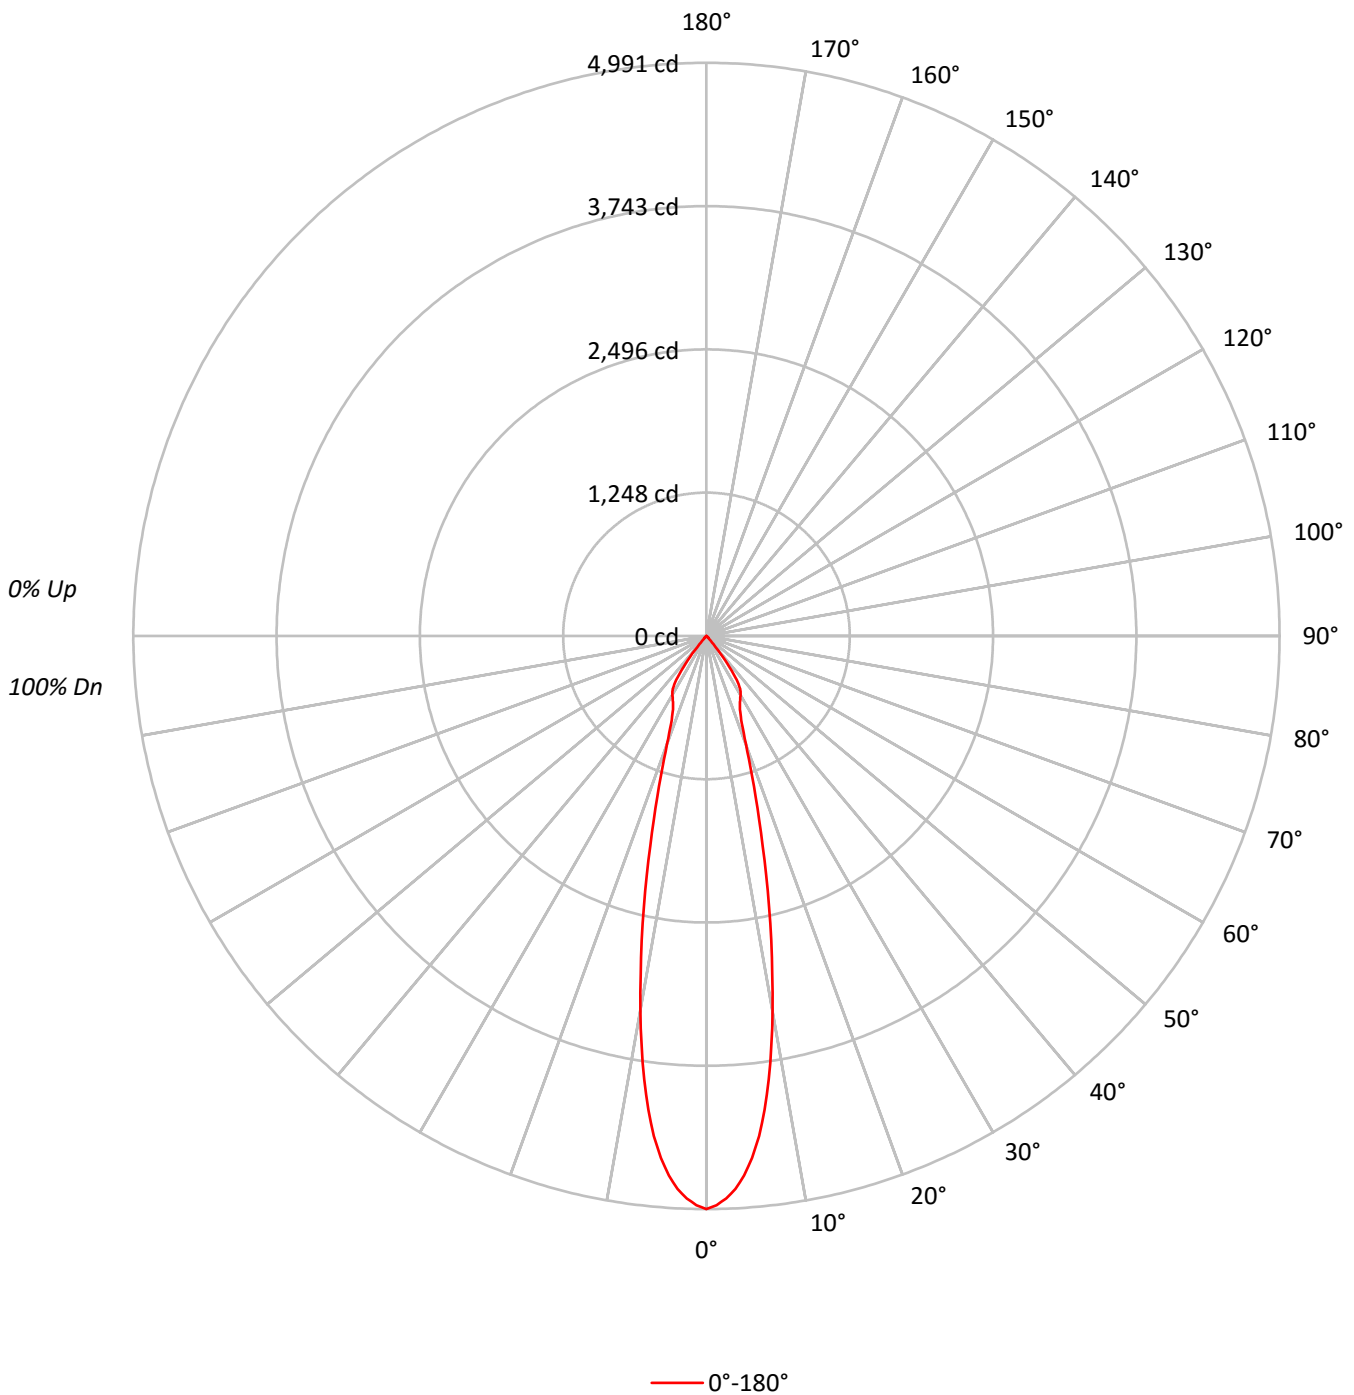



TEST NUMBER: P221064

CATALOG NUMBER: 9004-W1-FL-LED2797-M-BK-L2-UNV

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95
2	110	106	102	99	108	104	101	98	101	98	96	98	96	94	95	94	92	91
3	106	100	96	93	104	99	95	92	96	93	90	94	91	89	92	90	88	86
4	101	95	91	87	100	94	90	86	92	88	85	90	87	85	88	86	84	82
5	97	91	86	82	96	90	85	82	88	84	81	86	83	80	85	82	80	78
6	94	86	82	78	92	86	81	78	84	80	77	83	79	77	82	79	76	75
7	90	83	78	74	89	82	77	74	81	77	74	80	76	73	79	75	73	72
8	87	79	74	71	86	79	74	71	78	74	71	77	73	70	76	73	70	69
9	84	76	71	68	83	76	71	68	75	71	68	74	70	67	73	70	67	66
10	81	73	68	65	80	73	68	65	72	68	65	71	68	65	71	67	65	64

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	615606
5°	564889
10°	415061
15°	241641
20°	131774
25°	93662
30°	84402
35°	66480
40°	14781
45°	4047
50°	1343
55°	817
60°	543
65°	321
70°	180
75°	238
80°	0
85°	0



TEST NUMBER: P221064

CATALOG NUMBER: 9004-W1-FL-LED2797-M-BK-L2-UNV

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	395.2	25.9
10°-20°	527.4	34.6
20°-30°	329.9	21.6
30°-40°	244.7	16.0
40°-50°	22.8	1.5
50°-60°	3.7	0.2
60°-70°	1.3	0.1
70°-80°	0.5	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1252.5	82.1
0°-40°	1497.2	98.2
0°-60°	1523.6	99.9
0°-90°	1525.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1525.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4991	
5°	4562	395
15°	1892	527
25°	688	330
35°	442	245
45°	23	23
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P221064

CATALOG NUMBER: 9004-W1-FL-LED2797-M-BK-L2-UNV

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	4990.9
1°	4958.0
2°	4901.8
3°	4820.9
4°	4709.7
5°	4562.3
6°	4379.4
7°	4158.6
8°	3901.2
9°	3614.0
10°	3313.9
11°	3006.8
12°	2709.4
13°	2419.6
14°	2144.3
15°	1892.3
16°	1662.9
17°	1462.7
18°	1282.9
19°	1130.7
20°	1003.9
21°	903.5
22°	823.1
23°	763.7
24°	720.0
25°	688.2
26°	664.4
27°	643.9
28°	625.0
29°	608.8
30°	592.6
32.5°	547.8
35°	441.5
37.5°	267.2
40°	91.8
42.5°	31.8
45°	23.2
47.5°	16.7
50°	7.0
52.5°	5.4
55°	3.8
57.5°	2.7
60°	2.2
62.5°	1.6
65°	1.1



TEST NUMBER: P221064

CATALOG NUMBER: 9004-W1-FL-LED2797-M-BK-L2-UNV

**CANDELA DISTRIBUTION (continued):**

	0°
67.5°	1.1
70°	0.5
72.5°	0.5
75°	0.5
77.5°	0.5
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)