

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: METALUX

Report Number: P828554

Luminaire Tested: **OHBL-12HE-W-UNV-L950-CD-UPL18**

Issue Date: 5/3/2024



Test Information

Test Method: LM-79-08
Report Number: P828554
REPORT IS A COMBINATION OF REPORTS P826148 AND G3-2310-221-8
Test Lab: INNOVATION CENTER
Issue Date: 5/3/2024
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: METALUX
Catalog Number: OHBL-12HE-W-UNV-L950-CD-UPL18
Description:
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1556.2 lumens
Efficiency: N/A
Efficacy: 126.5 lumens/watt
Spacing Criteria (0/90/45): - / - / -
Luminous Opening: Rectangular w/ Sides (W: 3.78' x L: 1.67' x H: 0.17')
CIE Type: Indirect

Input Watts (W): 12.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P828554

CATALOG NUMBER: OHBL-12HE-W-UNV-L950-CD-UPL18

Luminous Intensity Polar Plot

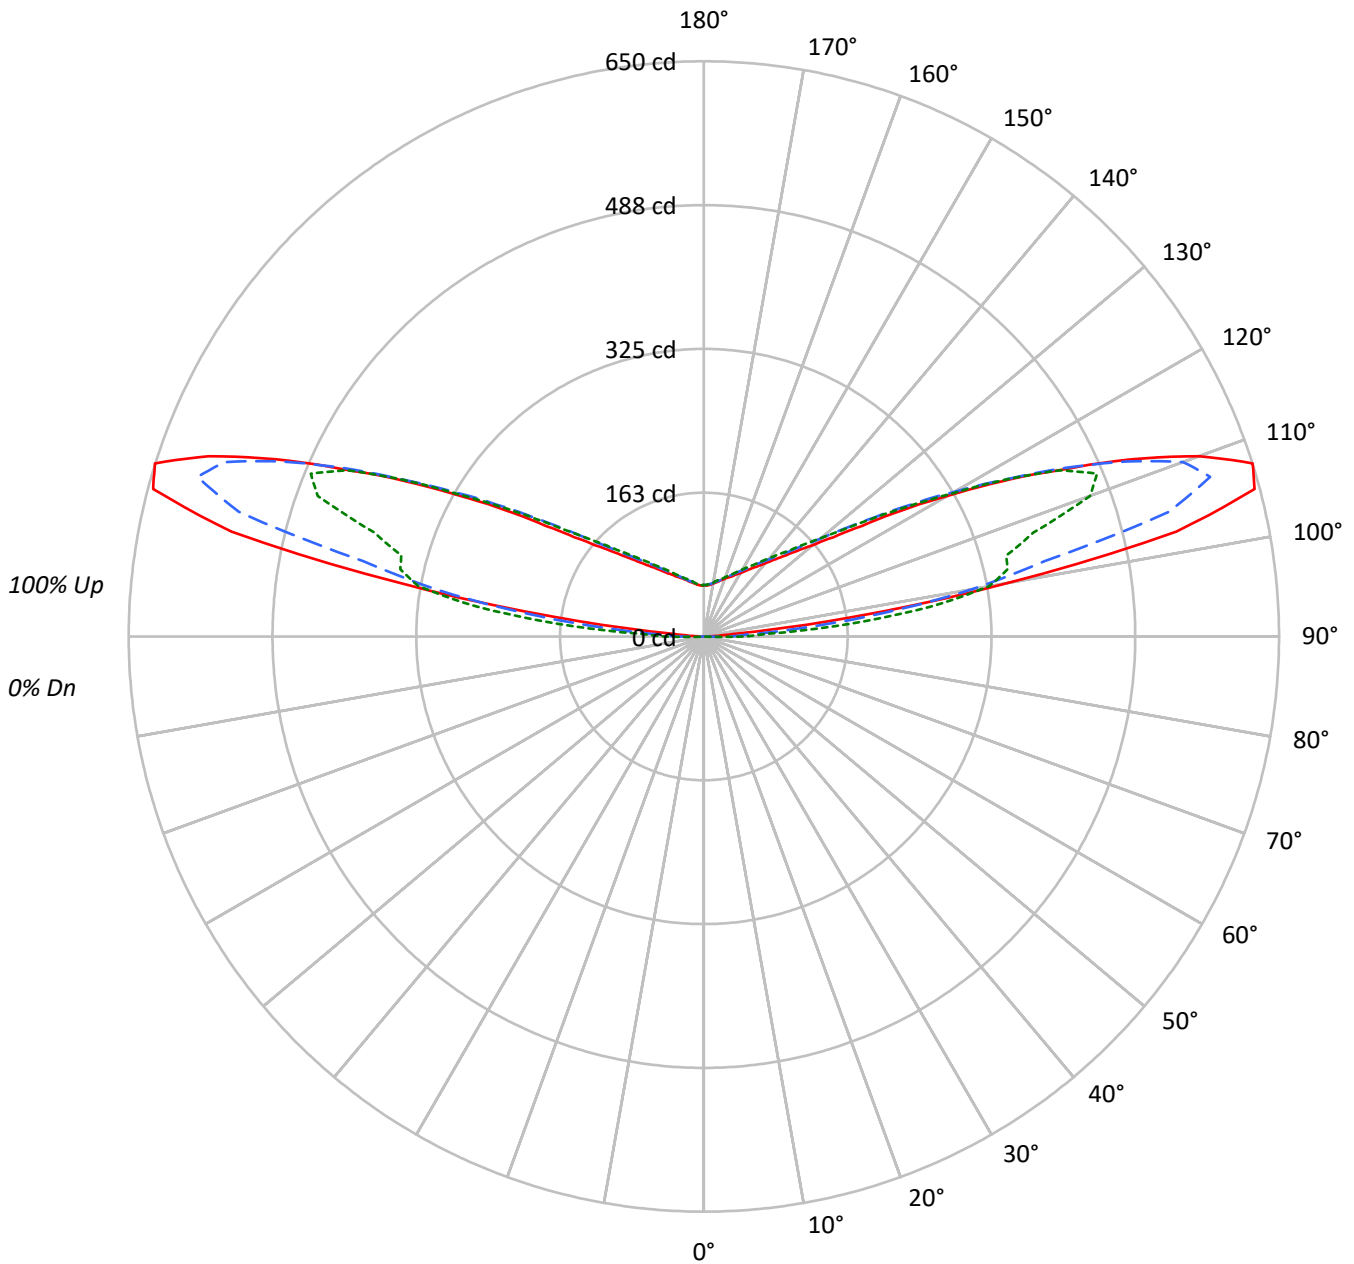



TEST NUMBER: P828554

CATALOG NUMBER: OHBL-12HE-W-UNV-L950-CD-UPL18

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR	0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10	0																		
	1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	9	0																		
	2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7	0																		
	3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6	0																		
	4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5	0																		
	5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4	0																		
	6	55	44	36	31	47	38	31	27	26	22	19	15	13	11	5	4	4	0																		
	7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3	0																		
	8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3	0																		
	9	43	32	25	20	37	27	22	18	19	15	13	11	9	8	4	3	2	0																		
	10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2	0																		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	0	0	0
5°	0	0	0
10°	0	0	0
15°	0	0	0
20°	0	0	0
25°	0	0	0
30°	0	0	0
35°	0	0	0
40°	0	0	0
45°	0	0	0
50°	0	0	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0



TEST NUMBER: P828554

CATALOG NUMBER: OHBL-12HE-W-UNV-L950-CD-UPL18

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	0.0	0.0
10°-20°	0.0	0.0
20°-30°	0.0	0.0
30°-40°	0.0	0.0
40°-50°	0.0	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	3.9	0.3
90°-100°	148.9	9.6
100°-110°	517.0	33.2
110°-120°	444.2	28.5
120°-130°	213.3	13.7
130°-140°	106.6	6.8
140°-150°	61.9	4.0
150°-160°	36.1	2.3
160°-170°	18.7	1.2
170°-180°	5.7	0.4
0°-30°	0.0	0.0
0°-40°	0.0	0.0
0°-60°	0.0	0.0
0°-90°	3.9	0.3
90°-120°	1110.0	71.3
90°-150°	1491.8	95.9
90°-180°	1552.0	99.7
0°-180°	1556.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	0	0	0	0	0	
5°	0	0	0	0	0	0
15°	0	0	0	0	0	0
25°	0	0	0	0	0	0
35°	0	0	0	0	0	0
45°	0	0	0	0	0	0
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	4	22	30	39	44	3
95°	33	71	112	145	166	104
105°	644	638	544	383	354	611
115°	446	451	450	445	444	450
125°	217	228	234	233	231	204
135°	129	131	136	137	138	102
145°	94	96	98	99	99	59
155°	75	76	77	78	78	35
165°	64	65	65	66	66	18
175°	58	58	59	59	59	6
180°	58	58	58	58	58	



TEST NUMBER: P828554

CATALOG NUMBER: OHBL-12HE-W-UNV-L950-CD-UPL18

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	0.0	0.0	0.0	0.0	0.0
2.5°	0.0	0.0	0.0	0.0	0.0
5°	0.0	0.0	0.0	0.0	0.0
7.5°	0.0	0.0	0.0	0.0	0.0
10°	0.0	0.0	0.0	0.0	0.0
12.5°	0.0	0.0	0.0	0.0	0.0
15°	0.0	0.0	0.0	0.0	0.0
17.5°	0.0	0.0	0.0	0.0	0.0
20°	0.0	0.0	0.0	0.0	0.0
22.5°	0.0	0.0	0.0	0.0	0.0
25°	0.0	0.0	0.0	0.0	0.0
27.5°	0.0	0.0	0.0	0.0	0.0
30°	0.0	0.0	0.0	0.0	0.0
32.5°	0.0	0.0	0.0	0.0	0.0
35°	0.0	0.0	0.0	0.0	0.0
37.5°	0.0	0.0	0.0	0.0	0.0
40°	0.0	0.0	0.0	0.0	0.0
42.5°	0.0	0.0	0.0	0.0	0.0
45°	0.0	0.0	0.0	0.0	0.0
47.5°	0.0	0.0	0.0	0.0	0.0
50°	0.0	0.0	0.0	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	3.5	21.7	29.6	39.1	43.5
92.5°	11.3	28.7	47.8	66.1	73.0
95°	33.0	71.3	112.2	145.2	166.1
97.5°	169.5	185.2	206.9	245.2	259.1
100°	349.5	366.9	307.8	322.6	327.8
102.5°	546.9	546.0	394.7	356.5	351.3
105°	644.3	638.2	544.3	383.4	353.9



TEST NUMBER: P828554

CATALOG NUMBER: OHBL-12HE-W-UNV-L950-CD-UPL18

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	523.4	526.9	516.4	502.5	480.8
115°	446.0	451.2	450.4	445.2	444.3
117.5°	379.9	382.6	384.3	382.6	383.4
120°	317.3	323.4	326.9	324.3	322.6
122.5°	265.2	273.0	277.4	274.7	273.0
125°	217.4	227.8	233.9	233.0	231.3
127.5°	184.3	192.1	200.0	199.1	197.4
130°	160.0	166.1	171.3	172.2	173.0
132.5°	143.5	146.1	151.3	152.2	153.9
135°	128.7	131.3	135.6	137.4	138.2
137.5°	117.4	120.0	123.5	125.2	126.1
140°	107.8	110.4	113.0	114.8	115.6
142.5°	100.0	102.6	105.2	106.1	106.9
145°	93.9	95.6	98.2	99.1	99.1
147.5°	87.8	89.6	91.3	93.0	93.0
150°	82.6	84.3	86.1	86.9	87.8
152.5°	79.1	80.0	81.7	82.6	82.6
155°	74.8	76.5	77.4	78.2	78.2
157.5°	72.2	73.0	73.9	74.8	74.8
160°	69.6	69.6	70.4	71.3	71.3
162.5°	66.9	66.9	67.8	68.7	68.7
165°	64.3	65.2	65.2	66.1	66.1
167.5°	62.6	62.6	63.5	63.5	64.3
170°	60.9	60.9	61.7	61.7	61.7
172.5°	59.1	60.0	60.0	60.0	60.0
175°	58.3	58.3	59.1	59.1	59.1
177.5°	57.4	58.3	58.3	58.3	58.3
180°	58.3	58.3	58.3	58.3	58.3



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180° - - 45°-225° - - - - 90°-270°







107.5°	650.3	650.3	599.9	466.0	390.4
110°	595.6	602.5	576.4	524.3	464.3



(END OF REPORT)