

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: METALUX

Report Number: P881287

Luminaire Tested: **24CZ2-75VHE-HRP-UNV-B35**

Issue Date: 10/2/2024

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P881287
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P474369)
Test Lab: INNOVATION CENTER(G3)
Issue Date: 10/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: METALUX
Catalog Number: 24CZ2-75VHE-HRP-UNV-B35
Description: 2X4 7500 LUMEN CRUZE TROFFER WITH BIO UP LEDS AT 3500K CCT AND HRP LENS

Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5878.0 lumens
Efficiency: N/A
Efficacy: 98.0 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.3 / 1.4
Luminous Opening: Rectangular (W 1.92' x L: 3.98' x H: 0')
CIE Type: Direct

Input Watts (W): 60
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P881287
CATALOG NUMBER: 24CZ2-75VHE-HRP-UNV-B35

Luminous Intensity Polar Plot

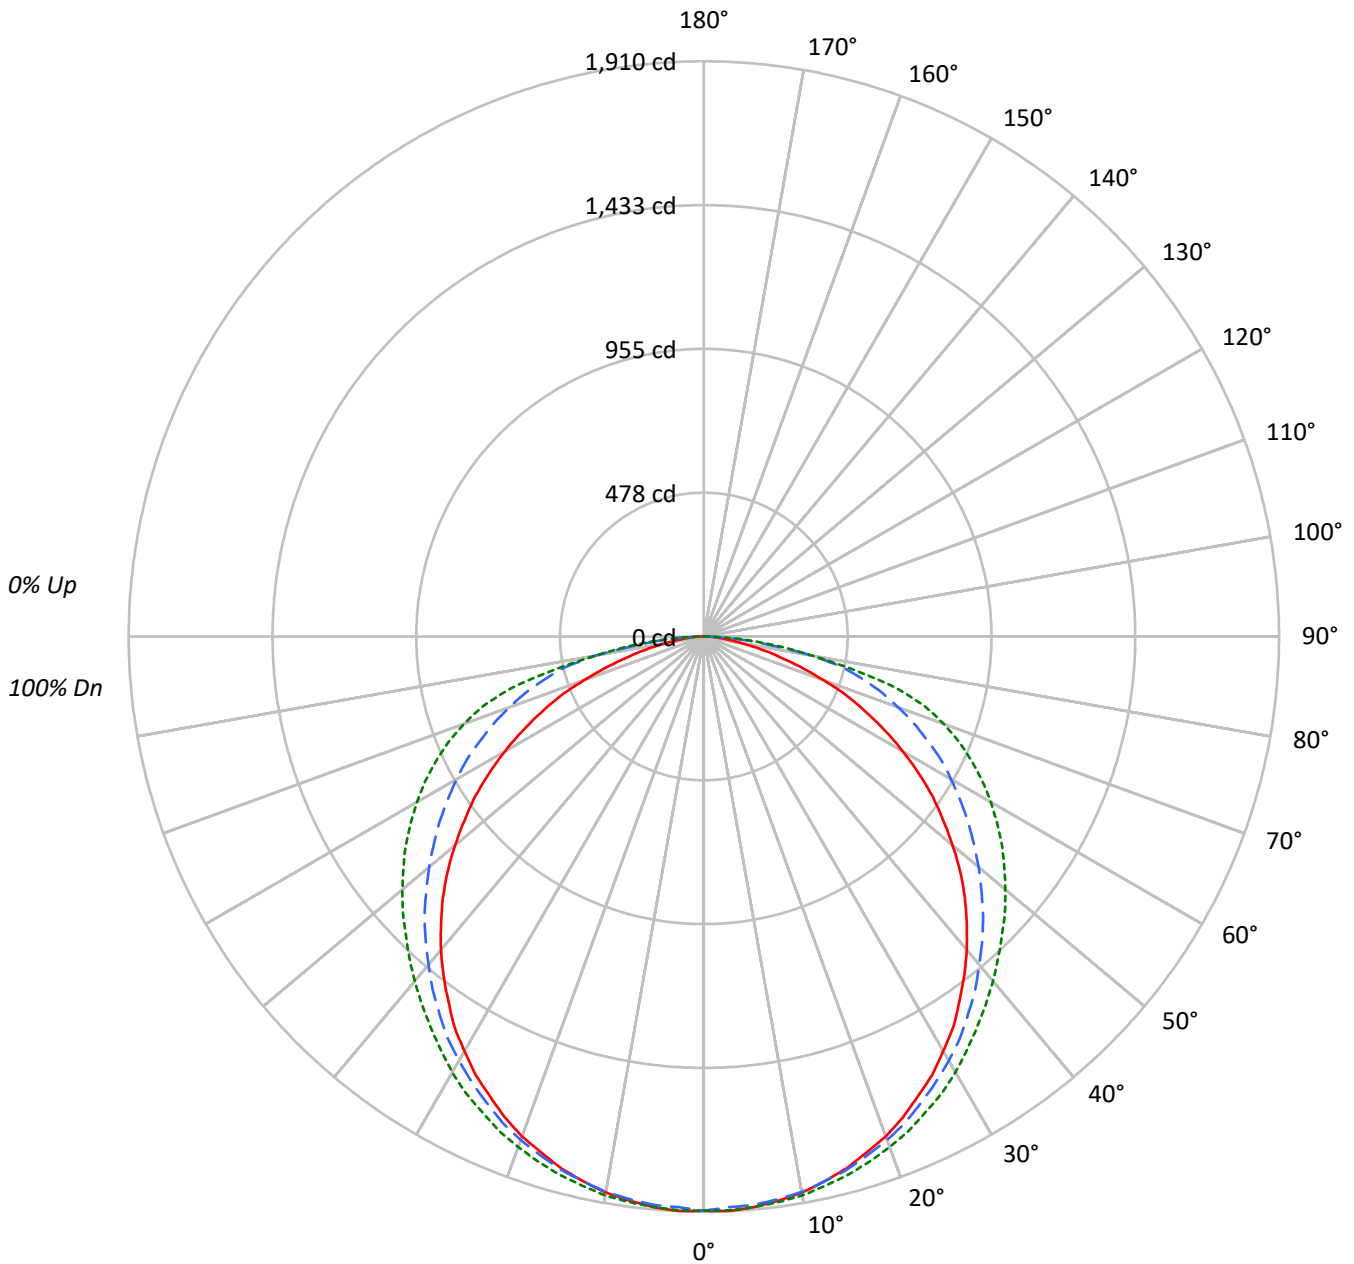



TEST NUMBER: P881287

CATALOG NUMBER: 24CZ2-75VHE-HRP-UNV-B35

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 108 | 103 | 98 | 94 | 105 | 101 | 96 | 93 | 96 | 93 | 90 | 92 | 90 | 87 | 89 | 86 | 84 | 82 | | | | | | | | | | | | | | | | | | | |
| 2 | 98 | 89 | 82 | 76 | 95 | 87 | 80 | 75 | 83 | 78 | 73 | 80 | 75 | 71 | 77 | 73 | 70 | 67 | | | | | | | | | | | | | | | | | | | |
| 3 | 89 | 78 | 69 | 62 | 86 | 76 | 68 | 62 | 73 | 66 | 61 | 70 | 64 | 59 | 68 | 63 | 58 | 56 | | | | | | | | | | | | | | | | | | | |
| 4 | 81 | 68 | 59 | 52 | 79 | 67 | 59 | 52 | 65 | 57 | 51 | 62 | 56 | 50 | 60 | 54 | 50 | 48 | | | | | | | | | | | | | | | | | | | |
| 5 | 74 | 61 | 52 | 45 | 72 | 60 | 51 | 45 | 58 | 50 | 44 | 56 | 49 | 44 | 54 | 48 | 43 | 41 | | | | | | | | | | | | | | | | | | | |
| 6 | 69 | 55 | 46 | 39 | 67 | 54 | 45 | 39 | 52 | 44 | 38 | 50 | 43 | 38 | 49 | 42 | 38 | 36 | | | | | | | | | | | | | | | | | | | |
| 7 | 63 | 50 | 41 | 34 | 62 | 49 | 40 | 34 | 47 | 39 | 34 | 46 | 39 | 34 | 44 | 38 | 33 | 31 | | | | | | | | | | | | | | | | | | | |
| 8 | 59 | 45 | 36 | 30 | 57 | 44 | 36 | 30 | 43 | 36 | 30 | 42 | 35 | 30 | 41 | 34 | 30 | 28 | | | | | | | | | | | | | | | | | | | |
| 9 | 55 | 41 | 33 | 27 | 54 | 41 | 33 | 27 | 40 | 32 | 27 | 39 | 32 | 27 | 38 | 31 | 27 | 25 | | | | | | | | | | | | | | | | | | | |
| 10 | 52 | 38 | 30 | 25 | 50 | 38 | 30 | 25 | 37 | 30 | 25 | 36 | 29 | 24 | 35 | 29 | 24 | 23 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° | 45° | 90° |
|-----|------|------|------|
| 0° | 2692 | 2692 | 2692 |
| 5° | 2695 | 2684 | 2695 |
| 10° | 2687 | 2684 | 2701 |
| 15° | 2671 | 2679 | 2704 |
| 20° | 2654 | 2672 | 2709 |
| 25° | 2621 | 2659 | 2713 |
| 30° | 2591 | 2651 | 2723 |
| 35° | 2548 | 2637 | 2726 |
| 40° | 2502 | 2621 | 2752 |
| 45° | 2446 | 2617 | 2795 |
| 50° | 2367 | 2615 | 2869 |
| 55° | 2283 | 2634 | 2973 |
| 60° | 2153 | 2674 | 3105 |
| 65° | 1988 | 2737 | 3280 |
| 70° | 1736 | 2832 | 3493 |
| 75° | 1409 | 2978 | 3609 |
| 80° | 1041 | 2921 | 2921 |
| 85° | 797 | 2152 | 2431 |



TEST NUMBER: P881287

CATALOG NUMBER: 24CZ2-75VHE-HRP-UNV-B35

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 180.7 | 3.1 |
| 10°-20° | 518.8 | 8.8 |
| 20°-30° | 789.8 | 13.4 |
| 30°-40° | 959.0 | 16.3 |
| 40°-50° | 1013.2 | 17.2 |
| 50°-60° | 956.1 | 16.3 |
| 60°-70° | 795.0 | 13.5 |
| 70°-80° | 523.0 | 8.9 |
| 80°-90° | 142.6 | 2.4 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1489.3 | 25.3 |
| 0°-40° | 2448.3 | 41.7 |
| 0°-60° | 4417.5 | 75.2 |
| 0°-90° | 5878.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5878.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | 22.5° | 45° | 67.5° | 90° | Flux |
|-----|------|-------|------|-------|------|------|
| 0° | 1907 | 1907 | 1907 | 1907 | 1907 | |
| 5° | 1902 | 1902 | 1895 | 1902 | 1902 | 181 |
| 15° | 1828 | 1831 | 1833 | 1851 | 1851 | 516 |
| 25° | 1683 | 1693 | 1708 | 1737 | 1742 | 776 |
| 35° | 1479 | 1496 | 1530 | 1570 | 1582 | 926 |
| 45° | 1225 | 1250 | 1311 | 1376 | 1400 | 944 |
| 55° | 928 | 967 | 1070 | 1172 | 1208 | 826 |
| 65° | 595 | 665 | 820 | 940 | 982 | 589 |
| 75° | 258 | 377 | 546 | 647 | 662 | 278 |
| 85° | 49 | 108 | 133 | 148 | 150 | 60 |
| 90° | 0 | 0 | 0 | 0 | 0 | |



TEST NUMBER: P881287

CATALOG NUMBER: 24CZ2-75VHE-HRP-UNV-B35

CANDELA DISTRIBUTION (FULL):

| | 0° | 22.5° | 45° | 67.5° | 90° |
|-------|--------|--------|--------|--------|--------|
| 0° | 1907.1 | 1907.1 | 1907.1 | 1907.1 | 1907.1 |
| 2.5° | 1909.5 | 1907.1 | 1897.2 | 1907.1 | 1907.1 |
| 5° | 1902.3 | 1902.3 | 1894.7 | 1902.3 | 1902.3 |
| 7.5° | 1889.9 | 1889.9 | 1884.8 | 1894.7 | 1894.7 |
| 10° | 1875.1 | 1875.1 | 1872.7 | 1884.8 | 1884.8 |
| 12.5° | 1853.0 | 1855.2 | 1853.0 | 1867.6 | 1867.6 |
| 15° | 1828.3 | 1830.7 | 1833.4 | 1850.6 | 1850.6 |
| 17.5° | 1796.5 | 1801.4 | 1806.2 | 1825.9 | 1828.3 |
| 20° | 1766.9 | 1769.1 | 1779.1 | 1801.4 | 1803.8 |
| 22.5° | 1727.6 | 1734.9 | 1747.3 | 1769.1 | 1776.9 |
| 25° | 1683.0 | 1693.0 | 1707.7 | 1737.3 | 1742.2 |
| 27.5° | 1641.3 | 1648.8 | 1668.5 | 1700.5 | 1710.4 |
| 30° | 1589.6 | 1602.0 | 1626.5 | 1658.5 | 1670.9 |
| 32.5° | 1540.4 | 1552.8 | 1582.4 | 1616.5 | 1626.5 |
| 35° | 1479.0 | 1496.2 | 1530.4 | 1570.0 | 1582.4 |
| 37.5° | 1419.8 | 1437.1 | 1479.0 | 1523.2 | 1538.2 |
| 40° | 1358.2 | 1377.9 | 1422.5 | 1473.9 | 1493.6 |
| 42.5° | 1291.8 | 1318.9 | 1368.2 | 1424.7 | 1447.0 |
| 45° | 1225.3 | 1250.1 | 1311.4 | 1375.5 | 1400.2 |
| 47.5° | 1154.3 | 1183.9 | 1250.1 | 1326.5 | 1356.1 |
| 50° | 1077.9 | 1114.7 | 1191.1 | 1274.6 | 1306.8 |
| 52.5° | 1001.7 | 1043.4 | 1129.5 | 1222.9 | 1257.6 |
| 55° | 927.7 | 967.0 | 1070.3 | 1171.5 | 1208.3 |
| 57.5° | 846.5 | 896.0 | 1009.0 | 1117.2 | 1154.3 |
| 60° | 762.8 | 817.1 | 947.4 | 1060.4 | 1099.9 |
| 62.5° | 679.1 | 740.7 | 888.2 | 1001.7 | 1043.4 |
| 65° | 595.4 | 664.6 | 819.6 | 940.1 | 982.1 |
| 67.5° | 514.2 | 590.6 | 755.5 | 876.1 | 917.8 |
| 70° | 420.8 | 516.9 | 686.4 | 804.8 | 846.5 |
| 72.5° | 334.7 | 445.6 | 619.9 | 731.0 | 767.9 |
| 75° | 258.3 | 376.7 | 546.2 | 647.1 | 661.9 |
| 77.5° | 189.4 | 307.5 | 470.0 | 504.2 | 506.9 |
| 80° | 128.1 | 245.9 | 359.4 | 354.4 | 359.4 |
| 82.5° | 83.7 | 184.6 | 226.3 | 253.5 | 255.9 |
| 85° | 49.2 | 108.4 | 132.9 | 147.7 | 150.1 |
| 87.5° | 24.5 | 36.9 | 46.8 | 49.2 | 54.1 |
| 90° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180° - - 45°-225° - - - - 90°-270°







(END OF REPORT)