

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: METALUX

Report Number: P388968

Luminaire Tested: **24CZ2-75VHE-UNV-L935-CD1-SDWPD1-U**

Issue Date: 2/28/2020

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.

Test Information

Test Method: LM-79-08
Report Number: P388968
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1805-783-5)
Test Lab: INNOVATIONS CENTER(G3)
Issue Date: 2/28/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: METALUX
Catalog Number: 24CZ2-75VHE-UNV-L935-CD1-SDWPD1-U
Description: 2x4 CRUZE LED TROFFER WITH 3500K, 90 LEDS, AND RIBBED LENS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6320.5 lumens
Efficiency: N/A
Efficacy: 126.7 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.27 / 1.37
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct


Input Watts (W): 49.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P388968

CATALOG NUMBER: 24CZ2-75VHE-UNV-L935-CD1-SDWPD1-U

Luminous Intensity Polar Plot

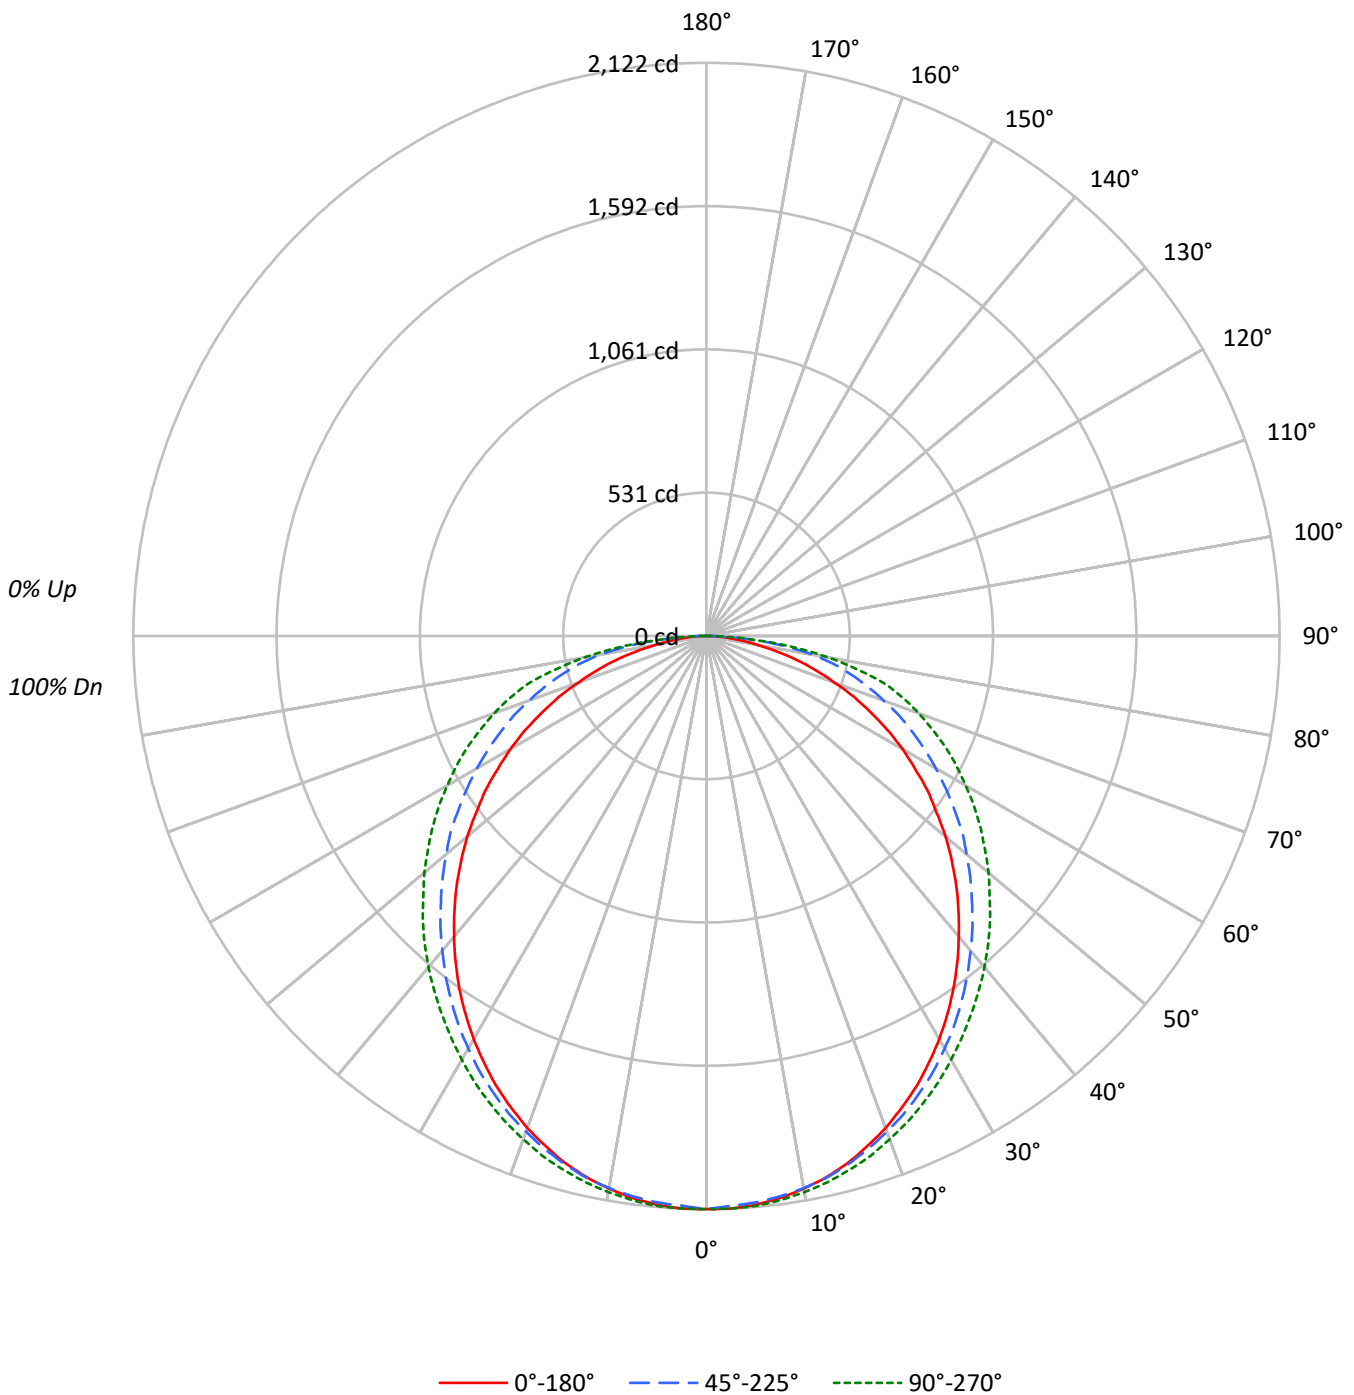



TEST NUMBER: P388968

CATALOG NUMBER: 24CZ2-75VHE-UNV-L935-CD1-SDWPD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	98	94	105	100	96	92	96	93	89	92	89	87	89	86	84	82
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	77	73	70	67
3	89	78	69	62	86	76	68	62	73	66	61	70	64	60	68	63	58	56
4	81	69	59	52	79	67	59	52	65	57	51	62	56	51	60	55	50	48
5	74	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43	41
6	69	55	46	39	67	54	45	39	52	44	39	50	44	38	49	43	38	36
7	64	50	41	35	62	49	40	34	47	40	34	46	39	34	45	38	34	32
8	59	45	37	31	58	45	36	31	43	36	30	42	35	30	41	35	30	28
9	55	42	33	28	54	41	33	28	40	33	27	39	32	27	38	32	27	25
10	52	38	30	25	51	38	30	25	37	30	25	36	29	25	35	29	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2855	2855	2855
5°	2855	2843	2860
10°	2839	2836	2856
15°	2815	2821	2850
20°	2776	2797	2839
25°	2731	2771	2828
30°	2678	2740	2815
35°	2619	2706	2806
40°	2553	2671	2812
45°	2488	2645	2826
50°	2420	2632	2852
55°	2346	2628	2905
60°	2253	2640	2980
65°	2136	2680	3110
70°	1983	2747	3286
75°	1810	2884	3564
80°	1488	3106	3563
85°	1139	2865	3061



TEST NUMBER: P388968

CATALOG NUMBER: 24CZ2-75VHE-UNV-L935-CD1-SDWPD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.7	3.2
10°-20°	573.0	9.1
20°-30°	862.2	13.6
30°-40°	1033.3	16.3
40°-50°	1076.8	17.0
50°-60°	1001.8	15.9
60°-70°	825.1	13.1
70°-80°	562.0	8.9
80°-90°	185.5	2.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1635.9	25.9
0°-40°	2669.2	42.2
0°-60°	4747.9	75.1
0°-90°	6320.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6320.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2122	2122	2122	2122	2122	
5°	2114	2114	2105	2116	2118	201
15°	2021	2023	2025	2044	2046	569
25°	1839	1848	1867	1898	1905	847
35°	1595	1614	1648	1692	1709	997
45°	1308	1335	1390	1460	1485	1009
55°	1000	1034	1120	1209	1238	891
65°	671	728	842	941	977	666
75°	348	426	555	654	686	367
85°	74	143	186	198	198	91
90°	0	0	0	0	0	



TEST NUMBER: P388968

CATALOG NUMBER: 24CZ2-75VHE-UNV-L935-CD1-SDWPD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2122.1	2122.1	2122.1	2122.1	2122.1
2.5°	2122.1	2122.1	2111.5	2122.1	2122.1
5°	2113.6	2113.6	2105.2	2115.8	2117.9
7.5°	2098.9	2101.0	2092.6	2105.2	2107.3
10°	2077.8	2079.9	2075.7	2088.3	2090.4
12.5°	2052.5	2054.6	2054.6	2069.4	2071.5
15°	2020.8	2022.9	2025.1	2044.0	2046.1
17.5°	1980.8	1987.1	1991.3	2014.5	2018.7
20°	1938.6	1944.9	1953.3	1978.6	1982.9
22.5°	1890.0	1898.5	1913.3	1940.7	1947.0
25°	1839.4	1847.9	1866.8	1898.5	1904.8
27.5°	1782.5	1795.1	1818.3	1852.1	1860.5
30°	1723.4	1736.1	1763.5	1799.3	1812.0
32.5°	1660.1	1677.0	1708.6	1748.7	1761.4
35°	1594.7	1613.7	1647.5	1691.8	1708.6
37.5°	1525.1	1546.2	1586.3	1634.8	1655.9
40°	1453.4	1478.7	1520.9	1577.9	1601.1
42.5°	1381.7	1404.9	1457.6	1518.8	1544.1
45°	1307.8	1335.3	1390.1	1459.7	1485.0
47.5°	1231.9	1259.3	1324.7	1398.6	1421.8
50°	1156.0	1183.4	1257.2	1335.3	1362.7
52.5°	1073.7	1109.6	1193.9	1272.0	1299.4
55°	999.9	1033.6	1120.1	1208.7	1238.2
57.5°	915.5	955.6	1050.5	1143.3	1175.0
60°	837.4	879.6	980.9	1075.8	1107.5
62.5°	757.3	803.7	911.3	1008.3	1044.2
65°	670.8	727.8	841.7	940.8	976.7
67.5°	592.7	651.8	772.1	873.3	904.9
70°	504.2	575.9	698.2	799.5	835.3
72.5°	428.2	499.9	628.6	727.8	763.6
75°	348.1	426.1	554.8	653.9	685.6
77.5°	267.9	354.4	483.1	559.0	569.5
80°	192.0	282.7	400.8	445.1	459.9
82.5°	135.0	217.3	295.3	324.9	333.3
85°	73.8	143.4	185.6	198.3	198.3
87.5°	31.6	61.2	73.8	75.9	78.0
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)