

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: METALUX

Report Number: P388830

Luminaire Tested: **24CZ2-55-SQR-UNV-L940-CD1-SDWPD1-U**

Issue Date: 2/28/2020

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.

Test Information

Test Method: LM-79-08
Report Number: P388830
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2002-678-2)
Test Lab: INNOVATION CENTER (G2)
Issue Date: 2/28/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: METALUX
Catalog Number: 24CZ2-55-SQR-UNV-L940-CD1-SDWPD1-U
Description: 2x4 CRUZE LED TROFFER WITH 4000K, 90 LEDS, AND SQUARE LENS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4459.2 lumens
Efficiency: N/A
Efficacy: 88.3 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.33 / 1.41
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct


Input Watts (W): 50.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P388830

CATALOG NUMBER: 24CZ2-55-SQR-UNV-L940-CD1-SDWPD1-U

Luminous Intensity Polar Plot

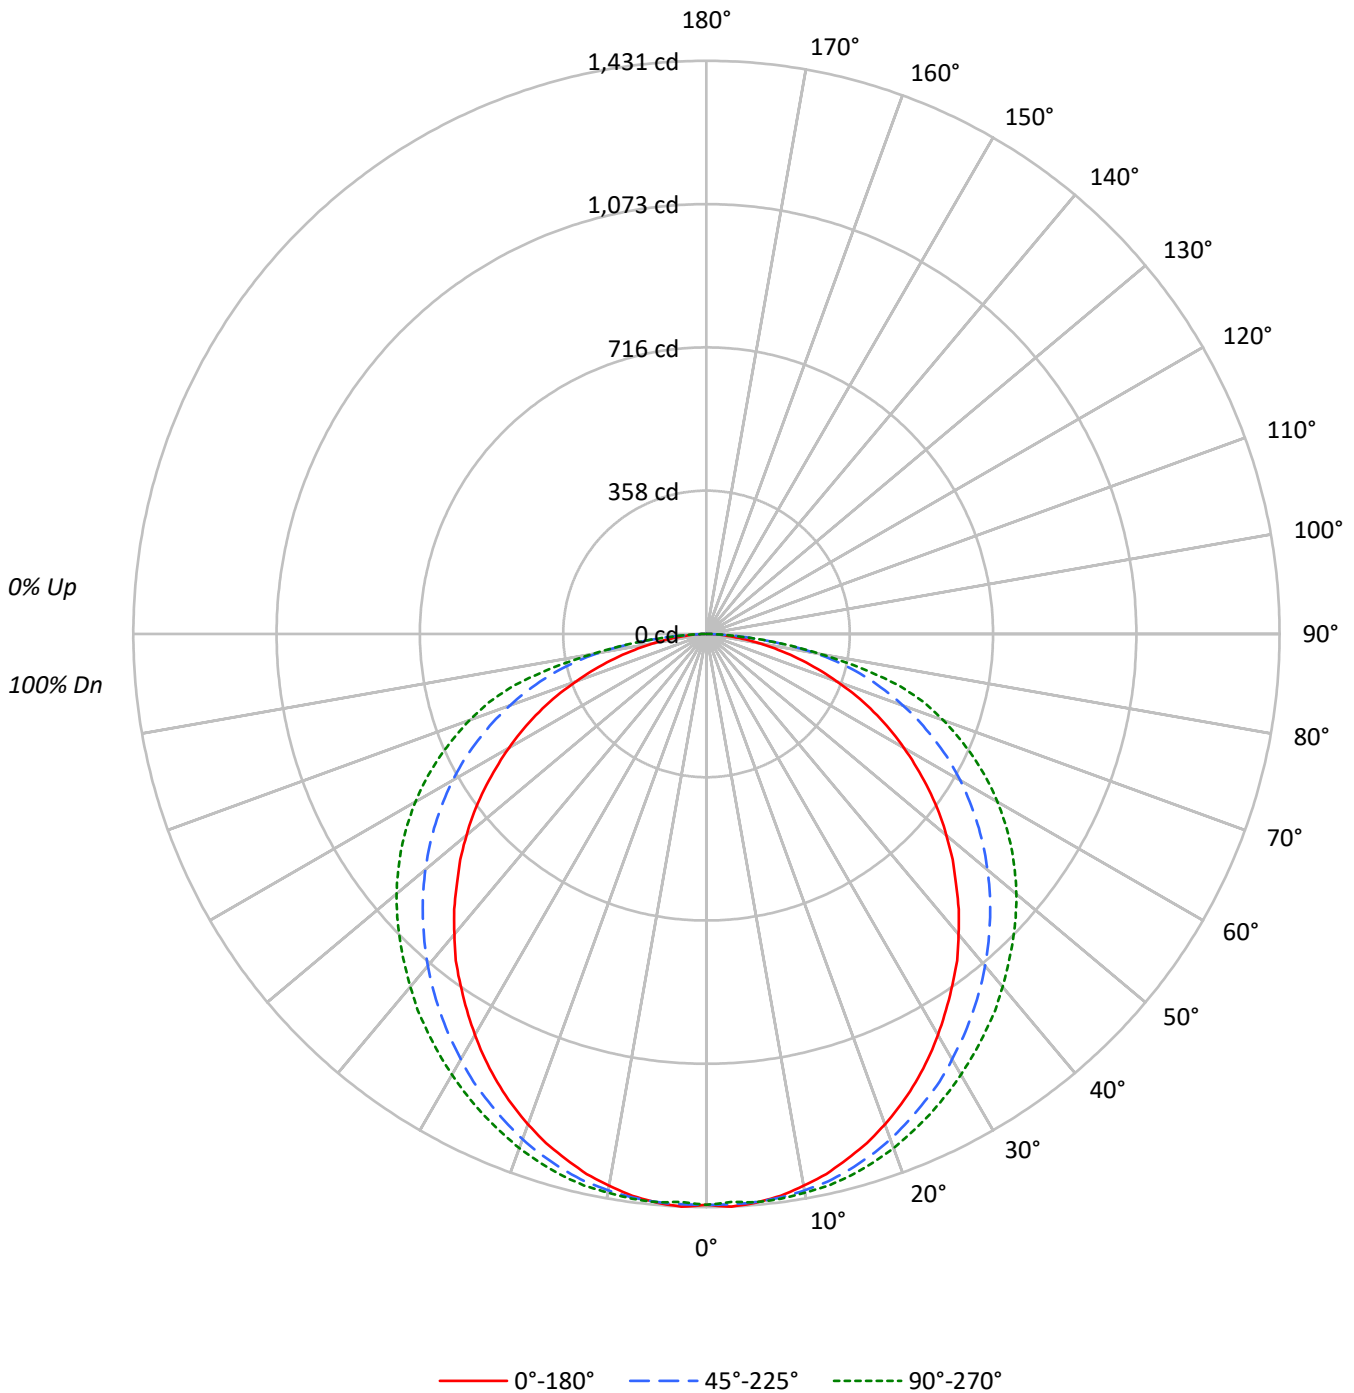



TEST NUMBER: P388830

CATALOG NUMBER: 24CZ2-55-SQR-UNV-L940-CD1-SDWPD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	98	94	105	100	96	92	96	93	89	92	89	87	89	86	84	82
2	98	89	81	75	95	87	80	74	83	78	73	80	75	71	77	73	69	67
3	89	77	69	62	86	76	68	61	73	66	60	70	64	59	67	62	58	56
4	81	68	59	52	78	67	58	52	64	57	51	62	55	50	60	54	49	47
5	74	61	51	44	72	60	51	44	57	50	44	55	49	43	54	48	43	41
6	68	55	45	39	66	54	45	38	52	44	38	50	43	38	48	42	37	35
7	63	49	40	34	62	49	40	34	47	39	34	45	39	33	44	38	33	31
8	59	45	36	30	57	44	36	30	43	35	30	42	35	30	40	34	30	28
9	55	41	33	27	54	41	33	27	39	32	27	38	32	27	37	31	27	25
10	52	38	30	25	50	37	30	24	36	29	24	36	29	24	35	29	24	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1918	1918	1918
5°	1925	1923	1923
10°	1911	1927	1935
15°	1891	1928	1949
20°	1866	1923	1957
25°	1834	1913	1963
30°	1796	1906	1974
35°	1758	1901	1993
40°	1720	1901	2020
45°	1676	1905	2059
50°	1637	1917	2114
55°	1589	1938	2179
60°	1534	1969	2259
65°	1467	2006	2353
70°	1361	2056	2474
75°	1233	2128	2587
80°	1038	2134	2225
85°	795	1613	1613



TEST NUMBER: P388830

CATALOG NUMBER: 24CZ2-55-SQR-UNV-L940-CD1-SDWPD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	135.3	3.0
10°-20°	389.3	8.7
20°-30°	591.3	13.3
30°-40°	719.2	16.1
40°-50°	765.7	17.2
50°-60°	729.3	16.4
60°-70°	609.9	13.7
70°-80°	406.7	9.1
80°-90°	112.5	2.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1115.9	25.0
0°-40°	1835.1	41.2
0°-60°	3330.1	74.7
0°-90°	4459.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4459.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1425	1425	1425	1425	1425	
5°	1425	1416	1424	1424	1424	135
15°	1358	1361	1384	1394	1399	383
25°	1235	1252	1288	1310	1322	569
35°	1070	1101	1157	1196	1213	670
45°	881	928	1001	1057	1082	681
55°	677	736	826	898	929	606
65°	461	529	630	708	739	455
75°	237	312	409	479	498	251
85°	52	96	104	103	104	62
90°	0	0	0	0	0	



TEST NUMBER: P388830

CATALOG NUMBER: 24CZ2-55-SQR-UNV-L940-CD1-SDWPD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1425.4	1425.4	1425.4	1425.4	1425.4
2.5°	1431.3	1421.0	1425.4	1425.4	1419.5
5°	1425.4	1416.5	1423.9	1423.9	1423.9
7.5°	1415.1	1407.7	1419.5	1422.4	1422.4
10°	1398.9	1395.9	1410.7	1415.1	1416.5
12.5°	1381.2	1379.7	1400.3	1406.2	1410.7
15°	1357.6	1360.6	1384.1	1394.5	1398.9
17.5°	1332.6	1338.5	1365.0	1379.7	1384.1
20°	1303.2	1312.0	1342.9	1357.6	1366.5
22.5°	1270.8	1284.0	1316.4	1334.1	1344.4
25°	1235.4	1251.6	1288.4	1310.5	1322.3
27.5°	1197.1	1217.8	1260.5	1285.5	1297.3
30°	1155.9	1179.5	1226.6	1256.0	1270.8
32.5°	1113.2	1141.2	1192.7	1225.1	1242.8
35°	1070.5	1101.4	1157.4	1195.7	1213.3
37.5°	1027.8	1058.7	1120.6	1161.8	1183.9
40°	979.2	1016.0	1082.3	1127.9	1150.0
42.5°	932.1	971.8	1042.5	1092.6	1116.2
45°	880.6	927.7	1001.3	1057.3	1082.3
47.5°	833.4	880.6	960.1	1019.0	1046.9
50°	781.9	832.0	915.9	980.7	1010.1
52.5°	731.8	783.4	871.7	940.9	970.4
55°	677.3	736.2	826.1	898.2	929.1
57.5°	622.9	686.2	779.0	854.0	885.0
60°	569.9	634.6	731.8	806.9	839.3
62.5°	516.8	581.6	683.2	759.8	790.7
65°	460.9	528.6	630.2	708.3	739.2
67.5°	404.9	475.6	577.2	655.3	684.7
70°	346.0	421.1	522.7	599.3	628.8
72.5°	291.6	366.7	466.8	541.9	569.9
75°	237.1	312.2	409.4	478.6	497.7
77.5°	184.1	259.2	346.0	391.7	396.1
80°	134.0	204.7	275.4	288.6	287.1
82.5°	89.8	153.1	190.0	191.4	195.8
85°	51.5	95.7	104.5	103.1	104.5
87.5°	20.6	33.9	29.4	22.1	22.1
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)