

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P319479

Luminaire Tested: **GLEON-SA5B-827-U-SL2**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P319479
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1903-205-20)
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: McGRAW-EDISON
Catalog Number: GLEON-SA5B-827-U-SL2
Description: GALLEON AREA AND ROADWAY LUMINAIRE
(5) 80 CRI, 2700K, 800mA LIGHTSQUARES WITH 16 LEDS EACH AND TYPE II SPILL
LIGHT ELIMINATOR OPTICS
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 20569 lumens
Efficiency: N/A
Efficacy: 97.9 lumens/watt
Luminous Opening: Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification: Type III - Medium
BUG Rating: B3 - U0 - G4


Input Watts (W): 210
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



REPORT NUMBER: P319479
 CATALOG NUMBER: GLEON-SA5B-827-U-SL2

Iso-Footcandle Lines of Horizontal Illumination


✕ Max cd
 - - - 1/2 Max cd

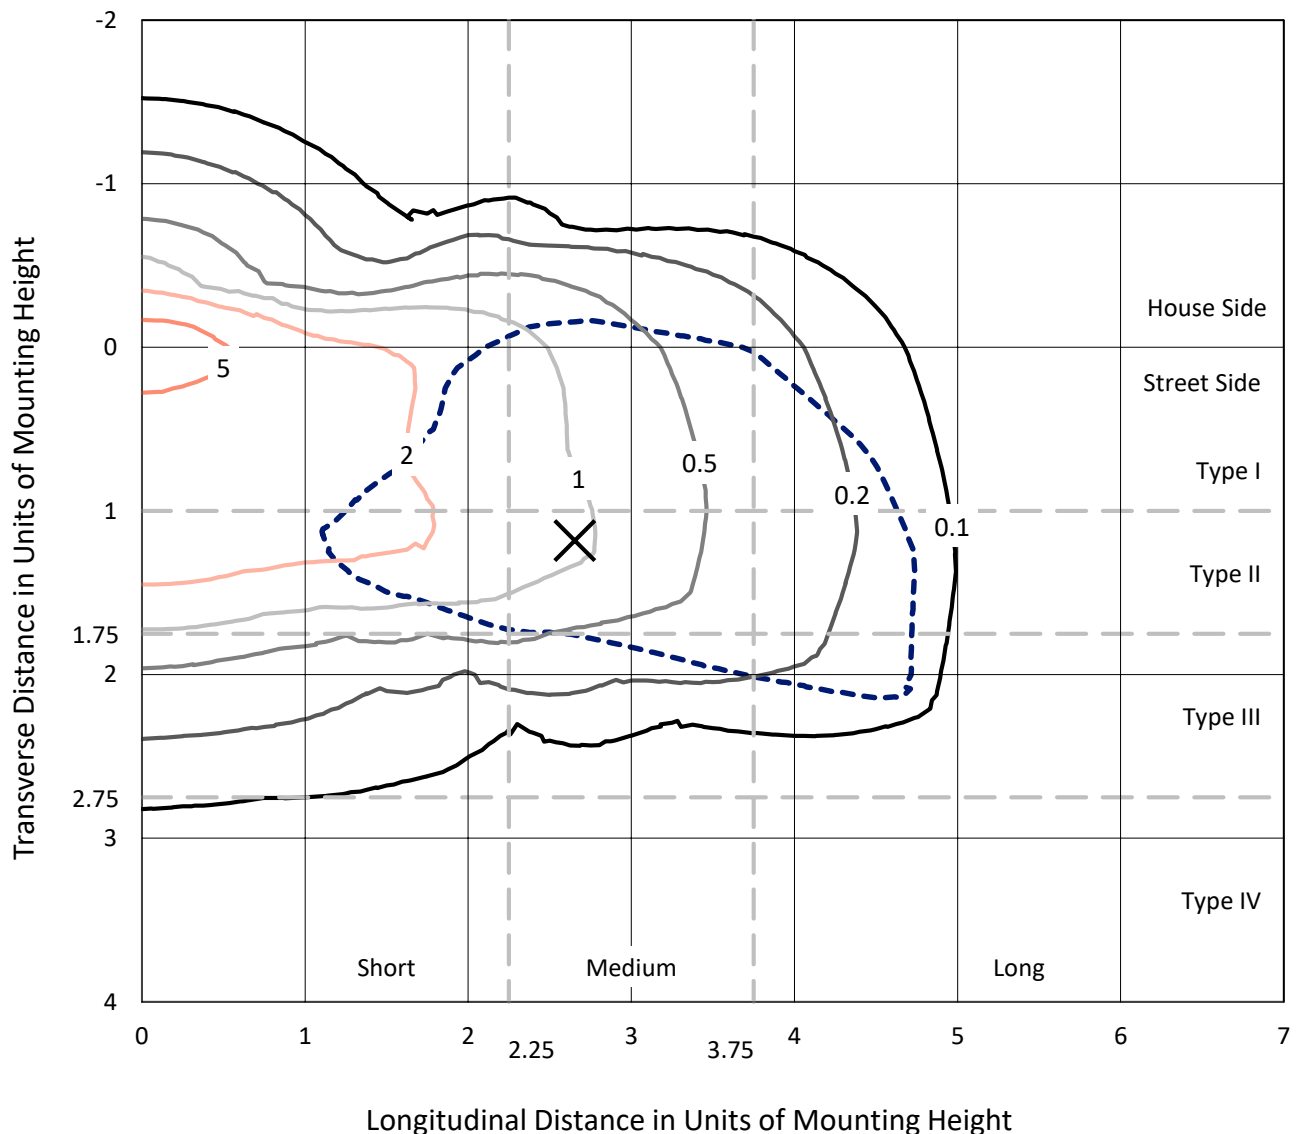

Based on 25 foot mounting height. Maximum calculated value = 7.5 fc
 Type III - Medium - N/A

REPORT NUMBER: P319479
CATALOG NUMBER: GLEON-SA5B-827-U-SL2

Luminous Intensity Polar Plot

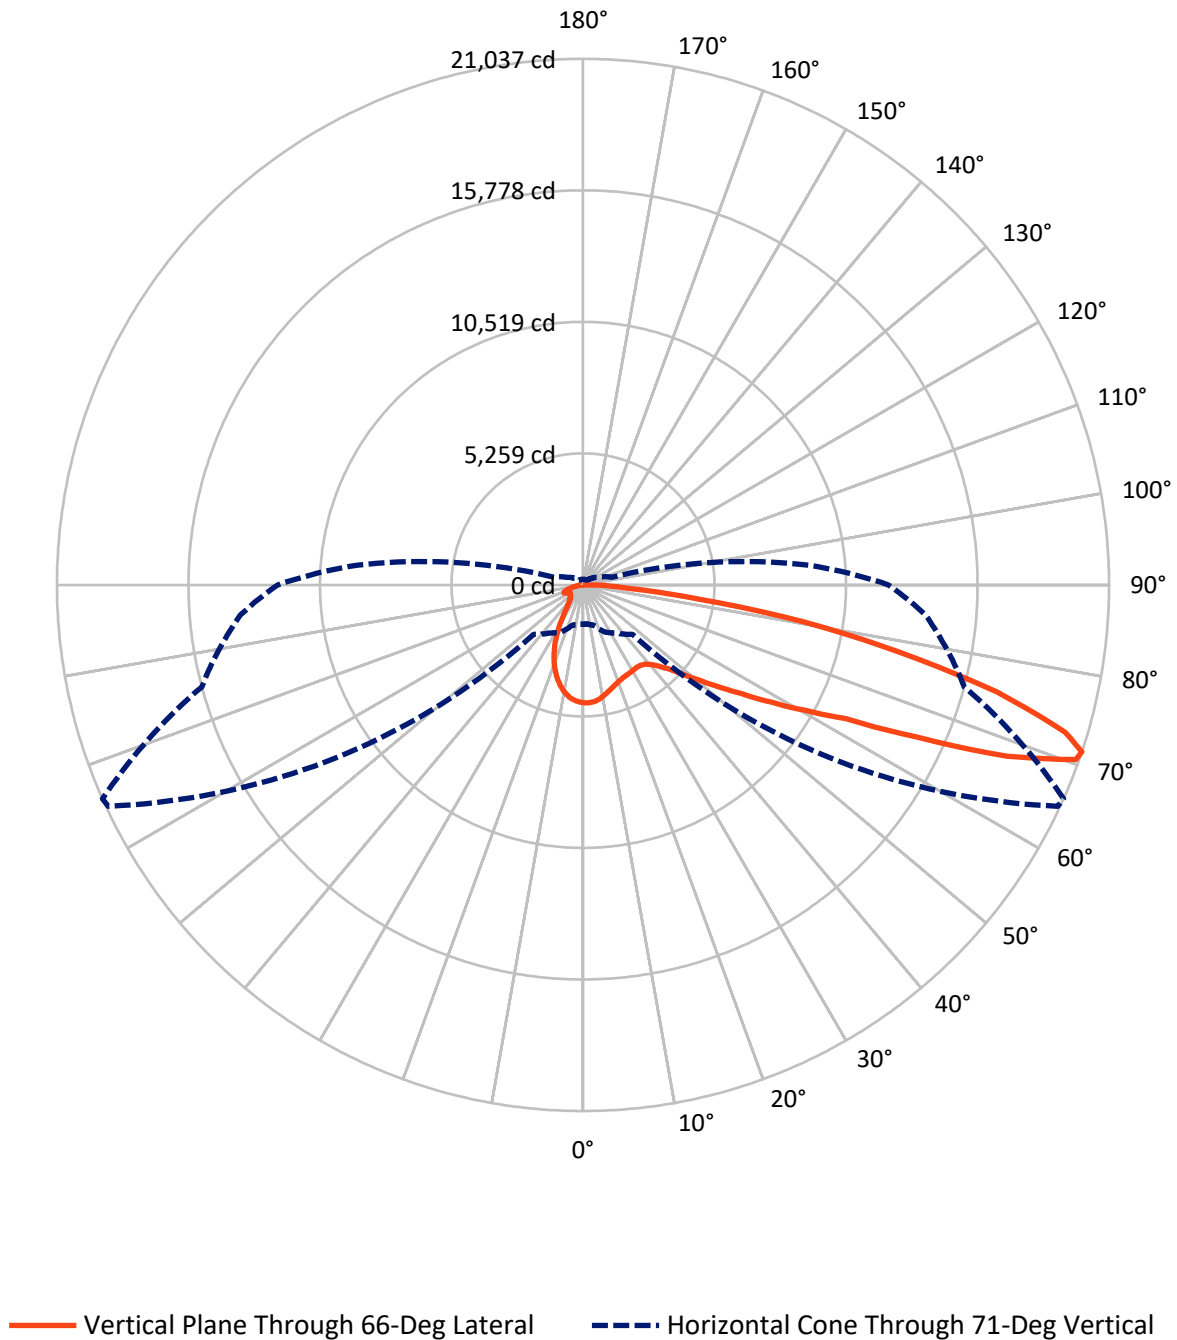

REPORT NUMBER: P319479

CATALOG NUMBER: GLEON-SA5B-827-U-SL2

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	3812.0	0.0	3812.0
	% Fixture	18.5	0.0	18.5
Street Side	Lumens	16757.0	0.0	16757.0
	% Fixture	81.5	0.0	81.5
Total	Lumens	20569.0	0.0	20569.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.8	2.0
10°-20°	994.8	4.8
20°-30°	1336.2	6.5
30°-40°	1757.8	8.5
40°-50°	2557.2	12.4
50°-60°	3994.5	19.4
60°-70°	5003.8	24.3
70°-80°	3816.8	18.6
80°-90°	693.1	3.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	20569.0	100.0
0°-180°	20569.0	100.0

Coefficient of Utilization



REPORT NUMBER: P319479


CATALOG NUMBER: GLEON-SA5B-827-U-SL2

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit		
				B	U	G
FL	(0°-30°)	1663.3	8.1			
FM	(30°-60°)	6994.5	34.0			
FH	(60°-80°)	7481.2	36.4			G3/7500
FVH	(80°-90°)	618.1	3.0			G4/750
BL	(0°-30°)	1082.5	5.3	B3/2500		
BM	(30°-60°)	1315.0	6.4	B2/2500		
BH	(60°-80°)	1339.4	6.5	B3/2500		G3/2500
BVH	(80°-90°)	75.0	0.4			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G4

Type III Medium

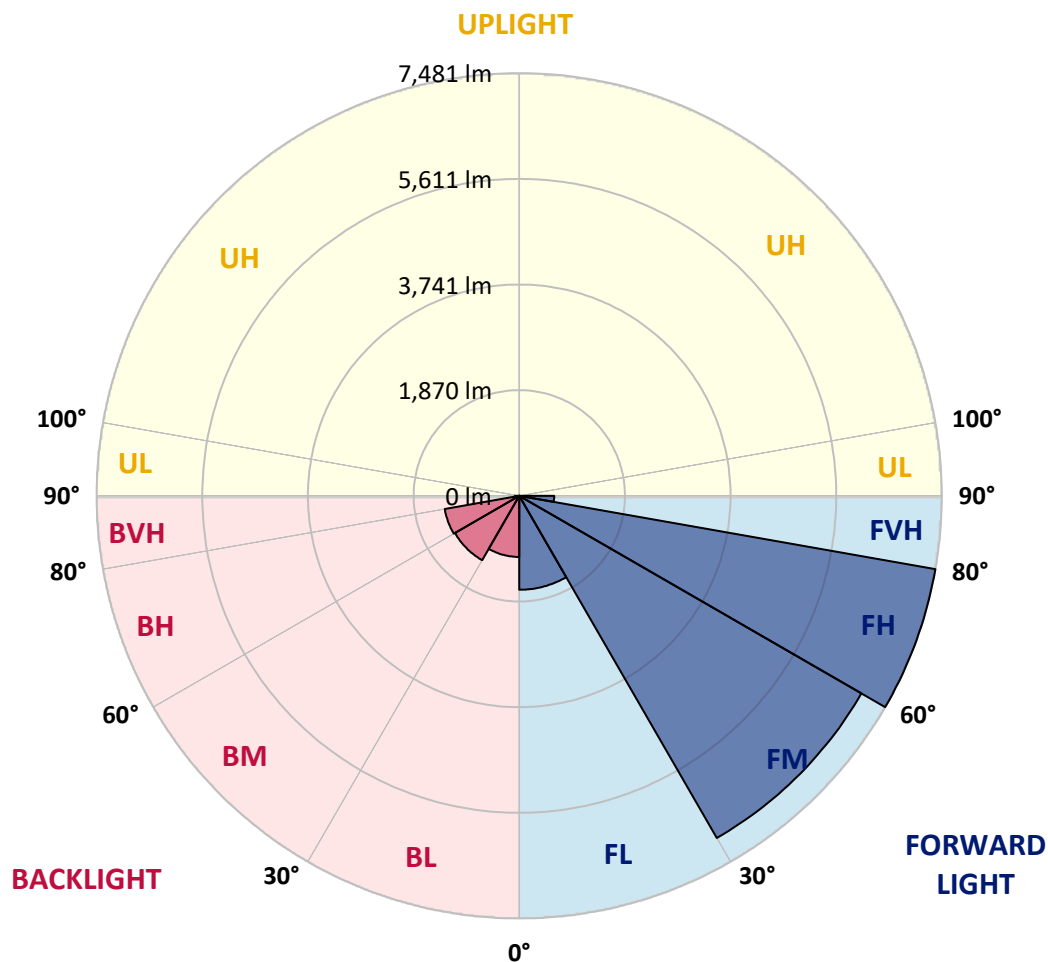



REPORT NUMBER: P319479

CATALOG NUMBER: GLEON-SA5B-827-U-SL2

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	4712.0	4712.0	4712.0	4712.0	4712.0	4712.0	4712.0	4712.0	4712.0	4712.0	4712.0
2.5°	4706.3	4710.5	4705.6	4677.2	4653.0	4614.0	4591.9	4561.4	4552.2	4547.9	4559.3
5°	4724.0	4725.5	4683.6	4609.0	4525.2	4426.5	4355.5	4268.1	4226.9	4209.2	4220.5
7.5°	4740.4	4734.0	4642.4	4499.6	4344.8	4172.9	4020.3	3880.4	3798.7	3765.3	3768.1
10°	4742.5	4715.5	4568.5	4347.6	4107.6	3855.5	3621.1	3405.3	3268.9	3180.1	3207.1
12.5°	4720.5	4675.0	4459.9	4150.9	3817.9	3474.1	3157.4	2833.6	2639.0	2548.8	2551.6
15°	4703.4	4621.1	4326.3	3919.4	3472.0	3016.8	2584.3	2203.6	1996.3	1904.0	1860.6
17.5°	4689.2	4562.8	4171.5	3658.8	3063.7	2486.3	1966.5	1627.0	1513.4	1486.4	1475.0
20°	4669.3	4501.0	3999.0	3357.0	2598.5	1892.6	1436.0	1268.4	1269.1	1300.3	1304.6
22.5°	4641.7	4430.7	3815.0	3018.2	2099.3	1378.4	1125.6	1077.3	1126.3	1186.0	1196.6
25°	4600.5	4347.6	3610.5	2644.0	1600.7	1059.6	961.6	959.4	1019.1	1081.6	1090.8
27.5°	4542.2	4239.0	3383.2	2242.0	1179.6	900.5	861.4	876.3	920.4	965.8	969.4
30°	4464.1	4112.6	3132.5	1818.0	924.6	801.8	797.5	811.0	838.0	870.0	872.8
32.5°	4378.2	3984.0	2864.8	1407.6	791.8	748.5	752.8	759.2	772.0	784.7	787.6
35°	4300.1	3852.7	2590.7	1069.5	728.6	713.7	710.9	709.5	710.9	706.6	707.3
37.5°	4249.6	3744.0	2305.2	851.5	692.4	683.2	674.7	664.0	651.9	644.8	646.3
40°	4231.2	3663.0	2016.2	735.7	662.6	656.2	639.9	617.1	602.9	598.7	598.7
42.5°	4280.9	3621.1	1737.1	677.5	637.7	627.1	600.1	573.8	563.2	562.5	561.7
45°	4432.9	3638.2	1471.5	645.5	615.0	594.4	558.9	536.9	529.8	531.2	530.5
47.5°	4705.6	3745.4	1244.2	624.2	592.3	565.3	525.5	507.8	499.2	499.2	500.0
50°	5169.3	3996.1	1063.1	606.5	573.1	538.3	501.4	479.4	468.0	467.3	467.3
52.5°	5844.7	4444.9	950.2	591.6	551.8	514.2	477.2	449.5	436.0	433.2	431.8
55°	6691.2	5088.3	919.0	581.6	523.4	487.9	448.1	420.4	405.5	399.1	398.4
57.5°	7637.8	5871.0	980.7	569.6	494.3	456.6	416.2	389.9	374.3	366.4	365.7
60°	8595.9	6725.3	1232.9	552.5	470.1	422.5	383.5	359.3	343.7	335.2	333.8
62.5°	9555.3	7625.8	1747.7	551.1	453.1	389.9	350.1	329.5	314.6	305.4	303.2
65°	10637.6	8611.5	2332.9	588.7	447.4	360.1	316.0	299.7	286.9	278.4	277.7
67.5°	11880.4	9724.3	2276.8	666.1	466.6	333.1	284.1	271.3	262.1	255.0	254.2
70°	12463.4	9550.3	1415.4	720.8	493.6	306.8	253.5	244.3	237.2	232.2	230.1
71°	12219.1	9068.1	1186.7	714.4	490.7	295.4	241.5	234.4	227.3	223.0	220.9
72.5°	11553.0	8269.9	990.0	664.7	458.8	274.8	225.8	218.7	212.3	207.4	205.9
75°	10367.0	7385.7	792.5	531.2	365.7	232.2	198.1	190.3	185.4	182.5	179.7
77.5°	7620.8	5270.9	612.9	419.7	269.2	189.6	169.0	163.3	158.4	154.1	152.0
80°	2919.5	2041.7	412.6	313.2	197.4	149.8	136.4	133.5	128.5	125.7	125.7
82.5°	786.2	610.0	220.2	189.6	132.1	109.4	104.4	103.0	98.7	93.0	93.7
85°	318.2	269.2	123.6	104.4	81.0	64.6	70.3	71.0	66.0	58.9	59.7
87.5°	139.9	114.3	68.9	46.2	35.5	24.9	32.0	32.0	29.1	24.1	22.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Invue

Report Number: SP1-2407-157-9

Test Date: 10/03/2024

Luminaire Tested: EMM2-HTN-SA1A-827-U-5WQ

Data applicable to all product families utilizing light square engine

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2407-157-9
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 10/03/2024
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Invue
 Catalog Number: **EMM2-HTN-SA1A-827-U-5WQ**
 Description: Epic Modern Light Square 40W 5WQ Optic

Spectral Parameters

CCT (K): 2764
 CIE u' : 0.2591
 CIE v' : 0.5290
 Duv: 0.0020
 CIE x: 0.4581
 CIE y: 0.4156
 CIE z: 0.1263
 Peak Wavelength (nm): 603
 Dominant Wavelength (nm): 583
 Purity: 62.2537
 R_f: 84.7
 R_g: 94.6

CRI (Ra): 80.9
 R1: 78.8
 R2: 89.9
 R3: 96.2
 R4: 79.1
 R5: 79.1
 R6: 88.8
 R7: 81.3
 R8: 54.3
 R9: -1.5
 R10: 77.9
 R11: 78.9
 R12: 71.6
 R13: 81.2
 R14: 98.5
 R15: 69.9



Test Conditions

Stabilization Time: 81M
 Operation Time: 2H 21M
 Sphere Temperature (°C): 25.2

REPORT NUMBER: SP1-2407-157-9

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-157-9

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 2700K 4-step quadrangle

REPORT NUMBER: SP1-2407-157-9

Melanopic Flux vs. Wavelength



Melanopic Lumens: 9797

M/P: 2.26

λ (nm)	Power (μW/nm)	Lumens (Φ/nm)	λ (nm)	Power (μW/nm)	Lumens (Φ/nm)	λ (nm)	Power (μW/nm)	Lumens (Φ/nm)	λ (nm)	Power (μW/nm)	Lumens (Φ/nm)	λ (nm)	Power (μW/nm)	Lumens (Φ/nm)
360	0	0.0	490	18018	27.7	620	87426	1.1	750	2680	0.0	880	58	0.0
365	0	0.0	495	22295	36.0	625	83013	0.7	755	2287	0.0	885	46	0.0
370	0	0.0	500	26478	44.2	630	78077	0.4	760	1944	0.0	890	45	0.0
375	0	0.0	505	30524	51.8	635	72080	0.3	765	1653	0.0	895	41	0.0
380	0	0.0	510	33611	57.0	640	66249	0.2	770	1413	0.0	900	38	0.0
385	0	0.0	515	36490	60.5	645	59973	0.1	775	1198	0.0	905	33	0.0
390	0	0.0	520	38610	61.4	650	53972	0.1	780	1025	0.0	910	30	0.0
395	0	0.0	525	40511	60.6	655	48369	0.0	785	874	0.0	915	23	0.0
400	48	0.0	530	42223	58.2	660	42641	0.0	790	747	0.0	920	24	0.0
405	201	0.0	535	44137	55.0	665	37602	0.0	795	639	0.0	925	22	0.0
410	457	0.0	540	46032	50.9	670	32798	0.0	800	547	0.0	930	22	0.0
415	925	0.1	545	48553	46.6	675	28558	0.0	805	473	0.0	935	17	0.0
420	1816	0.3	550	51408	42.0	680	24782	0.0	810	401	0.0	940	13	0.0
425	3217	0.8	555	54711	37.4	685	21386	0.0	815	351	0.0	945	6	0.0
430	5520	1.9	560	58847	32.9	690	18413	0.0	820	307	0.0	950	10	0.0
435	9225	4.1	565	63386	28.4	695	15721	0.0	825	261	0.0	955	11	0.0
440	15522	8.7	570	68196	24.1	700	13432	0.0	830	228	0.0	960	8	0.0
445	27642	18.5	575	73613	20.0	705	11513	0.0	835	193	0.0	965	12	0.0
450	36602	28.3	580	79207	16.3	710	9780	0.0	840	174	0.0	970	3	0.0
455	28292	24.7	585	84248	12.9	715	8356	0.0	845	151	0.0	975	8	0.0
460	21166	20.4	590	88397	9.8	720	7161	0.0	850	123	0.0	980	2	0.0
465	19092	20.1	595	91428	7.3	725	6067	0.0	855	106	0.0	985	13	0.0
470	14951	17.2	600	93452	5.3	730	5164	0.0	860	95	0.0	990	16	0.0
475	12606	15.7	605	93959	3.7	735	4393	0.0	865	82	0.0	995	20	0.0
480	13323	18.0	610	93079	2.5	740	3694	0.0	870	77	0.0	1000	0	0.0
485	15164	21.9	615	90707	1.7	745	3157	0.0	875	65	0.0			

REPORT NUMBER: SP1-2407-157-9

TM-30-18

Summary

$R_f = 84.7$
 $R_g = 94.6$
 $CIE\ R_a = 80.9$
 $R_g = -1.5$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 84	CES51 = 95	CES76 = 81
CES02 = 63	CES27 = 95	CES52 = 94	CES77 = 84
CES03 = 31	CES28 = 94	CES53 = 89	CES78 = 81
CES04 = 71	CES29 = 87	CES54 = 91	CES79 = 89
CES05 = 50	CES30 = 94	CES55 = 90	CES80 = 89
CES06 = 52	CES31 = 89	CES56 = 86	CES81 = 69
CES07 = 43	CES32 = 82	CES57 = 85	CES82 = 96
CES08 = 41	CES33 = 91	CES58 = 86	CES83 = 93
CES09 = 29	CES34 = 92	CES59 = 91	CES84 = 92
CES10 = 77	CES35 = 96	CES60 = 94	CES85 = 76
CES11 = 60	CES36 = 90	CES61 = 89	CES86 = 65
CES12 = 66	CES37 = 96	CES62 = 94	CES87 = 84
CES13 = 44	CES38 = 98	CES63 = 87	CES88 = 86
CES14 = 74	CES39 = 98	CES64 = 82	CES89 = 73
CES15 = 72	CES40 = 95	CES65 = 78	CES90 = 88
CES16 = 48	CES41 = 96	CES66 = 81	CES91 = 82
CES17 = 50	CES42 = 97	CES67 = 80	CES92 = 64
CES18 = 57	CES43 = 91	CES68 = 83	CES93 = 78
CES19 = 73	CES44 = 99	CES69 = 88	CES94 = 59
CES20 = 67	CES45 = 93	CES70 = 80	CES95 = 74
CES21 = 87	CES46 = 89	CES71 = 79	CES96 = 83
CES22 = 79	CES47 = 92	CES72 = 92	CES97 = 88
CES23 = 92	CES48 = 83	CES73 = 75	CES98 = 83
CES24 = 91	CES49 = 90	CES74 = 91	CES99 = 74
CES25 = 72	CES50 = 94	CES75 = 81	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)