

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: NEO-RAY

Report Number: P888264

Luminaire Tested: **DPT5-6FO55-37V60-A-XX-UDD_3500K**

Issue Date: 10/24/2024

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P888264
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (DEFINE LENGTH SCALING TOOL)
Test Lab: INNOVATIONS CENTER
Issue Date: 10/24/2024
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: NEO-RAY
Catalog Number: DPT5-6FO55-37V60-A-XX-UDD_3500K
Description: 5in Define Recessed Patient with Asymmetric Lens

Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1221.0 lumens
Efficiency: N/A
Efficacy: 93.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.11 / 1.25
Luminous Opening: Rectangular (W 4.31' x L: 0.39' x H: 0')
CIE Type: Direct

Input Watts (W): 13.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P888264

CATALOG NUMBER: DPT5-6FO55-37V60-A-XX-UDD_3500K

Luminous Intensity Polar Plot

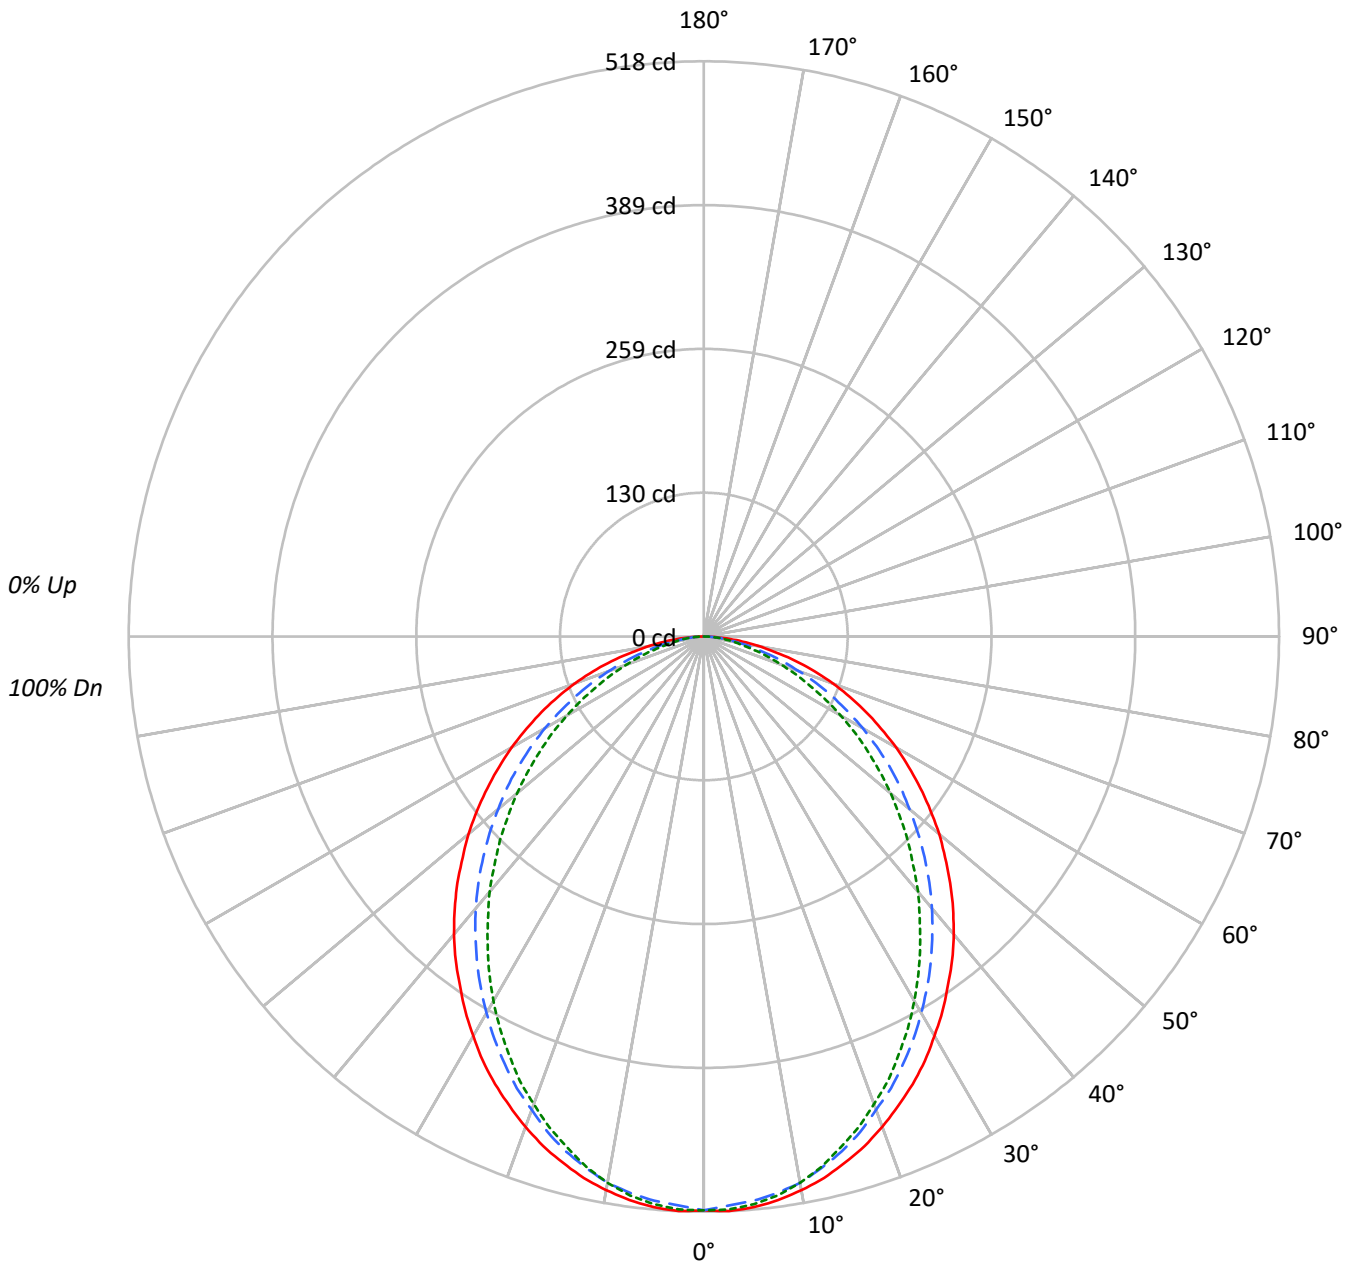



TEST NUMBER: P888264

CATALOG NUMBER: DPT5-6FO55-37V60-A-XX-UDD_3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 109 | 105 | 101 | 97 | 107 | 103 | 99 | 96 | 99 | 96 | 93 | 95 | 92 | 90 | 91 | 89 | 87 | 85 | | | | | | | | | | | | | | | | | | | |
| 2 | 100 | 92 | 86 | 80 | 98 | 90 | 84 | 79 | 87 | 82 | 78 | 84 | 79 | 76 | 81 | 77 | 74 | 72 | | | | | | | | | | | | | | | | | | | |
| 3 | 92 | 82 | 74 | 68 | 89 | 80 | 73 | 67 | 77 | 71 | 66 | 74 | 69 | 65 | 72 | 67 | 64 | 61 | | | | | | | | | | | | | | | | | | | |
| 4 | 84 | 73 | 64 | 58 | 82 | 71 | 64 | 57 | 69 | 62 | 57 | 67 | 61 | 56 | 64 | 59 | 55 | 53 | | | | | | | | | | | | | | | | | | | |
| 5 | 78 | 65 | 57 | 50 | 76 | 64 | 56 | 50 | 62 | 55 | 49 | 60 | 54 | 49 | 58 | 53 | 48 | 46 | | | | | | | | | | | | | | | | | | | |
| 6 | 72 | 59 | 50 | 44 | 70 | 58 | 50 | 44 | 56 | 49 | 44 | 55 | 48 | 43 | 53 | 47 | 43 | 41 | | | | | | | | | | | | | | | | | | | |
| 7 | 67 | 54 | 45 | 39 | 65 | 53 | 45 | 39 | 51 | 44 | 39 | 50 | 43 | 39 | 49 | 43 | 38 | 36 | | | | | | | | | | | | | | | | | | | |
| 8 | 62 | 49 | 41 | 35 | 61 | 48 | 41 | 35 | 47 | 40 | 35 | 46 | 39 | 35 | 45 | 39 | 34 | 33 | | | | | | | | | | | | | | | | | | | |
| 9 | 58 | 45 | 37 | 32 | 57 | 45 | 37 | 32 | 44 | 37 | 32 | 42 | 36 | 31 | 41 | 36 | 31 | 29 | | | | | | | | | | | | | | | | | | | |
| 10 | 55 | 42 | 34 | 29 | 54 | 41 | 34 | 29 | 40 | 34 | 29 | 39 | 33 | 29 | 39 | 33 | 29 | 27 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° | 45° | 90° |
|-----|------|------|------|
| 0° | 3300 | 3300 | 3300 |
| 5° | 3308 | 3271 | 3290 |
| 10° | 3283 | 3240 | 3240 |
| 15° | 3244 | 3174 | 3148 |
| 20° | 3194 | 3082 | 3045 |
| 25° | 3135 | 2993 | 2926 |
| 30° | 3063 | 2887 | 2795 |
| 35° | 2988 | 2779 | 2648 |
| 40° | 2919 | 2665 | 2503 |
| 45° | 2834 | 2538 | 2345 |
| 50° | 2749 | 2400 | 2180 |
| 55° | 2651 | 2269 | 2004 |
| 60° | 2552 | 2109 | 1815 |
| 65° | 2436 | 1924 | 1597 |
| 70° | 2304 | 1690 | 1378 |
| 75° | 2120 | 1426 | 1147 |
| 80° | 1868 | 1122 | 964 |
| 85° | 1568 | 916 | 857 |



TEST NUMBER: P888264

CATALOG NUMBER: DPT5-6FO55-37V60-A-XX-UDD_3500K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 48.6 | 4.0 |
| 10°-20° | 135.9 | 11.1 |
| 20°-30° | 197.1 | 16.1 |
| 30°-40° | 224.5 | 18.4 |
| 40°-50° | 218.9 | 17.9 |
| 50°-60° | 184.2 | 15.1 |
| 60°-70° | 129.1 | 10.6 |
| 70°-80° | 66.2 | 5.4 |
| 80°-90° | 16.5 | 1.4 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 381.7 | 31.3 |
| 0°-40° | 606.2 | 49.6 |
| 0°-60° | 1009.2 | 82.7 |
| 0°-90° | 1221.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1221.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | 22.5° | 45° | 67.5° | 90° | Flux |
|-----|-----|-------|-----|-------|-----|------|
| 0° | 517 | 517 | 517 | 517 | 517 | |
| 5° | 516 | 514 | 510 | 514 | 513 | 49 |
| 15° | 491 | 488 | 480 | 480 | 476 | 138 |
| 25° | 445 | 439 | 425 | 420 | 415 | 205 |
| 35° | 383 | 374 | 356 | 345 | 340 | 240 |
| 45° | 314 | 303 | 281 | 265 | 260 | 242 |
| 55° | 238 | 226 | 204 | 186 | 180 | 213 |
| 65° | 161 | 148 | 127 | 112 | 106 | 160 |
| 75° | 86 | 74 | 58 | 49 | 46 | 91 |
| 85° | 21 | 14 | 12 | 12 | 12 | 25 |
| 90° | 0 | 0 | 0 | 0 | 0 | |



TEST NUMBER: P888264

CATALOG NUMBER: DPT5-6FO55-37V60-A-XX-UDD_3500K

CANDELA DISTRIBUTION (FULL):

| | 0° | 22.5° | 45° | 67.5° | 90° |
|-------|-------|-------|-------|-------|-------|
| 0° | 516.8 | 516.8 | 516.8 | 516.8 | 516.8 |
| 2.5° | 518.0 | 516.8 | 512.9 | 516.8 | 516.4 |
| 5° | 516.0 | 514.5 | 510.2 | 514.0 | 513.2 |
| 7.5° | 512.1 | 510.5 | 505.5 | 508.6 | 507.8 |
| 10° | 506.3 | 505.1 | 499.6 | 500.8 | 499.6 |
| 12.5° | 499.6 | 498.0 | 490.2 | 491.0 | 489.1 |
| 15° | 490.7 | 488.3 | 480.0 | 479.7 | 476.2 |
| 17.5° | 481.3 | 477.8 | 468.0 | 466.1 | 463.3 |
| 20° | 469.9 | 466.1 | 453.5 | 451.6 | 448.1 |
| 22.5° | 457.5 | 453.5 | 440.4 | 436.0 | 433.2 |
| 25° | 444.9 | 439.1 | 424.7 | 419.6 | 415.3 |
| 27.5° | 431.0 | 423.9 | 408.7 | 402.1 | 397.8 |
| 30° | 415.3 | 407.9 | 391.5 | 382.6 | 379.0 |
| 32.5° | 400.0 | 391.1 | 374.3 | 364.2 | 359.6 |
| 35° | 383.3 | 374.0 | 356.4 | 345.1 | 339.6 |
| 37.5° | 367.3 | 355.9 | 338.0 | 324.8 | 319.2 |
| 40° | 350.1 | 338.4 | 319.7 | 304.8 | 300.2 |
| 42.5° | 332.1 | 320.0 | 300.5 | 286.5 | 279.0 |
| 45° | 313.8 | 302.6 | 281.0 | 265.4 | 259.6 |
| 47.5° | 294.6 | 283.0 | 261.5 | 245.5 | 238.9 |
| 50° | 276.7 | 263.8 | 241.6 | 225.3 | 219.4 |
| 52.5° | 257.2 | 244.0 | 223.2 | 205.3 | 199.4 |
| 55° | 238.1 | 225.6 | 203.8 | 186.2 | 180.0 |
| 57.5° | 218.6 | 205.3 | 184.3 | 167.0 | 161.6 |
| 60° | 199.8 | 186.2 | 165.1 | 147.9 | 142.1 |
| 62.5° | 180.0 | 167.0 | 145.6 | 130.0 | 124.1 |
| 65° | 161.2 | 147.9 | 127.3 | 111.6 | 105.7 |
| 67.5° | 142.4 | 129.2 | 109.3 | 94.5 | 89.9 |
| 70° | 123.4 | 110.1 | 90.5 | 78.4 | 73.8 |
| 72.5° | 104.6 | 91.7 | 73.8 | 62.8 | 60.2 |
| 75° | 85.9 | 74.1 | 57.8 | 49.2 | 46.5 |
| 77.5° | 66.7 | 57.3 | 43.7 | 37.1 | 34.8 |
| 80° | 50.8 | 41.4 | 30.5 | 26.9 | 26.2 |
| 82.5° | 35.1 | 26.9 | 20.3 | 19.0 | 18.8 |
| 85° | 21.4 | 14.4 | 12.5 | 12.1 | 11.7 |
| 87.5° | 9.1 | 6.2 | 5.9 | 5.9 | 5.4 |
| 90° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180° - - 45°-225° - - - - 90°-270°







(END OF REPORT)