

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: NEO-RAY

Report Number: P892227

Luminaire Tested: **1040S**

Issue Date: 10/24/2024

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P892227
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P264347)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 10/24/2024
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: NEO-RAY
Catalog Number: 1040S
Description: Define Patient, Downlight with Spot 15deg

Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 852.9 lumens
Efficiency: N/A
Efficacy: 82.8 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P892227
CATALOG NUMBER: 1040S

Luminous Intensity Polar Plot

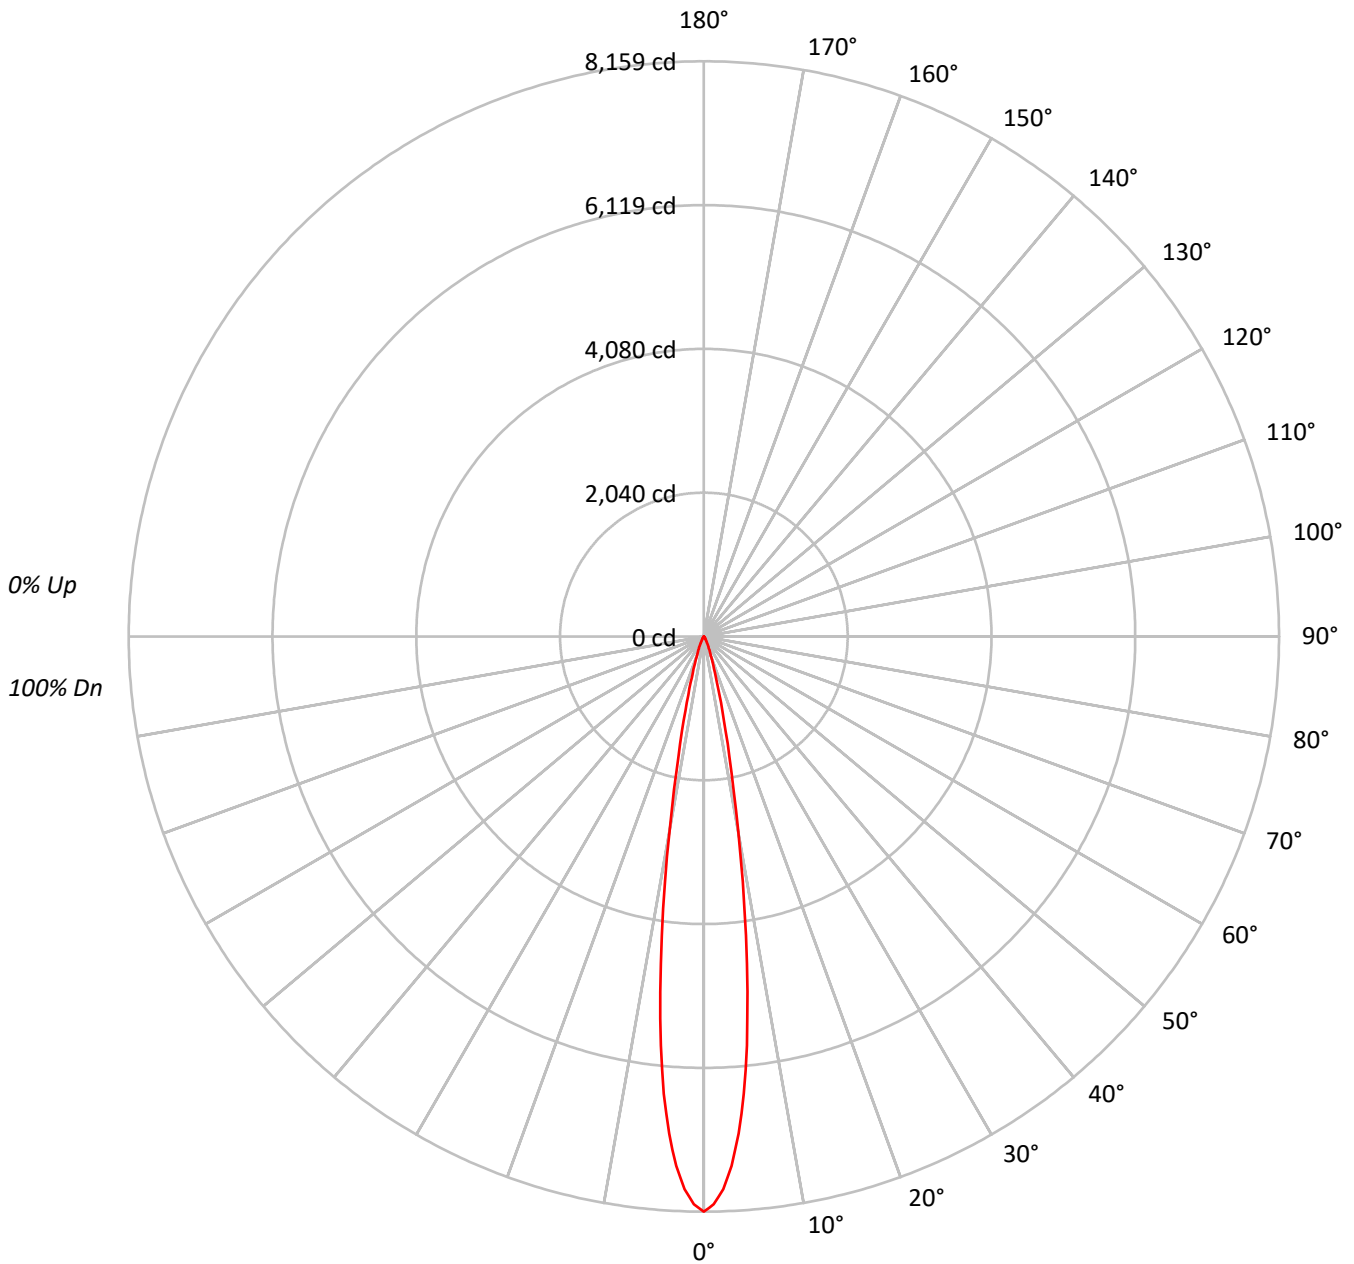



TEST NUMBER: P892227
 CATALOG NUMBER: 1040S

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98			98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96			96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94			94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92			92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90			90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89			89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87			87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86			86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85			85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83			83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	4025302
5°	3226510
10°	1408240
15°	436416
20°	152106
25°	67232
30°	30422
35°	15780
40°	9081
45°	4256
50°	2686
55°	1548
60°	789
65°	934
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P892227
 CATALOG NUMBER: 1040S

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	494.7	58.0
10°-20°	270.9	31.8
20°-30°	61.8	7.2
30°-40°	17.7	2.1
40°-50°	5.5	0.6
50°-60°	1.6	0.2
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	827.4	97.0
0°-40°	845.1	99.1
0°-60°	852.2	99.9
0°-90°	852.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	852.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8159	
5°	6515	495
15°	854	271
25°	124	62
35°	26	18
45°	6	5
55°	2	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P892227
CATALOG NUMBER: 1040S

CANDELA DISTRIBUTION (FULL):

0°	
0°	8158.6
1°	8057.0
2°	7846.1
3°	7518.7
4°	7068.8
5°	6514.7
6°	5835.3
7°	5076.4
8°	4284.1
9°	3517.3
10°	2810.9
11°	2212.9
12°	1742.0
13°	1370.9
14°	1082.8
15°	854.4
16°	674.1
17°	536.7
18°	431.6
19°	351.0
20°	289.7
22.5°	187.3
25°	123.5
26°	104.1
27°	88.4
28°	74.4
29°	62.2
30°	53.4
32.5°	36.8
35°	26.2
37.5°	19.2
40°	14.1
42.5°	9.6
45°	6.1
47.5°	4.3
50°	3.5
52.5°	2.6
55°	1.8
57.5°	0.8
60°	0.8
62.5°	0.8
65°	0.8
67.5°	0.8



TEST NUMBER: P892227
CATALOG NUMBER: 1040S

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)