

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P931303

Luminaire Tested: DFN2DS-TR2F0-060DS840-FLL

Issue Date: 11/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P931303
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P333812)
Test Lab: INNOVATION CENTER
Issue Date: 11/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DS-TR2F0-060DS840-FLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5945.9 lumens
Efficiency: N/A
Efficacy: 96.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular (W 2.36' x L: 2.04' x H: 0')
CIE Type: Direct

Input Watts (W): 61.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P931303

CATALOG NUMBER: DFN2DS-TR2F0-060DS840-FLL

Luminous Intensity Polar Plot

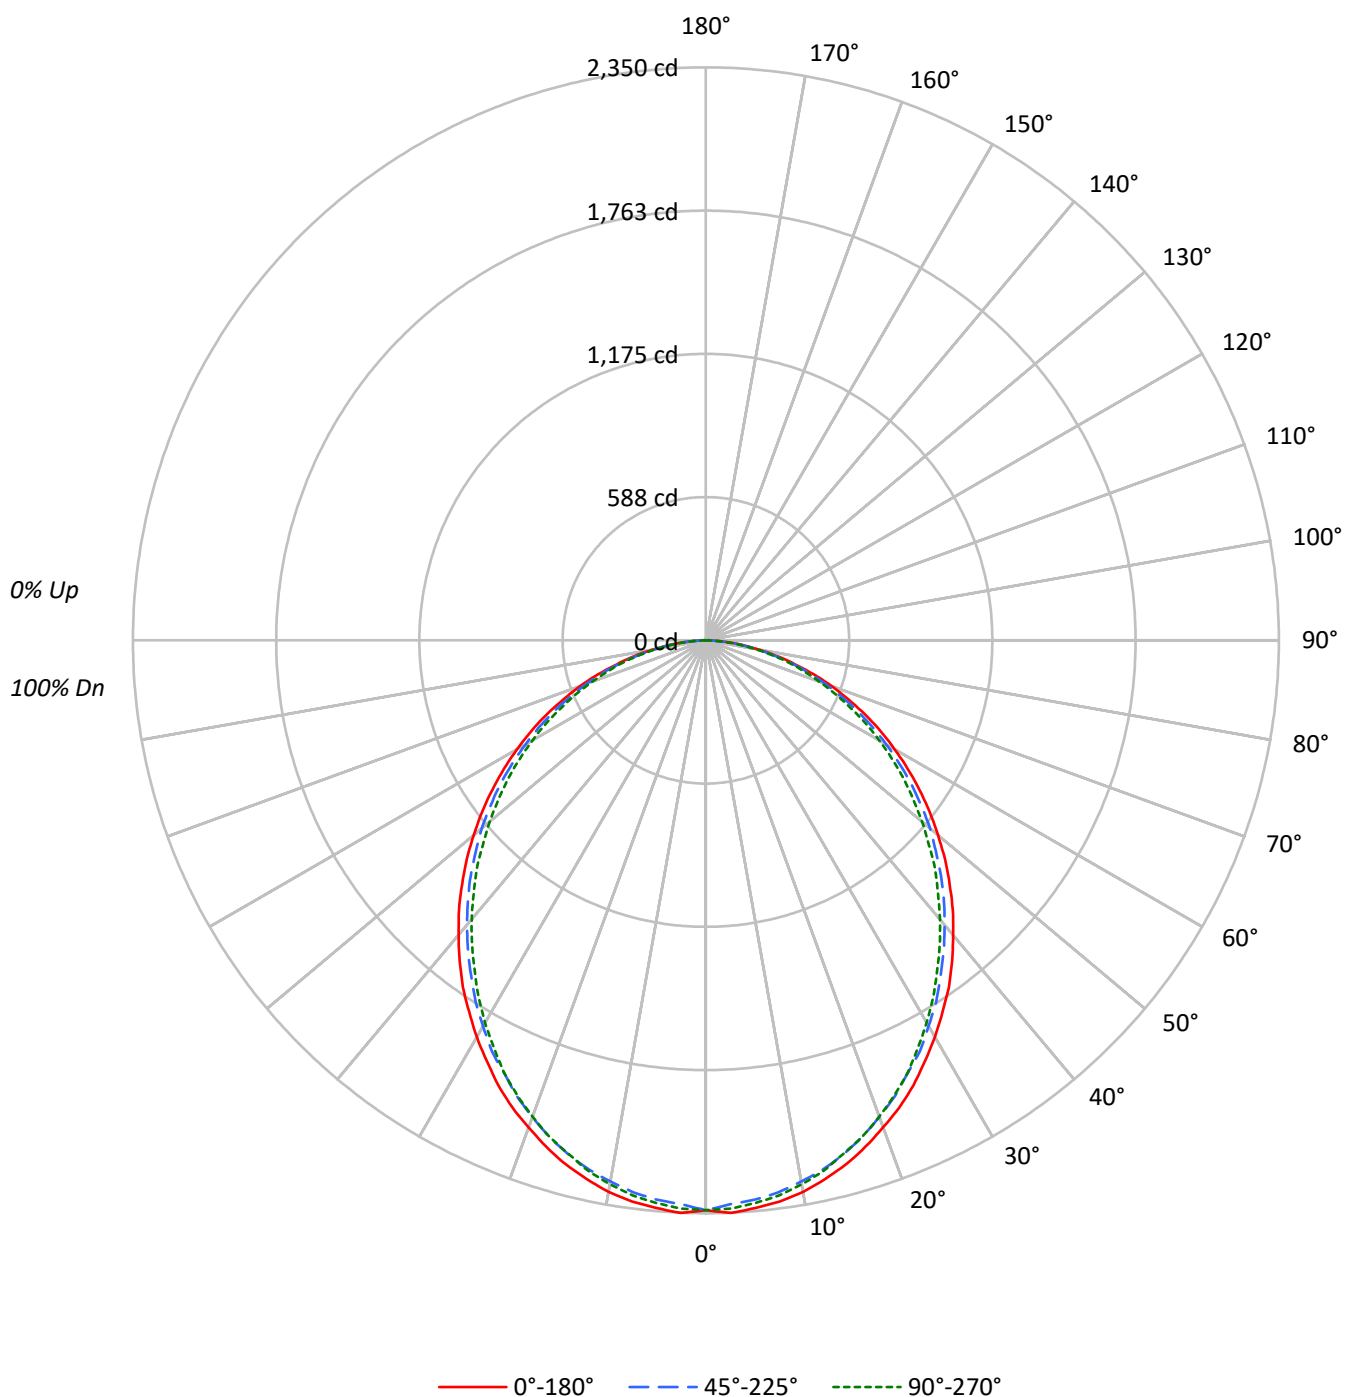

TEST NUMBER: P931303

CATALOG NUMBER: DFN2DS-TR2F0-060DS840-FLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	100	96	106	102	98	95	98	95	92		94	91	89		90
2	99	91	85	79	97	89	83	78	86	81	76		83	78	74		80
3	91	80	72	66	88	79	71	65	76	69	64		73	68	63		71
4	83	71	63	56	81	70	62	56	68	61	55		65	59	54		63
5	77	64	55	49	75	63	55	48	61	53	48		59	52	47		57
6	71	58	49	43	69	57	48	42	55	48	42		53	47	42		52
7	66	52	44	38	64	52	43	38	50	43	37		49	42	37		47
8	61	48	40	34	60	47	39	34	46	39	33		45	38	33		44
9	57	44	36	30	56	43	36	30	42	35	30		41	35	30		40
10	54	41	33	28	53	40	33	28	39	32	27		38	32	27		37

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5212	5212	5212
5°	5232	5157	5187
10°	5202	5105	5130
15°	5137	5038	5034
20°	5046	4939	4934
25°	4955	4817	4817
30°	4839	4705	4665
35°	4730	4571	4503
40°	4593	4436	4351
45°	4459	4302	4196
50°	4312	4164	4016
55°	4160	4002	3854
60°	3989	3810	3669
65°	3807	3618	3452
70°	3576	3385	3225
75°	3252	3117	3041
80°	2887	2799	2655
85°	2354	2244	2014

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4459 cd/sqm

TEST NUMBER: P931303

CATALOG NUMBER: DFN2DS-TR2F0-060DS840-FLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.0	3.7
10°-20°	618.9	10.4
20°-30°	909.5	15.3
30°-40°	1056.3	17.8
40°-50°	1055.0	17.7
50°-60°	919.9	15.5
60°-70°	680.0	11.4
70°-80°	384.8	6.5
80°-90°	101.5	1.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1748.3	29.4
0°-40°	2804.6	47.2
0°-60°	4779.6	80.4
0°-90°	5945.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5945.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2328	2303	2321	2317	222
15°	2225	2211	2182	2191	2180	627
25°	2013	1996	1957	1962	1957	926
35°	1737	1715	1679	1665	1654	1085
45°	1414	1398	1364	1339	1330	1091
55°	1070	1056	1029	1002	991	956
65°	721	708	686	665	654	713
75°	377	373	362	348	353	403
85°	92	90	88	81	79	108
90°	0	0	0	0	0	

TEST NUMBER: P931303

CATALOG NUMBER: DFN2DS-TR2F0-060DS840-FLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2336.9	2336.9	2336.9	2336.9	2336.9
2.5°	2350.5	2339.3	2314.5	2336.9	2332.6
5°	2336.9	2328.1	2303.3	2321.2	2316.9
7.5°	2321.2	2307.9	2283.1	2301.2	2296.7
10°	2296.7	2281.0	2254.0	2271.9	2265.2
12.5°	2262.9	2249.4	2222.5	2233.7	2229.2
15°	2224.6	2211.3	2182.0	2191.1	2179.9
17.5°	2177.5	2164.2	2134.8	2145.9	2134.8
20°	2125.7	2112.4	2080.9	2087.6	2078.8
22.5°	2074.3	2054.0	2024.6	2024.6	2020.1
25°	2013.4	1995.6	1957.4	1961.7	1957.4
27.5°	1945.9	1930.2	1901.1	1894.5	1883.3
30°	1878.8	1860.6	1827.0	1820.3	1811.2
32.5°	1806.7	1793.4	1757.4	1743.7	1734.7
35°	1737.1	1714.7	1678.7	1665.1	1653.9
37.5°	1658.5	1638.1	1602.2	1586.4	1575.2
40°	1577.6	1559.5	1523.5	1503.5	1494.4
42.5°	1498.9	1480.8	1445.0	1422.4	1409.0
45°	1413.6	1397.8	1364.0	1339.4	1330.3
47.5°	1330.3	1314.6	1278.7	1253.9	1240.4
50°	1242.6	1231.4	1200.0	1168.5	1157.3
52.5°	1157.3	1141.5	1112.4	1087.7	1072.0
55°	1069.8	1056.2	1029.2	1002.3	991.1
57.5°	982.1	970.9	941.5	914.6	905.5
60°	894.3	885.5	854.1	829.2	822.5
62.5°	808.9	793.2	770.8	748.3	739.3
65°	721.4	707.9	685.5	665.2	654.0
67.5°	631.5	620.1	600.1	584.4	575.3
70°	548.3	539.3	519.0	503.3	494.5
72.5°	463.0	454.0	442.7	427.0	420.3
75°	377.4	373.2	361.7	348.3	352.9
77.5°	301.1	292.1	287.5	280.9	274.2
80°	224.8	222.4	217.9	211.2	206.7
82.5°	152.9	152.9	150.7	141.6	141.6
85°	92.0	89.9	87.7	80.8	78.7
87.5°	40.5	36.0	31.4	24.8	22.4
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P931303

CATALOG NUMBER: DFN2DS-TR2F0-060DS840-FLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.02	18.63	17.38	18.94	19.26	16.57	18.19	16.94	18.50	18.81
	3H	18.77	20.22	19.15	20.55	20.91	18.28	19.73	18.66	20.06	20.42
	4H	19.42	20.78	19.81	21.13	21.51	18.92	20.29	19.32	20.64	21.01
	6H	19.88	21.15	20.30	21.52	21.91	19.38	20.65	19.79	21.02	21.41
	8H	20.03	21.24	20.45	21.63	22.03	19.52	20.74	19.95	21.12	21.52
	12H	20.12	21.28	20.55	21.66	22.09	19.61	20.77	20.04	21.15	21.58
4H	2H	17.58	18.95	17.98	19.30	19.67	17.23	18.60	17.63	18.94	19.32
	3H	19.55	20.70	19.96	21.10	21.50	19.15	20.29	19.56	20.69	21.09
	4H	20.33	21.37	20.76	21.78	22.22	19.91	20.94	20.34	21.36	21.79
	6H	20.93	21.83	21.38	22.27	22.73	20.50	21.40	20.95	21.84	22.30
	8H	21.12	21.96	21.58	22.41	22.87	20.68	21.53	21.14	21.97	22.43
	12H	21.25	22.01	21.73	22.48	22.95	20.80	21.56	21.28	22.03	22.50
8H	4H	20.60	21.45	21.07	21.89	22.36	20.23	21.08	20.69	21.52	21.98
	6H	21.32	22.02	21.81	22.51	22.99	20.94	21.64	21.43	22.13	22.60
	8H	21.58	22.21	22.09	22.72	23.20	21.19	21.82	21.70	22.32	22.81
	12H	21.78	22.34	22.28	22.83	23.39	21.36	21.92	21.87	22.41	22.97
12H	4H	20.63	21.39	21.11	21.87	22.34	20.27	21.03	20.75	21.50	21.97
	6H	21.36	22.00	21.87	22.50	22.99	21.00	21.63	21.51	22.13	22.62
	8H	21.68	22.24	22.19	22.73	23.29	21.30	21.86	21.81	22.35	22.91