

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: NEO-RAY

Report Number: P332623-830

Luminaire Tested: **S124DIP-S795D1205U830-4F0-1E-UDD-F1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-79-08  
Report Number: P332623-830  
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-10,  
Test Lab: INNOVATION CENTER  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: NEO-RAY  
Catalog Number: S124DIP-S795D1205U830-4F0-1E-UDD-F1  
Description: DEFINE 4 DIRECT-INDIRECT PENDANT LED LUMINAIRE  
DOWNLIGHT 795 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER  
UPLIGHT 1205 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER  
Light Source: -  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 7143.2 lumens  
Efficiency: N/A  
Efficacy: 125.5 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.3  
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')  
CIE Type: General Diffuse


Input Watts (W): 56.9  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P332623-830

CATALOG NUMBER: S124DIP-S795D1205U830-4F0-1E-UDD-F1

### Luminous Intensity Polar Plot

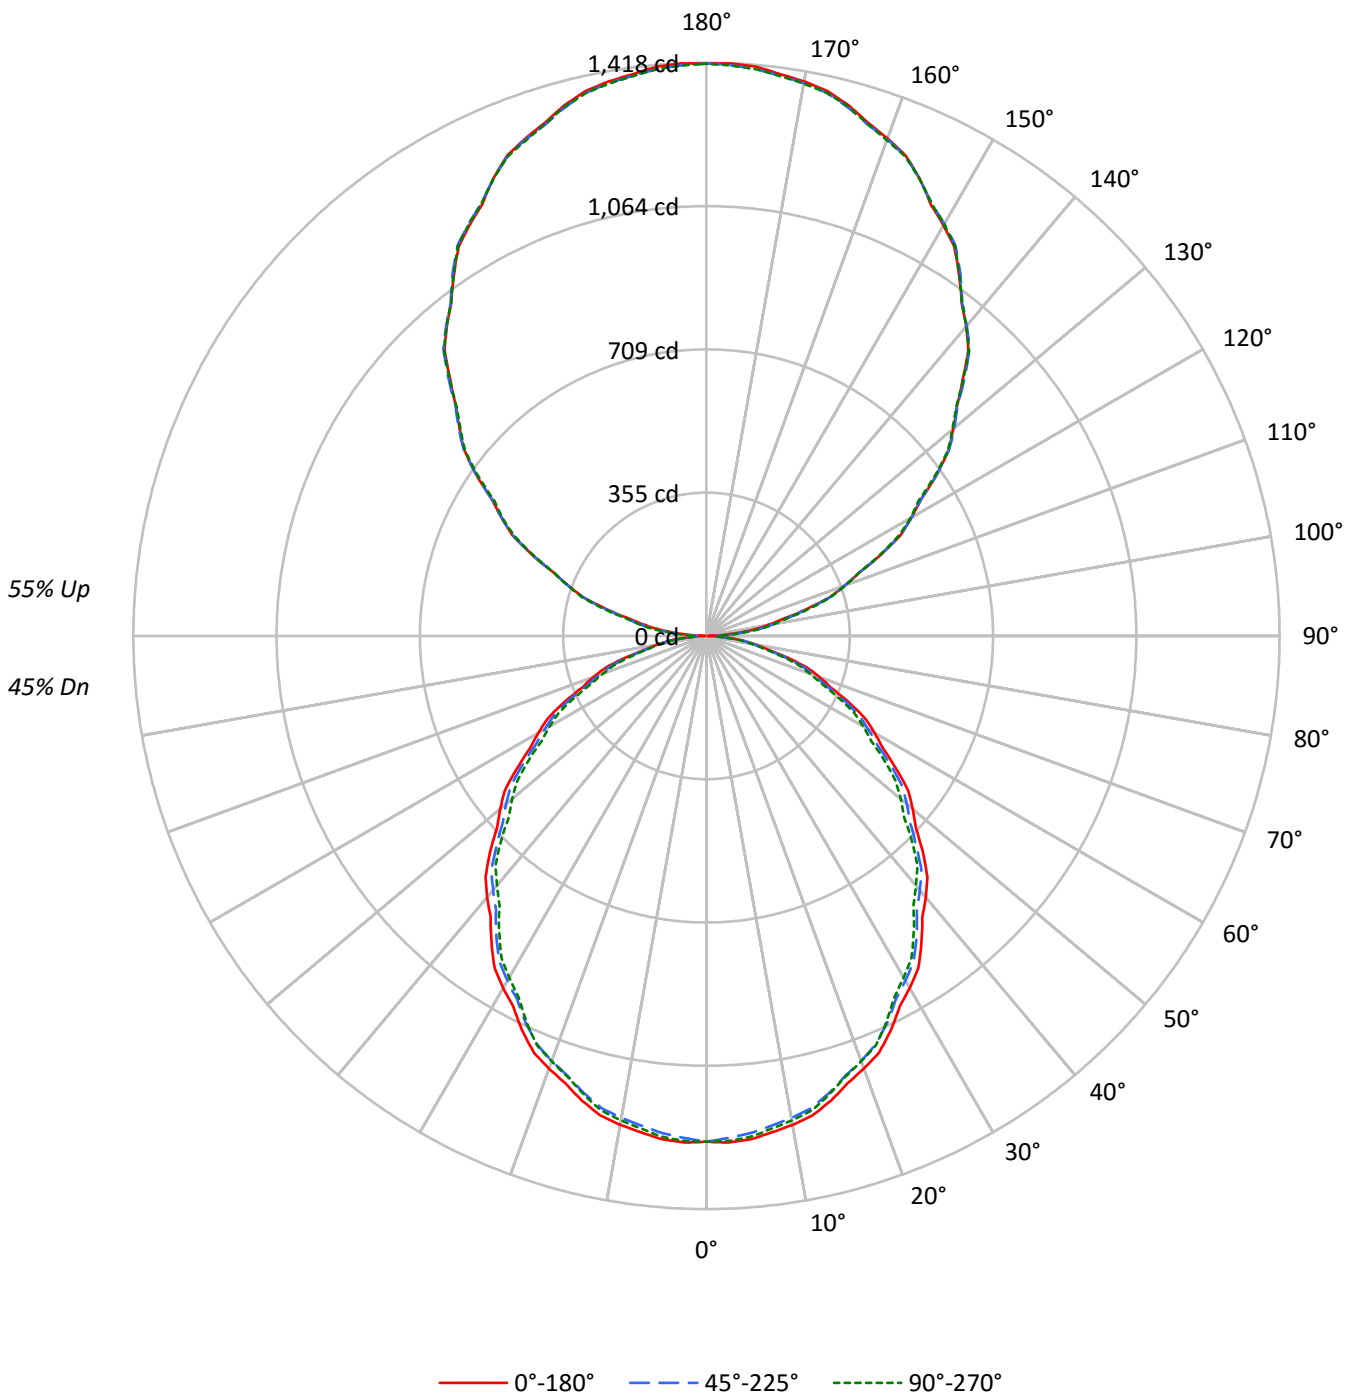



TEST NUMBER: P332623-830

CATALOG NUMBER: S124DIP-S795D1205U830-4F0-1E-UDD-F1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	106	106	106	106	97	97	97	97	81	81	81	65	65	65	52	52	52	45
1	97	92	88	85	88	85	81	78	71	68	66	57	56	54	45	44	43	38
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	37	32
3	80	71	64	58	73	65	59	54	54	50	46	45	41	38	35	33	31	27
4	73	63	55	49	67	58	51	45	48	43	39	40	36	33	32	29	27	23
5	67	56	48	42	61	51	44	39	43	38	34	36	32	28	29	26	23	20
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	21	18
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	24	21	18	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16	14
9	49	37	30	25	45	35	28	23	29	24	20	25	21	18	20	17	15	13
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	19	16	13	11

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	10101	10101	10101
5°	10131	10009	10083
10°	10067	9928	9977
15°	9947	9787	9812
20°	9784	9613	9620
25°	9600	9413	9386
30°	9374	9177	9093
35°	9140	8932	8814
40°	8896	8652	8495
45°	8643	8379	8218
50°	8361	8133	7882
55°	8058	7817	7562
60°	7753	7463	7237
65°	7412	7125	6837
70°	7027	6675	6413
75°	6441	6129	5973
80°	5732	5500	5360
85°	5011	4826	4733



TEST NUMBER: P332623-830

CATALOG NUMBER: S124DIP-S795D1205U830-4F0-1E-UDD-F1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	117.8	1.6
10°-20°	332.0	4.6
20°-30°	488.6	6.8
30°-40°	568.1	8.0
40°-50°	568.1	8.0
50°-60°	496.9	7.0
60°-70°	369.0	5.2
70°-80°	209.7	2.9
80°-90°	64.7	0.9
90°-100°	93.4	1.3
100°-110°	276.7	3.9
110°-120°	469.6	6.6
120°-130°	619.1	8.7
130°-140°	695.3	9.7
140°-150°	683.3	9.6
150°-160°	574.7	8.0
160°-170°	382.4	5.4
170°-180°	133.9	1.9
0°-30°	938.5	13.1
0°-40°	1506.5	21.1
0°-60°	2571.5	36.0
0°-90°	3215.0	45.0
90°-120°	839.6	11.8
90°-150°	2837.4	39.7
90°-180°	3928.0	55.0
0°-180°	7143.2	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1251	1251	1251	1251	1251	
5°	1250	1246	1235	1245	1244	119
15°	1190	1185	1171	1176	1174	335
25°	1078	1070	1057	1057	1054	496
35°	927	920	906	899	894	580
45°	757	749	734	723	720	583
55°	572	569	555	544	537	513
65°	388	383	373	363	358	384
75°	206	202	196	193	192	219
85°	54	54	52	52	51	60
90°	3	15	24	30	33	7
95°	66	75	83	86	86	73
105°	255	256	261	264	267	271
115°	477	477	475	474	473	471
125°	695	695	694	692	690	620
135°	897	903	903	901	898	694
145°	1090	1094	1095	1094	1091	682
155°	1248	1248	1247	1251	1247	574
165°	1359	1356	1354	1359	1356	383
175°	1414	1408	1407	1414	1407	134
180°	1416	1416	1416	1416	1416	



TEST NUMBER: P332623-830

CATALOG NUMBER: S124DIP-S795D1205U830-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2
2.5°	1254.4	1253.9	1253.3	1252.8	1252.3	1251.0	1249.1	1247.1	1245.1	1243.2	1244.9
5°	1250.2	1249.3	1248.4	1247.5	1246.6	1244.9	1242.5	1240.0	1237.6	1235.1	1237.6
7.5°	1238.6	1237.7	1236.8	1235.9	1235.0	1233.2	1230.5	1227.8	1225.0	1222.3	1224.3
10°	1228.1	1227.3	1226.3	1225.5	1224.6	1222.7	1219.7	1216.9	1214.0	1211.1	1212.9
12.5°	1214.5	1213.6	1212.7	1211.8	1211.0	1208.9	1205.9	1202.8	1199.8	1196.7	1198.6
15°	1190.1	1189.1	1188.3	1187.3	1186.5	1184.4	1181.0	1177.7	1174.3	1171.0	1172.3
17.5°	1160.6	1159.4	1158.3	1157.3	1156.1	1154.0	1150.8	1147.6	1144.4	1141.3	1142.2
20°	1138.9	1137.7	1136.7	1135.6	1134.4	1132.2	1128.9	1125.5	1122.2	1118.9	1119.6
22.5°	1115.7	1114.2	1112.7	1111.3	1109.7	1107.4	1104.0	1100.7	1097.3	1094.0	1095.2
25°	1077.7	1076.2	1074.6	1073.1	1071.5	1069.1	1066.0	1062.9	1059.8	1056.7	1056.9
27.5°	1034.4	1032.8	1031.2	1029.6	1028.0	1025.8	1022.8	1020.0	1017.1	1014.2	1013.6
30°	1005.6	1003.8	1002.0	1000.2	998.4	996.1	993.2	990.3	987.4	984.5	983.6
32.5°	975.1	973.5	971.9	970.3	968.7	966.3	963.3	960.2	957.2	954.0	953.0
35°	927.4	925.8	924.3	922.7	921.1	918.8	915.7	912.6	909.5	906.3	904.7
37.5°	877.0	875.6	874.2	872.8	871.3	868.9	865.6	862.2	858.9	855.5	853.8
40°	844.1	842.4	840.6	838.8	837.0	834.4	831.1	827.7	824.4	821.0	818.9
42.5°	808.9	807.8	806.7	805.7	804.6	802.2	798.5	794.8	791.1	787.4	784.9
45°	757.0	755.4	753.8	752.2	750.7	748.1	744.6	741.0	737.4	733.9	731.4
47.5°	702.6	701.5	700.5	699.4	698.3	696.2	692.9	689.6	686.3	683.0	680.1
50°	665.7	664.8	663.9	663.0	662.1	660.2	657.0	653.9	650.7	647.6	644.5
52.5°	629.6	628.6	627.5	626.4	625.3	623.1	619.8	616.5	613.2	609.9	607.2
55°	572.5	571.7	571.1	570.4	569.8	567.9	564.8	561.7	558.6	555.4	552.7
57.5°	517.9	517.2	516.4	515.7	514.9	512.9	509.9	506.8	503.8	500.7	498.1
60°	480.2	479.1	478.0	476.9	475.8	473.7	470.9	468.0	465.1	462.2	460.1
62.5°	443.4	442.4	441.5	440.5	439.6	437.6	434.5	431.4	428.4	425.3	423.5
65°	388.0	386.9	385.8	384.7	383.5	381.8	379.7	377.4	375.1	373.0	370.7
67.5°	332.2	331.2	330.2	329.1	328.2	326.6	324.4	322.3	320.2	318.0	315.8
70°	297.7	296.2	294.6	293.0	291.5	289.8	288.0	286.3	284.5	282.8	281.0
72.5°	260.9	259.3	257.8	256.2	254.6	253.2	251.8	250.2	248.8	247.4	246.0
75°	206.5	205.4	204.3	203.2	202.1	201.0	199.8	198.7	197.7	196.5	195.6
77.5°	154.6	154.1	153.6	153.2	152.6	151.9	150.9	150.0	148.9	148.0	147.7
80°	123.3	122.6	122.0	121.3	120.6	120.1	119.6	119.2	118.8	118.3	117.8
82.5°	92.8	92.6	92.2	91.9	91.6	91.4	91.3	91.2	91.1	91.0	90.8
85°	54.1	54.1	54.1	54.1	54.1	53.9	53.4	53.1	52.6	52.1	52.1
87.5°	21.5	21.9	22.2	22.6	22.9	23.2	23.5	23.7	23.8	24.0	24.3
90°	3.3	5.9	8.7	11.3	13.9	16.3	18.3	20.2	22.1	24.1	25.5
92.5°	23.5	26.5	29.6	32.6	35.7	37.9	39.3	40.6	42.0	43.4	44.2
95°	65.7	67.9	70.1	72.3	74.5	76.4	78.1	79.8	81.5	83.2	84.0
97.5°	114.8	116.5	118.3	120.0	121.8	123.7	125.6	127.6	129.6	131.6	132.5
100°	153.4	154.3	155.2	156.2	157.2	158.8	161.0	163.2	165.3	167.6	168.1
102.5°	193.6	194.0	194.4	194.7	195.2	196.3	198.3	200.4	202.4	204.3	205.0
105°	255.1	255.4	255.6	255.9	256.1	256.7	257.7	258.6	259.7	260.6	261.4
107.5°	319.7	320.1	320.4	320.7	320.9	321.1	321.3	321.4	321.6	321.7	322.4
110°	363.5	364.0	364.5	365.0	365.5	365.6	365.4	365.1	364.9	364.7	364.2



TEST NUMBER: P332623-830

CATALOG NUMBER: S124DIP-S795D1205U830-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (continued):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
112.5°	409.1	409.3	409.3	409.4	409.5	409.3	408.9	408.5	408.0	407.6	407.5
115°	477.4	477.4	477.4	477.4	477.4	477.2	476.7	476.3	475.7	475.2	475.0
117.5°	541.9	542.1	542.2	542.4	542.6	542.5	542.2	541.9	541.5	541.2	540.4
120°	584.8	585.7	586.7	587.7	588.6	588.8	588.1	587.3	586.5	585.9	584.7
122.5°	629.4	629.8	630.2	630.6	631.0	631.0	630.7	630.4	630.0	629.6	628.9
125°	695.3	695.3	695.3	695.3	695.3	695.2	695.0	694.7	694.5	694.3	693.8
127.5°	755.2	755.9	756.6	757.3	758.1	758.3	757.8	757.4	757.1	756.7	756.2
130°	797.2	798.0	798.6	799.4	800.1	800.5	800.5	800.5	800.5	800.5	800.0
132.5°	840.1	840.7	841.2	841.7	842.3	842.4	842.3	842.1	841.9	841.7	841.1
135°	896.8	898.3	899.8	901.3	902.7	903.4	903.4	903.4	903.4	903.4	903.0
137.5°	958.6	959.3	960.0	960.6	961.3	961.9	962.2	962.6	963.0	963.4	962.8
140°	999.8	1000.2	1000.8	1001.3	1001.7	1001.9	1001.9	1001.9	1001.9	1001.9	1001.7
142.5°	1037.5	1037.9	1038.4	1038.9	1039.4	1039.5	1039.3	1039.2	1039.0	1038.8	1038.7
145°	1089.6	1090.5	1091.6	1092.5	1093.4	1094.1	1094.3	1094.6	1094.8	1095.0	1094.8
147.5°	1141.2	1142.5	1143.6	1144.7	1145.9	1146.4	1146.2	1146.0	1145.8	1145.7	1145.5
150°	1172.8	1173.7	1174.8	1175.7	1176.7	1177.1	1177.1	1177.1	1177.1	1177.1	1177.1
152.5°	1202.6	1203.2	1203.7	1204.3	1204.9	1205.3	1205.5	1205.7	1205.9	1206.1	1206.6
155°	1248.3	1248.3	1248.3	1248.3	1248.3	1248.2	1248.0	1247.7	1247.5	1247.3	1248.2
157.5°	1286.9	1286.5	1286.0	1285.6	1285.2	1284.9	1284.9	1284.8	1284.8	1284.7	1285.4
160°	1309.7	1309.5	1309.2	1308.9	1308.7	1308.4	1308.2	1308.0	1307.7	1307.5	1308.2
162.5°	1330.7	1330.0	1329.5	1328.8	1328.1	1327.8	1327.5	1327.3	1327.0	1326.7	1328.0
165°	1359.0	1358.2	1357.4	1356.8	1356.0	1355.4	1354.9	1354.4	1354.0	1353.5	1354.9
167.5°	1380.6	1379.6	1378.6	1377.5	1376.6	1376.0	1376.1	1376.1	1376.2	1376.2	1377.7
170°	1392.9	1391.7	1390.4	1389.2	1388.0	1387.5	1387.8	1388.0	1388.3	1388.6	1390.0
172.5°	1401.7	1400.6	1399.6	1398.5	1397.6	1397.0	1397.1	1397.2	1397.2	1397.3	1398.9
175°	1413.7	1412.5	1411.3	1410.0	1408.8	1408.1	1407.9	1407.6	1407.4	1407.1	1408.8
177.5°	1417.7	1416.6	1415.7	1414.8	1413.7	1413.2	1413.2	1413.2	1413.2	1413.2	1414.7
180°	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9



TEST NUMBER: P332623-830

CATALOG NUMBER: S124DIP-S795D1205U830-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
0°	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2	1251.2
2.5°	1246.7	1248.5	1250.3	1251.1	1250.9	1250.8	1250.6	1250.4
5°	1240.0	1242.5	1244.9	1245.9	1245.5	1245.1	1244.6	1244.2
7.5°	1226.2	1228.2	1230.1	1231.0	1230.8	1230.5	1230.2	1229.9
10°	1214.7	1216.4	1218.2	1218.9	1218.4	1218.0	1217.6	1217.1
12.5°	1200.6	1202.5	1204.5	1205.1	1204.6	1203.9	1203.2	1202.7
15°	1173.7	1175.0	1176.3	1176.7	1176.0	1175.4	1174.7	1174.0
17.5°	1143.0	1143.9	1144.7	1144.9	1144.4	1144.0	1143.6	1143.1
20°	1120.2	1120.9	1121.5	1121.6	1121.2	1120.8	1120.3	1119.8
22.5°	1096.4	1097.6	1098.8	1099.0	1098.2	1097.4	1096.6	1095.8
25°	1057.2	1057.3	1057.6	1057.2	1056.4	1055.5	1054.6	1053.7
27.5°	1013.1	1012.6	1012.0	1011.3	1010.1	1009.0	1007.9	1006.7
30°	982.7	981.8	980.9	980.0	978.8	977.7	976.6	975.5
32.5°	951.9	950.8	949.8	948.7	947.5	946.4	945.3	944.2
35°	903.2	901.6	900.0	898.7	897.6	896.5	895.4	894.3
37.5°	852.2	850.5	848.9	847.3	845.7	844.3	842.8	841.3
40°	816.6	814.5	812.2	810.5	809.4	808.3	807.2	806.1
42.5°	782.2	779.7	777.0	775.4	774.7	773.9	773.2	772.4
45°	729.0	726.5	724.1	722.6	721.8	721.1	720.5	719.8
47.5°	677.4	674.7	671.8	669.7	668.0	666.3	664.6	662.9
50°	641.4	638.3	635.2	632.9	631.6	630.3	629.0	627.6
52.5°	604.5	601.6	598.9	596.7	595.0	593.3	591.6	589.9
55°	550.1	547.4	544.7	542.7	541.4	540.1	538.7	537.3
57.5°	495.6	493.0	490.5	488.6	487.3	486.0	484.7	483.4
60°	458.2	456.2	454.1	452.6	451.5	450.3	449.2	448.2
62.5°	421.6	419.8	418.0	416.5	415.4	414.2	413.2	412.1
65°	368.5	366.3	364.0	362.4	361.3	360.1	359.0	357.9
67.5°	313.8	311.6	309.4	308.2	307.9	307.6	307.3	307.0
70°	279.2	277.4	275.6	274.4	273.7	273.1	272.4	271.7
72.5°	244.6	243.2	241.8	240.7	240.0	239.3	238.7	238.0
75°	194.7	193.8	192.9	192.4	192.2	191.9	191.7	191.5
77.5°	147.4	147.1	146.9	146.5	145.9	145.3	144.8	144.2
80°	117.4	117.0	116.5	116.2	115.9	115.7	115.6	115.3
82.5°	90.5	90.2	89.9	89.7	89.5	89.3	89.1	88.8
85°	52.1	52.1	52.1	52.0	51.8	51.6	51.4	51.1
87.5°	24.7	25.0	25.3	25.4	25.5	25.6	25.7	25.8
90°	27.1	28.5	30.0	30.9	31.4	31.9	32.3	32.9
92.5°	45.1	46.0	46.8	47.4	47.8	48.1	48.4	48.6
95°	84.6	85.4	86.1	86.5	86.5	86.5	86.5	86.5
97.5°	133.4	134.2	135.2	135.5	135.5	135.5	135.5	135.5
100°	168.5	169.0	169.5	169.8	169.8	169.8	169.8	169.8
102.5°	205.7	206.4	207.1	207.5	207.7	207.9	208.1	208.3
105°	262.1	262.8	263.5	264.3	265.0	265.7	266.5	267.2
107.5°	323.1	323.8	324.4	324.8	324.7	324.7	324.6	324.6
110°	363.6	363.2	362.7	362.8	363.5	364.3	365.0	365.7





TEST NUMBER: P332623-830

CATALOG NUMBER: S124DIP-S795D1205U830-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
112.5°	407.4	407.3	407.2	407.2	407.4	407.5	407.6	407.8
115°	474.8	474.5	474.3	474.0	473.8	473.5	473.3	473.1
117.5°	539.5	538.7	537.8	537.2	536.7	536.2	535.7	535.3
120°	583.4	582.2	581.0	580.6	581.1	581.5	582.1	582.6
122.5°	628.0	627.2	626.3	625.5	624.6	623.8	622.8	622.0
125°	693.2	692.8	692.3	691.8	691.4	690.9	690.3	689.8
127.5°	755.7	755.3	754.7	754.3	753.9	753.5	753.1	752.7
130°	799.5	799.0	798.5	797.8	796.8	795.9	794.8	793.9
132.5°	840.7	840.2	839.7	839.2	838.9	838.5	838.1	837.7
135°	902.5	901.9	901.4	900.9	900.1	899.4	898.6	898.0
137.5°	962.1	961.5	960.9	960.6	960.8	960.9	961.1	961.2
140°	1001.5	1001.3	1001.0	1000.8	1000.5	1000.2	1000.0	999.8
142.5°	1038.7	1038.6	1038.6	1038.5	1038.5	1038.4	1038.4	1038.3
145°	1094.6	1094.3	1094.1	1093.5	1092.9	1092.1	1091.4	1090.7
147.5°	1145.3	1145.1	1144.8	1144.6	1144.4	1144.2	1143.9	1143.7
150°	1177.1	1177.1	1177.1	1177.0	1176.8	1176.6	1176.3	1176.1
152.5°	1207.2	1207.9	1208.4	1208.4	1207.8	1207.1	1206.5	1205.9
155°	1249.2	1250.2	1251.1	1251.1	1250.2	1249.2	1248.2	1247.3
157.5°	1286.2	1286.9	1287.6	1287.6	1286.8	1285.9	1285.1	1284.3
160°	1308.9	1309.7	1310.4	1310.1	1308.9	1307.7	1306.6	1305.3
162.5°	1329.4	1330.7	1332.0	1332.1	1330.9	1329.6	1328.4	1327.2
165°	1356.4	1357.8	1359.3	1359.5	1358.6	1357.6	1356.6	1355.7
167.5°	1379.1	1380.6	1382.1	1382.1	1380.5	1379.0	1377.5	1376.0
170°	1391.5	1392.9	1394.4	1394.2	1392.5	1390.8	1389.1	1387.4
172.5°	1400.6	1402.2	1403.9	1403.9	1402.1	1400.4	1398.7	1397.0
175°	1410.5	1412.2	1413.9	1413.9	1412.2	1410.5	1408.8	1407.1
177.5°	1416.0	1417.4	1418.7	1418.6	1417.0	1415.5	1413.9	1412.4
180°	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9	1415.9

(END OF REPORT)