

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: NEO-RAY

Report Number: P333008-830

Luminaire Tested: **S124RDIP-S1195D1035U830-4F0-1E-UDD-F4**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P333008-830
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-18,
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: NEO-RAY
Catalog Number: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4
Description: DEFINE 4 DIRECT-INDIRECT PENDANT LED LUMINAIRE
DOWNLIGHT 1195 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER, REGRESSED
HOUSING
UPLIGHT 1035 LUMENS PER FOOT, BATWING OPTIC
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8027.3 lumens
Efficiency: N/A
Efficacy: 120.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.09 / 1.24
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')
CIE Type: General Diffuse


Input Watts (W): 66.8
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P333008-830

CATALOG NUMBER: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4

Luminous Intensity Polar Plot

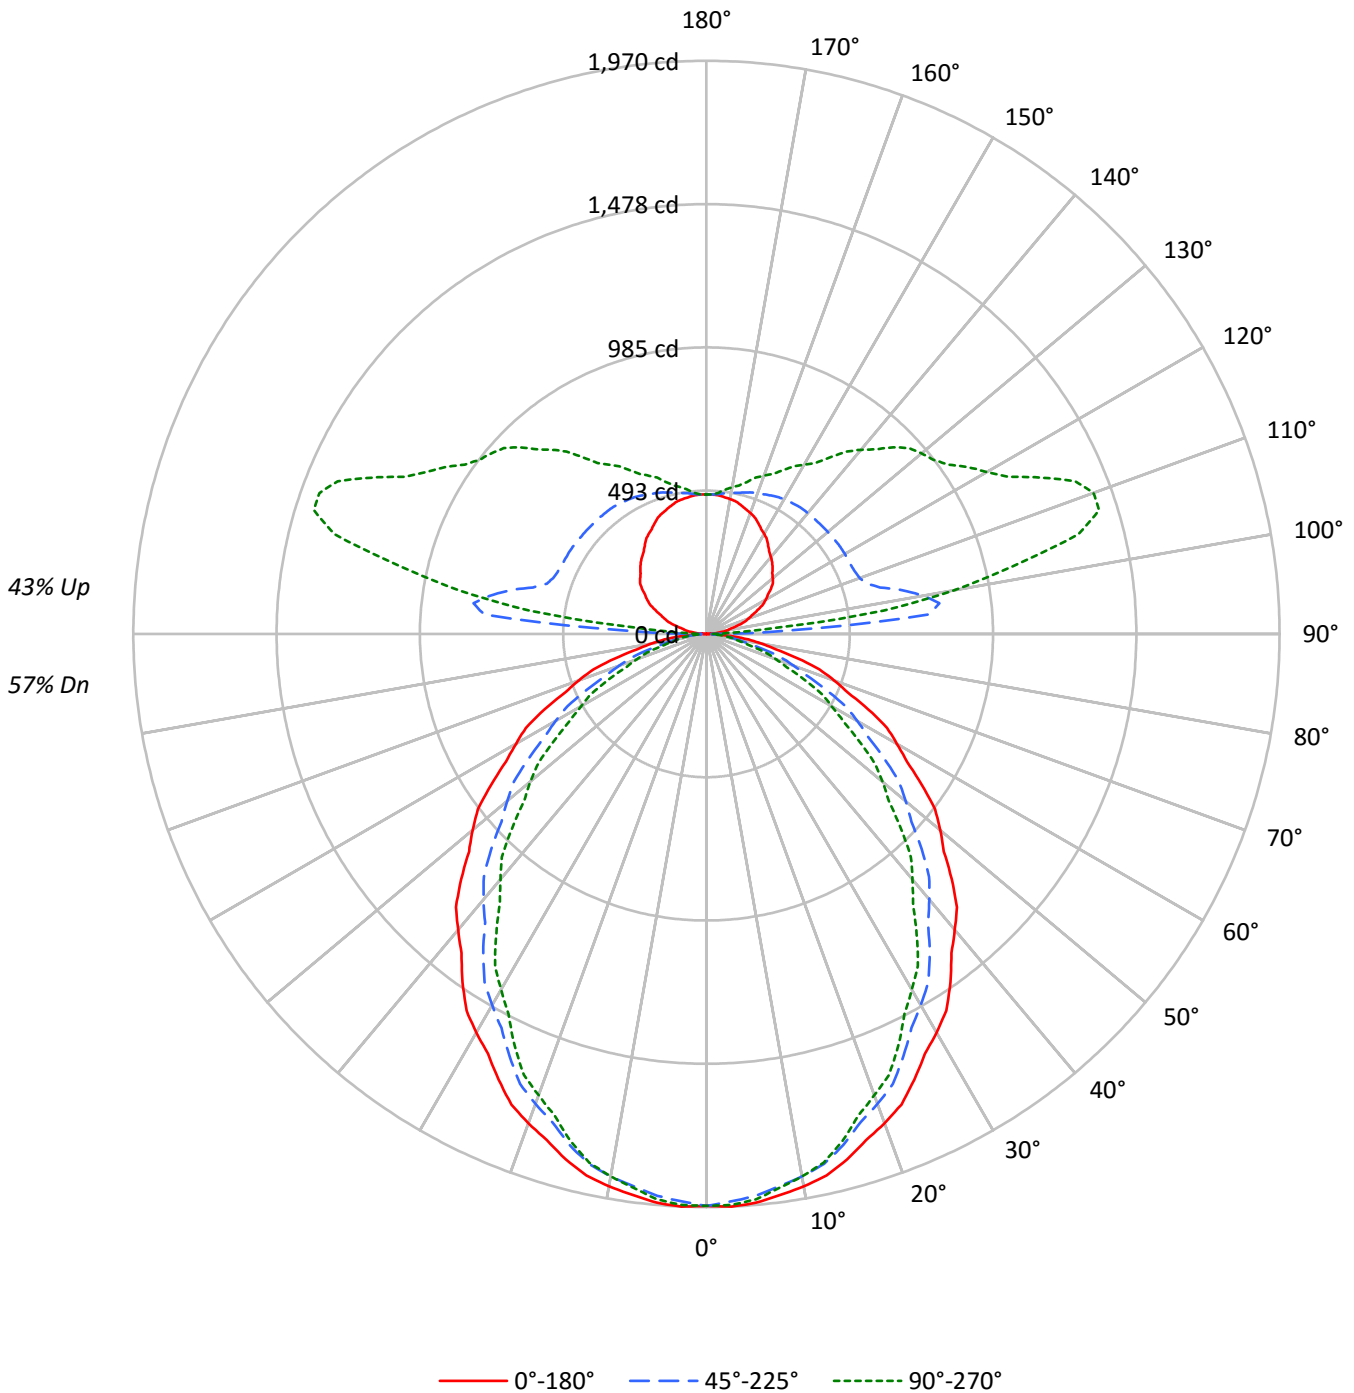



TEST NUMBER: P333008-830

CATALOG NUMBER: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62	57
1	100	95	92	88	93	89	86	83	77	74	72	66	64	62	55	54	53	48
2	91	84	78	72	84	78	73	68	68	64	60	58	55	53	49	47	45	41
3	83	74	66	61	77	69	63	57	60	55	51	52	48	45	44	41	39	35
4	76	65	58	52	71	61	54	49	53	48	44	46	42	39	39	36	34	30
5	70	58	50	44	65	55	48	42	48	42	38	42	37	34	36	32	30	26
6	65	53	45	39	60	49	42	37	43	38	33	38	33	30	32	29	26	23
7	60	48	40	34	56	45	38	33	39	34	29	34	30	26	30	26	23	21
8	56	43	36	30	52	41	34	29	36	30	26	32	27	24	27	24	21	19
9	52	40	32	27	48	37	31	26	33	27	24	29	25	21	25	22	19	17
10	49	36	29	24	45	34	28	23	31	25	21	27	22	19	23	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	15868	15868	15868
5°	15904	15709	15807
10°	15805	15521	15521
15°	15623	15195	15082
20°	15374	14766	14495
25°	15055	14264	13903
30°	14746	13736	13160
35°	14402	13186	12415
40°	13990	12562	11610
45°	13609	11942	10791
50°	13175	11228	9923
55°	12711	10486	8981
60°	12198	9671	8018
65°	11731	8653	7072
70°	11049	7532	6005
75°	10187	6245	4885
80°	8884	4761	4477
85°	7521	4326	4039



TEST NUMBER: P333008-830

CATALOG NUMBER: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.6	2.3
10°-20°	514.9	6.4
20°-30°	743.5	9.3
30°-40°	842.8	10.5
40°-50°	813.8	10.1
50°-60°	676.7	8.4
60°-70°	467.3	5.8
70°-80°	236.9	3.0
80°-90°	63.4	0.8
90°-100°	345.9	4.3
100°-110°	720.0	9.0
110°-120°	644.9	8.0
120°-130°	542.4	6.8
130°-140°	452.3	5.6
140°-150°	345.5	4.3
150°-160°	242.9	3.0
160°-170°	142.9	1.8
170°-180°	46.5	0.6
0°-30°	1443.1	18.0
0°-40°	2285.8	28.5
0°-60°	3776.4	47.0
0°-90°	4544.0	56.6
90°-120°	1710.8	21.3
90°-150°	3051.1	38.0
90°-180°	3483.0	43.4
0°-180°	8027.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1966	1966	1966	1966	1966	
5°	1963	1956	1938	1953	1951	186
15°	1869	1854	1818	1815	1805	526
25°	1690	1661	1601	1576	1561	778
35°	1461	1412	1338	1288	1260	913
45°	1192	1134	1046	975	945	919
55°	903	841	745	669	638	807
65°	614	548	453	391	370	606
75°	327	270	200	167	157	345
85°	81	53	47	44	44	91
90°	1	8	17	19	20	6
95°	31	98	767	380	230	35
105°	110	159	617	1329	1324	117
115°	194	243	550	1058	1271	192
125°	270	321	548	900	1014	240
135°	321	382	543	799	907	248
145°	370	423	540	674	741	232
155°	421	454	525	595	620	194
165°	458	472	503	533	541	129
175°	478	479	483	489	487	45
180°	479	479	479	479	479	



TEST NUMBER: P333008-830

CATALOG NUMBER: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6
2.5°	1970.4	1969.3	1968.3	1967.2	1966.1	1964.2	1961.2	1958.2	1955.3	1952.4	1955.3
5°	1962.6	1961.2	1959.9	1958.6	1957.3	1954.6	1950.6	1946.5	1942.6	1938.5	1941.8
7.5°	1944.8	1943.4	1942.0	1940.6	1939.2	1935.9	1930.7	1925.5	1920.2	1915.1	1917.2
10°	1928.0	1926.3	1924.7	1923.0	1921.3	1917.4	1911.5	1905.4	1899.4	1893.4	1894.7
12.5°	1906.3	1904.4	1902.4	1900.4	1898.6	1894.0	1887.0	1879.9	1872.7	1865.7	1866.5
15°	1869.3	1866.2	1863.3	1860.3	1857.3	1851.5	1843.2	1834.8	1826.5	1818.1	1817.4
17.5°	1824.5	1820.0	1815.7	1811.4	1807.0	1799.9	1789.8	1779.8	1769.7	1759.7	1757.8
20°	1789.5	1785.2	1780.8	1776.5	1772.2	1764.3	1752.9	1741.5	1730.1	1718.8	1716.1
22.5°	1751.0	1746.2	1741.3	1736.4	1731.5	1723.0	1710.7	1698.6	1686.4	1674.2	1670.2
25°	1690.2	1684.1	1678.1	1672.2	1666.1	1656.2	1642.6	1628.8	1615.1	1601.4	1595.7
27.5°	1626.4	1618.8	1611.3	1603.7	1596.1	1585.1	1570.4	1555.8	1541.1	1526.4	1519.4
30°	1581.9	1573.5	1565.1	1556.7	1548.4	1536.3	1520.6	1504.9	1489.2	1473.5	1465.1
32.5°	1534.8	1525.4	1516.0	1506.6	1497.1	1484.3	1468.0	1451.8	1435.5	1419.3	1409.6
35°	1461.4	1450.7	1440.0	1429.3	1418.6	1404.9	1388.2	1371.5	1354.7	1338.0	1326.6
37.5°	1382.9	1371.8	1360.7	1349.7	1338.7	1323.9	1305.4	1286.9	1268.4	1249.8	1237.1
40°	1327.5	1316.4	1305.4	1294.4	1283.3	1268.3	1249.2	1230.1	1211.1	1192.0	1178.0
42.5°	1274.5	1262.9	1251.3	1239.7	1228.2	1212.5	1192.6	1172.7	1152.9	1133.0	1118.7
45°	1192.0	1179.6	1167.2	1154.9	1142.6	1126.2	1106.3	1086.2	1066.1	1046.0	1029.6
47.5°	1106.8	1094.0	1081.3	1068.5	1055.7	1038.9	1018.0	997.1	976.3	955.5	938.4
50°	1049.0	1035.9	1022.9	1009.9	996.8	979.6	958.2	936.8	915.4	894.0	877.3
52.5°	990.0	977.2	964.5	951.7	939.0	921.5	899.7	877.7	855.7	833.8	816.8
55°	903.1	889.7	876.3	862.9	849.5	832.0	810.2	788.5	766.8	745.0	727.6
57.5°	816.9	803.0	789.1	775.2	761.3	743.7	722.3	700.8	679.4	658.0	640.4
60°	755.5	742.2	728.8	715.4	702.0	684.7	663.3	641.9	620.4	599.0	581.6
62.5°	700.1	686.3	672.3	658.5	644.5	626.6	604.6	582.7	560.7	538.9	522.7
65°	614.1	599.6	585.3	570.9	556.6	538.7	517.3	495.9	474.5	453.0	438.7
67.5°	524.6	510.9	497.1	483.3	469.6	452.7	432.8	413.0	393.1	373.2	360.9
70°	468.1	454.0	440.0	425.9	411.9	395.3	376.3	357.2	338.2	319.1	308.0
72.5°	407.8	395.2	382.5	369.8	357.0	341.7	323.7	305.7	287.7	269.7	260.2
75°	326.6	314.2	301.8	289.5	277.1	263.1	247.3	231.6	215.9	200.2	192.5
77.5°	244.1	233.7	223.1	212.6	202.1	190.5	177.8	165.1	152.4	139.7	135.2
80°	191.1	181.4	171.7	162.0	152.3	142.5	132.4	122.4	112.4	102.4	101.3
82.5°	145.4	136.5	127.6	118.7	109.8	102.5	96.7	91.0	85.2	79.5	78.7
85°	81.2	74.6	67.9	61.2	54.5	50.7	49.7	48.6	47.7	46.7	46.0
87.5°	27.9	26.1	24.5	22.6	20.6	19.4	20.3	20.0	20.2	20.3	19.8
90°	0.9	2.8	5.7	6.6	7.5	7.5	13.2	13.2	15.1	17.0	16.0
92.5°	10.7	15.6	24.5	35.9	49.7	69.3	117.1	190.1	261.2	298.5	248.6
95°	31.0	33.8	43.3	55.5	78.1	117.6	199.4	353.8	578.7	766.9	788.5
97.5°	55.7	55.7	63.8	75.1	94.4	127.6	190.7	318.0	541.6	807.7	990.6
100°	71.5	71.5	78.1	89.4	107.3	137.4	192.9	299.3	491.2	756.5	997.4
102.5°	86.5	88.0	93.9	104.4	121.6	150.1	200.4	294.0	457.3	692.6	940.9
105°	110.1	112.9	117.6	128.9	145.8	173.1	218.3	296.4	428.1	617.3	838.4
107.5°	136.1	138.0	142.6	154.7	170.9	197.7	239.2	310.3	422.8	575.1	755.5
110°	153.4	155.2	159.9	171.3	188.2	213.6	255.0	320.8	424.3	560.8	714.2



TEST NUMBER: P333008-830

CATALOG NUMBER: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (continued):

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
112.5°	169.9	171.8	177.3	187.8	204.7	230.2	270.0	332.2	428.9	554.0	690.9
115°	193.9	196.6	203.2	212.6	230.5	255.9	293.6	350.1	437.5	550.4	669.0
117.5°	218.7	221.3	227.2	237.5	254.2	280.6	316.3	368.3	446.8	549.5	659.2
120°	235.3	237.1	243.7	254.0	270.0	296.4	332.2	381.1	453.6	549.5	653.9
122.5°	250.3	252.1	258.7	268.3	285.9	311.4	347.2	393.1	460.3	548.7	647.9
125°	270.0	273.8	279.5	289.8	307.6	334.0	367.9	411.2	470.5	547.6	638.0
127.5°	287.6	290.6	297.4	309.2	327.8	354.4	387.1	426.8	478.5	545.5	624.6
130°	297.4	301.1	308.6	322.7	340.6	367.9	399.9	436.6	484.6	544.8	616.3
132.5°	307.1	310.1	319.9	333.3	352.7	378.4	410.5	446.4	489.8	544.0	608.8
135°	320.8	324.6	334.0	350.1	369.8	394.3	425.3	459.2	497.8	542.9	597.5
137.5°	334.4	338.2	348.6	363.7	384.3	407.6	436.6	468.3	502.5	542.7	587.7
140°	344.4	347.2	357.6	373.5	393.3	415.9	444.1	474.2	506.2	542.0	582.5
142.5°	355.0	357.8	367.3	382.6	401.6	423.4	450.9	478.7	509.3	542.0	578.0
145°	369.8	372.6	382.0	395.2	413.1	433.8	458.3	483.6	511.0	540.1	570.2
147.5°	386.5	387.5	395.8	409.3	424.1	442.8	465.8	488.0	511.9	536.7	563.3
150°	397.1	398.0	405.6	416.9	430.9	448.8	469.6	490.2	511.9	534.4	558.0
152.5°	406.9	407.1	414.6	425.1	437.7	454.1	472.6	491.7	510.4	530.7	552.0
155°	420.6	421.5	427.2	436.6	447.0	461.1	477.0	493.0	508.1	525.1	542.9
157.5°	433.9	433.9	439.2	446.6	455.6	466.7	480.2	493.0	505.7	519.2	533.7
160°	442.2	442.2	446.0	452.6	460.1	470.5	481.7	493.0	503.4	514.7	527.0
162.5°	449.8	449.0	452.0	457.9	464.7	472.8	483.2	493.0	501.1	510.2	520.9
165°	458.3	458.3	460.1	464.9	469.6	475.1	483.6	491.2	496.8	503.4	511.0
167.5°	466.7	465.8	466.7	470.3	473.0	477.2	483.4	488.9	492.3	496.6	501.9
170°	470.5	469.6	470.5	473.3	475.1	478.0	482.7	487.4	489.3	492.1	495.9
172.5°	474.2	473.3	473.4	475.5	476.6	478.7	481.9	485.9	486.3	487.6	490.6
175°	478.0	477.0	477.0	478.0	478.9	478.9	480.8	483.6	482.7	482.7	484.6
177.5°	479.7	478.9	478.2	478.9	478.9	478.9	479.7	481.2	479.7	479.7	480.4
180°	478.9	478.9	478.9	478.9	478.9	478.9	478.9	478.9	478.9	478.9	478.9



TEST NUMBER: P333008-830

CATALOG NUMBER: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (continued):

	55°	60°	65°	70°	75°	80°	85°	90°
0°	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6
2.5°	1958.2	1961.2	1964.2	1965.5	1965.2	1964.9	1964.6	1964.4
5°	1945.2	1948.5	1951.9	1953.2	1952.6	1951.9	1951.3	1950.6
7.5°	1919.3	1921.5	1923.6	1924.1	1923.1	1922.0	1920.9	1919.9
10°	1896.0	1897.3	1898.8	1898.8	1897.3	1896.0	1894.7	1893.4
12.5°	1867.3	1868.1	1868.9	1868.3	1866.5	1864.6	1862.7	1860.9
15°	1816.8	1816.1	1815.4	1813.9	1811.6	1809.2	1806.9	1804.6
17.5°	1756.0	1754.1	1752.2	1749.5	1746.0	1742.4	1738.9	1735.3
20°	1713.4	1710.7	1708.1	1704.6	1700.3	1695.9	1691.5	1687.2
22.5°	1666.2	1662.2	1658.2	1654.4	1650.9	1647.3	1643.8	1640.2
25°	1590.0	1584.3	1578.7	1574.1	1570.7	1567.4	1564.1	1560.8
27.5°	1512.4	1505.3	1498.4	1492.4	1487.6	1482.8	1478.0	1473.2
30°	1456.7	1448.4	1440.0	1433.1	1427.8	1422.5	1417.1	1411.7
32.5°	1399.9	1390.2	1380.4	1373.1	1368.0	1362.9	1357.8	1352.7
35°	1315.2	1303.9	1292.5	1283.8	1277.8	1271.8	1265.7	1259.7
37.5°	1224.4	1211.6	1199.0	1189.6	1183.6	1177.5	1171.6	1165.5
40°	1163.9	1149.9	1135.9	1125.8	1119.7	1113.7	1107.8	1101.7
42.5°	1104.4	1090.1	1075.7	1065.5	1059.1	1052.9	1046.6	1040.3
45°	1013.2	996.8	980.4	969.2	963.3	957.2	951.2	945.2
47.5°	921.4	904.5	887.5	875.6	869.0	862.4	855.7	849.1
50°	860.5	843.9	827.1	815.6	809.3	802.9	796.5	790.1
52.5°	799.8	782.9	765.8	754.0	747.4	740.8	734.1	727.5
55°	710.2	692.9	675.4	663.5	657.2	650.8	644.5	638.1
57.5°	622.7	605.0	587.4	576.2	571.4	566.5	561.7	556.9
60°	564.2	546.9	529.4	518.1	512.7	507.4	502.0	496.6
62.5°	506.7	490.7	474.6	464.4	460.1	455.9	451.6	447.3
65°	424.2	409.9	395.5	386.3	382.3	378.2	374.3	370.2
67.5°	348.6	336.1	323.8	315.4	310.9	306.5	302.1	297.7
70°	297.0	286.0	274.9	267.8	264.4	261.1	257.7	254.4
72.5°	250.8	241.4	232.0	225.7	222.6	219.6	216.5	213.4
75°	184.8	177.1	169.4	164.6	162.6	160.5	158.5	156.6
77.5°	130.7	126.2	121.8	119.2	118.6	118.0	117.4	116.8
80°	100.4	99.3	98.3	97.6	97.4	97.0	96.7	96.3
82.5°	78.0	77.3	76.5	76.0	75.7	75.3	75.0	74.6
85°	45.3	44.7	44.0	43.6	43.6	43.6	43.6	43.6
87.5°	19.7	19.6	19.5	19.5	20.0	20.5	20.5	20.8
90°	17.0	17.9	18.9	18.9	19.8	20.7	19.8	19.8
92.5°	184.8	139.1	110.7	91.8	80.8	75.7	72.5	72.5
95°	697.2	551.4	425.3	334.0	287.9	258.7	241.9	229.6
97.5°	1030.2	975.9	883.9	785.7	718.1	661.5	633.3	613.7
100°	1134.8	1153.6	1107.5	1037.8	956.0	898.6	870.3	862.9
102.5°	1129.5	1222.9	1236.2	1207.2	1157.0	1115.4	1085.7	1079.7
105°	1053.9	1216.6	1309.8	1348.4	1350.3	1342.7	1329.6	1323.9
107.5°	946.4	1119.7	1250.9	1334.8	1381.3	1402.8	1412.2	1414.7
110°	881.7	1044.4	1180.9	1284.4	1351.2	1390.7	1407.7	1416.2



TEST NUMBER: P333008-830

CATALOG NUMBER: S124RDIP-S1195D1035U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (continued):

	55°	60°	65°	70°	75°	80°	85°	90°
112.5°	834.2	978.2	1107.1	1210.6	1286.5	1334.3	1358.0	1371.7
115°	786.6	902.4	1012.5	1102.8	1177.1	1233.6	1263.7	1271.2
117.5°	763.3	859.1	945.7	1022.3	1085.7	1133.1	1163.6	1169.4
120°	752.7	840.3	915.6	982.3	1035.9	1077.4	1101.8	1112.2
122.5°	743.8	828.2	896.7	955.3	1000.6	1035.9	1056.7	1067.1
125°	728.3	809.2	874.1	925.9	963.6	990.8	1008.7	1014.4
127.5°	709.5	786.8	851.6	900.7	938.5	962.8	977.8	983.4
130°	694.5	768.7	832.7	882.6	921.1	944.7	959.8	965.4
132.5°	678.6	748.5	810.9	860.8	898.6	925.1	939.4	945.1
135°	656.8	717.9	775.3	822.4	860.1	886.4	901.4	907.1
137.5°	637.1	688.8	737.2	779.7	814.8	840.8	853.3	860.1
140°	625.8	670.0	712.3	751.8	784.8	805.5	818.6	826.1
142.5°	615.2	654.1	690.5	724.7	753.8	773.1	784.8	790.0
145°	600.3	632.4	660.5	686.9	710.4	726.4	735.8	740.6
147.5°	588.1	613.5	636.1	656.8	674.1	687.9	695.0	696.6
150°	580.6	602.2	621.0	638.0	653.0	665.2	670.9	671.8
152.5°	572.3	590.9	608.2	622.2	635.0	644.9	648.3	649.2
155°	559.9	575.0	589.0	600.3	609.7	617.3	620.1	620.1
157.5°	546.5	559.1	571.0	580.0	587.1	592.8	594.5	594.5
160°	538.2	548.6	558.9	566.5	572.1	577.8	578.7	578.7
162.5°	529.9	538.8	546.9	553.6	557.8	563.5	564.4	563.6
165°	518.5	524.1	530.7	535.4	539.1	542.9	542.0	541.0
167.5°	507.4	511.7	517.0	519.8	521.7	524.1	524.0	523.2
170°	500.6	503.4	507.2	510.0	511.9	512.8	511.9	511.9
172.5°	494.6	496.6	498.9	501.0	502.1	503.0	502.1	500.6
175°	486.4	487.4	489.3	489.3	489.3	491.2	489.3	487.4
177.5°	481.2	481.9	481.9	482.7	481.9	482.7	481.2	479.7
180°	478.9	478.9	478.9	478.9	478.9	478.9	478.9	478.9

(END OF REPORT)