

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: NEO-RAY

Report Number: P333014-830

Luminaire Tested: **S124RDIP-S1195D1205U830-4F0-1E-UDD-F4**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P333014-830
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-18,
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: NEO-RAY
Catalog Number: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4
Description: DEFINE 4 DIRECT-INDIRECT PENDANT LED LUMINAIRE
DOWNLIGHT 1195 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER, REGRESSED
HOUSING
UPLIGHT 1205 LUMENS PER FOOT, BATWING OPTIC
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8598.9 lumens
Efficiency: N/A
Efficacy: 119.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.09 / 1.24
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')
CIE Type: General Diffuse


Input Watts (W): 71.7
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P333014-830

CATALOG NUMBER: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4

Luminous Intensity Polar Plot

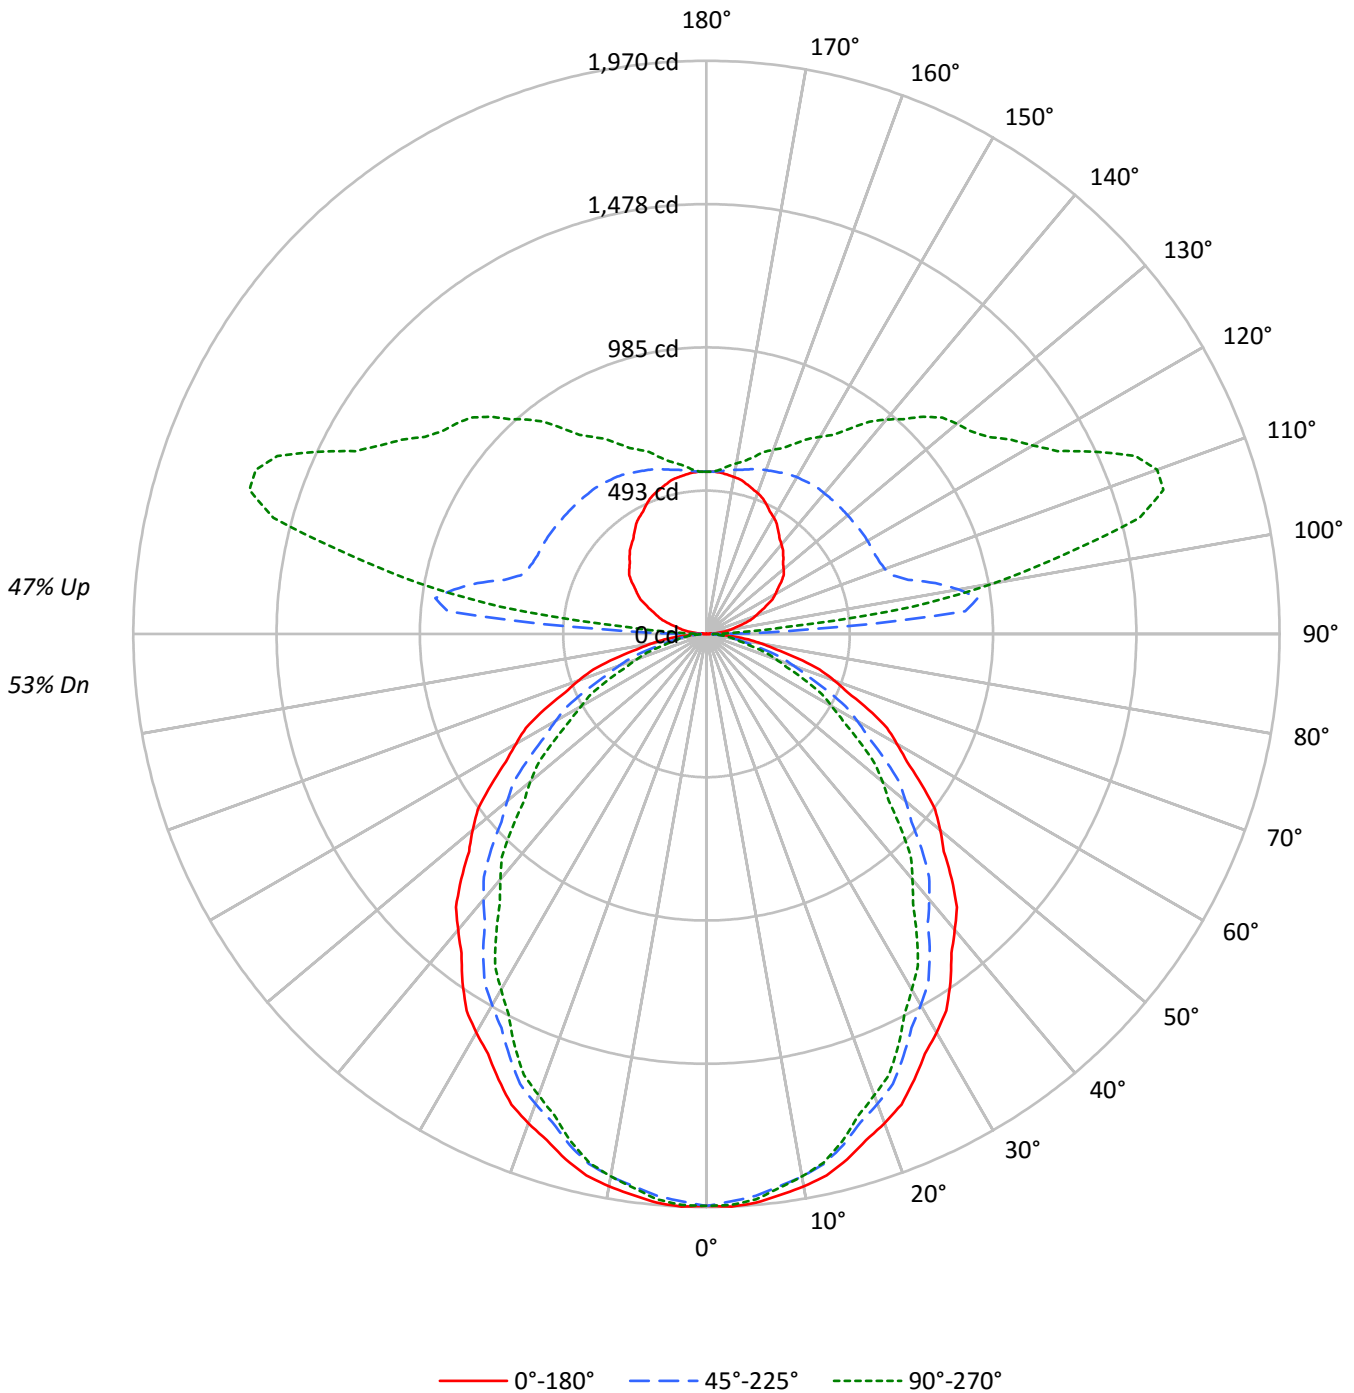



TEST NUMBER: P333014-830

CATALOG NUMBER: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59	53
1	99	94	91	87	91	88	84	81	75	73	70	63	62	60	52	51	50	45
2	90	83	77	72	83	77	72	67	66	62	59	56	53	51	46	44	43	38
3	82	73	66	60	76	68	62	57	58	54	50	50	46	43	41	39	37	33
4	75	65	57	51	70	60	53	48	52	47	43	44	40	37	37	34	32	28
5	69	58	50	44	64	54	47	42	47	41	37	40	36	32	34	30	28	25
6	64	52	44	38	59	49	41	36	42	37	32	36	32	28	31	27	25	22
7	59	47	39	34	55	44	37	32	38	33	29	33	29	25	28	25	22	19
8	55	43	35	30	51	40	33	28	35	29	25	30	26	23	26	22	20	17
9	51	39	32	27	48	37	30	25	32	27	23	28	23	20	24	20	18	16
10	48	36	29	24	44	34	27	23	30	24	21	26	21	18	22	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	15868	15868	15868
5°	15904	15709	15807
10°	15805	15521	15521
15°	15623	15195	15082
20°	15374	14766	14495
25°	15055	14264	13903
30°	14746	13736	13160
35°	14402	13186	12415
40°	13990	12562	11610
45°	13609	11942	10791
50°	13175	11228	9923
55°	12711	10486	8981
60°	12198	9671	8018
65°	11731	8653	7072
70°	11049	7532	6005
75°	10187	6245	4885
80°	8884	4761	4477
85°	7521	4326	4039



TEST NUMBER: P333014-830

CATALOG NUMBER: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.6	2.1
10°-20°	514.9	6.0
20°-30°	743.5	8.6
30°-40°	842.8	9.8
40°-50°	813.8	9.5
50°-60°	676.7	7.9
60°-70°	467.3	5.4
70°-80°	236.9	2.8
80°-90°	63.8	0.7
90°-100°	402.7	4.7
100°-110°	838.0	9.7
110°-120°	750.6	8.7
120°-130°	631.4	7.3
130°-140°	526.5	6.1
140°-150°	402.2	4.7
150°-160°	282.7	3.3
160°-170°	166.3	1.9
170°-180°	54.1	0.6
0°-30°	1443.1	16.8
0°-40°	2285.8	26.6
0°-60°	3776.4	43.9
0°-90°	4544.5	52.8
90°-120°	1991.3	23.2
90°-150°	3551.4	41.3
90°-180°	4054.0	47.1
0°-180°	8598.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1966	1966	1966	1966	1966	
5°	1963	1956	1938	1953	1951	186
15°	1869	1854	1818	1815	1805	526
25°	1690	1661	1601	1576	1561	778
35°	1461	1412	1338	1288	1260	913
45°	1192	1134	1046	975	945	919
55°	903	841	745	669	638	807
65°	614	548	453	391	370	606
75°	327	270	200	167	157	345
85°	81	53	47	44	44	91
90°	1	9	20	22	23	6
95°	36	114	893	442	267	40
105°	128	186	718	1547	1541	137
115°	226	283	641	1231	1480	224
125°	314	374	637	1048	1181	280
135°	373	445	632	930	1056	289
145°	430	493	629	784	862	270
155°	490	528	611	692	722	226
165°	533	550	586	620	630	151
175°	556	558	562	570	567	53
180°	558	558	558	558	558	



TEST NUMBER: P333014-830

CATALOG NUMBER: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6
2.5°	1970.4	1969.3	1968.3	1967.2	1966.1	1964.2	1961.2	1958.2	1955.3	1952.4	1955.3
5°	1962.6	1961.2	1959.9	1958.6	1957.3	1954.6	1950.6	1946.5	1942.6	1938.5	1941.8
7.5°	1944.8	1943.4	1942.0	1940.6	1939.2	1935.9	1930.7	1925.5	1920.2	1915.1	1917.2
10°	1928.0	1926.3	1924.7	1923.0	1921.3	1917.4	1911.5	1905.4	1899.4	1893.4	1894.7
12.5°	1906.3	1904.4	1902.4	1900.4	1898.6	1894.0	1887.0	1879.9	1872.7	1865.7	1866.5
15°	1869.3	1866.2	1863.3	1860.3	1857.3	1851.5	1843.2	1834.8	1826.5	1818.1	1817.4
17.5°	1824.5	1820.0	1815.7	1811.4	1807.0	1799.9	1789.8	1779.8	1769.7	1759.7	1757.8
20°	1789.5	1785.2	1780.8	1776.5	1772.2	1764.3	1752.9	1741.5	1730.1	1718.8	1716.1
22.5°	1751.0	1746.2	1741.3	1736.4	1731.5	1723.0	1710.7	1698.6	1686.4	1674.2	1670.2
25°	1690.2	1684.1	1678.1	1672.2	1666.1	1656.2	1642.6	1628.8	1615.1	1601.4	1595.7
27.5°	1626.4	1618.8	1611.3	1603.7	1596.1	1585.1	1570.4	1555.8	1541.1	1526.4	1519.4
30°	1581.9	1573.5	1565.1	1556.7	1548.4	1536.3	1520.6	1504.9	1489.2	1473.5	1465.1
32.5°	1534.8	1525.4	1516.0	1506.6	1497.1	1484.3	1468.0	1451.8	1435.5	1419.3	1409.6
35°	1461.4	1450.7	1440.0	1429.3	1418.6	1404.9	1388.2	1371.5	1354.7	1338.0	1326.6
37.5°	1382.9	1371.8	1360.7	1349.7	1338.7	1323.9	1305.4	1286.9	1268.4	1249.8	1237.1
40°	1327.5	1316.4	1305.4	1294.4	1283.3	1268.3	1249.2	1230.1	1211.1	1192.0	1178.0
42.5°	1274.5	1262.9	1251.3	1239.7	1228.2	1212.5	1192.6	1172.7	1152.9	1133.0	1118.7
45°	1192.0	1179.6	1167.2	1154.9	1142.6	1126.2	1106.3	1086.2	1066.1	1046.0	1029.6
47.5°	1106.8	1094.0	1081.3	1068.5	1055.7	1038.9	1018.0	997.1	976.3	955.5	938.4
50°	1049.0	1035.9	1022.9	1009.9	996.8	979.6	958.2	936.8	915.4	894.0	877.3
52.5°	990.0	977.2	964.5	951.7	939.0	921.5	899.7	877.7	855.7	833.8	816.8
55°	903.1	889.7	876.3	862.9	849.5	832.0	810.2	788.5	766.8	745.0	727.6
57.5°	816.9	803.0	789.1	775.2	761.3	743.7	722.3	700.8	679.4	658.0	640.4
60°	755.5	742.2	728.8	715.4	702.0	684.7	663.3	641.9	620.4	599.0	581.6
62.5°	700.1	686.3	672.3	658.5	644.5	626.6	604.6	582.7	560.7	538.9	522.7
65°	614.1	599.6	585.3	570.9	556.6	538.7	517.3	495.9	474.5	453.0	438.7
67.5°	524.6	510.9	497.1	483.3	469.6	452.7	432.8	413.0	393.1	373.2	360.9
70°	468.1	454.0	440.0	425.9	411.9	395.3	376.3	357.2	338.2	319.1	308.0
72.5°	407.8	395.2	382.5	369.8	357.0	341.7	323.7	305.7	287.7	269.7	260.2
75°	326.6	314.2	301.8	289.5	277.1	263.1	247.3	231.6	215.9	200.2	192.5
77.5°	244.1	233.7	223.1	212.6	202.1	190.5	177.8	165.1	152.4	139.7	135.2
80°	191.1	181.4	171.7	162.0	152.3	142.5	132.4	122.4	112.4	102.4	101.3
82.5°	145.4	136.5	127.6	118.7	109.8	102.5	96.7	91.0	85.2	79.5	78.7
85°	81.2	74.6	67.9	61.2	54.5	50.7	49.7	48.6	47.7	46.7	46.0
87.5°	27.9	26.2	24.7	22.8	20.9	19.7	20.7	20.5	20.6	20.8	20.4
90°	1.1	3.3	6.6	7.6	8.8	8.8	15.4	15.4	17.5	19.7	18.7
92.5°	12.4	18.2	28.5	41.8	57.9	80.6	136.3	221.2	304.1	347.4	289.4
95°	36.1	39.4	50.4	64.7	90.9	137.0	232.1	411.8	673.5	892.6	917.8
97.5°	64.8	64.8	74.3	87.4	110.0	148.5	221.9	370.2	630.4	940.2	1153.1
100°	83.2	83.2	90.9	104.1	124.9	159.9	224.5	348.3	571.7	880.5	1160.9
102.5°	100.8	102.5	109.3	121.6	141.5	174.8	233.3	342.1	532.3	806.1	1095.2
105°	128.2	131.4	137.0	150.1	169.8	201.5	254.1	345.0	498.3	718.5	975.8
107.5°	158.3	160.5	166.1	180.0	198.9	230.3	278.4	361.2	492.2	669.4	879.5
110°	178.5	180.7	186.2	199.3	219.0	248.6	296.8	373.4	494.0	652.8	831.3



TEST NUMBER: P333014-830

CATALOG NUMBER: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (continued):

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
112.5°	197.8	200.0	206.3	218.6	238.4	267.9	314.3	386.6	499.2	644.9	804.1
115°	225.6	228.9	236.6	247.5	268.3	297.9	341.7	407.5	509.3	640.7	778.7
117.5°	254.5	257.6	264.4	276.4	296.0	326.6	368.3	428.7	520.0	639.6	767.3
120°	273.8	276.0	283.7	295.7	314.3	345.0	386.6	443.6	527.9	639.6	761.2
122.5°	291.3	293.5	301.2	312.4	332.7	362.5	404.2	457.6	535.8	638.8	754.2
125°	314.3	318.7	325.3	337.3	358.2	388.8	428.2	478.6	547.6	637.4	742.5
127.5°	334.7	338.2	346.1	359.9	381.5	412.5	450.5	496.8	557.0	635.0	727.0
130°	346.1	350.4	359.2	375.7	396.4	428.2	465.5	508.2	564.0	634.1	717.4
132.5°	357.5	361.0	372.4	388.0	410.5	440.5	477.8	519.6	570.1	633.3	708.6
135°	373.4	377.9	388.8	407.5	430.5	458.9	495.0	534.5	579.4	632.0	695.5
137.5°	389.5	393.6	405.7	423.4	447.3	474.5	508.2	545.0	584.8	631.7	684.1
140°	400.9	404.2	416.2	434.8	457.8	484.1	517.0	552.0	589.3	630.8	678.0
142.5°	413.1	416.4	427.5	445.4	467.4	492.9	524.8	557.2	592.8	630.8	672.7
145°	430.5	433.8	444.7	460.0	480.8	504.9	533.4	563.0	594.7	628.7	663.7
147.5°	449.9	451.0	460.6	476.5	493.7	515.4	542.2	568.0	595.8	624.7	655.6
150°	462.2	463.3	472.0	485.2	501.6	522.5	546.5	570.6	595.8	622.1	649.5
152.5°	473.5	473.8	482.6	494.8	509.5	528.6	550.1	572.4	594.1	617.7	642.4
155°	489.6	490.7	497.2	508.2	520.3	536.7	555.3	573.9	591.4	611.1	632.0
157.5°	505.1	505.1	511.2	519.8	530.3	543.3	559.0	573.9	588.6	604.4	621.2
160°	514.7	514.7	519.2	526.8	535.6	547.6	560.7	573.9	586.0	599.1	613.3
162.5°	523.5	522.6	526.1	532.9	540.8	550.3	562.5	573.9	583.3	593.8	606.3
165°	533.4	533.4	535.6	541.0	546.5	553.1	563.0	571.7	578.2	586.0	594.7
167.5°	543.3	542.2	543.3	547.4	550.4	555.5	562.7	569.1	573.1	578.1	584.2
170°	547.6	546.5	547.6	550.9	553.1	556.4	561.8	567.3	569.5	572.8	577.2
172.5°	552.0	550.9	551.1	553.6	554.9	557.2	561.0	565.6	566.0	567.5	571.1
175°	556.4	555.3	555.3	556.4	557.5	557.5	559.7	563.0	561.8	561.8	564.0
177.5°	558.4	557.5	556.6	557.5	557.5	557.5	558.4	560.1	558.4	558.4	559.2
180°	557.5	557.5	557.5	557.5	557.5	557.5	557.5	557.5	557.5	557.5	557.5



TEST NUMBER: P333014-830

CATALOG NUMBER: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (continued):

	55°	60°	65°	70°	75°	80°	85°	90°
0°	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6	1965.6
2.5°	1958.2	1961.2	1964.2	1965.5	1965.2	1964.9	1964.6	1964.4
5°	1945.2	1948.5	1951.9	1953.2	1952.6	1951.9	1951.3	1950.6
7.5°	1919.3	1921.5	1923.6	1924.1	1923.1	1922.0	1920.9	1919.9
10°	1896.0	1897.3	1898.8	1898.8	1897.3	1896.0	1894.7	1893.4
12.5°	1867.3	1868.1	1868.9	1868.3	1866.5	1864.6	1862.7	1860.9
15°	1816.8	1816.1	1815.4	1813.9	1811.6	1809.2	1806.9	1804.6
17.5°	1756.0	1754.1	1752.2	1749.5	1746.0	1742.4	1738.9	1735.3
20°	1713.4	1710.7	1708.1	1704.6	1700.3	1695.9	1691.5	1687.2
22.5°	1666.2	1662.2	1658.2	1654.4	1650.9	1647.3	1643.8	1640.2
25°	1590.0	1584.3	1578.7	1574.1	1570.7	1567.4	1564.1	1560.8
27.5°	1512.4	1505.3	1498.4	1492.4	1487.6	1482.8	1478.0	1473.2
30°	1456.7	1448.4	1440.0	1433.1	1427.8	1422.5	1417.1	1411.7
32.5°	1399.9	1390.2	1380.4	1373.1	1368.0	1362.9	1357.8	1352.7
35°	1315.2	1303.9	1292.5	1283.8	1277.8	1271.8	1265.7	1259.7
37.5°	1224.4	1211.6	1199.0	1189.6	1183.6	1177.5	1171.6	1165.5
40°	1163.9	1149.9	1135.9	1125.8	1119.7	1113.7	1107.8	1101.7
42.5°	1104.4	1090.1	1075.7	1065.5	1059.1	1052.9	1046.6	1040.3
45°	1013.2	996.8	980.4	969.2	963.3	957.2	951.2	945.2
47.5°	921.4	904.5	887.5	875.6	869.0	862.4	855.7	849.1
50°	860.5	843.9	827.1	815.6	809.3	802.9	796.5	790.1
52.5°	799.8	782.9	765.8	754.0	747.4	740.8	734.1	727.5
55°	710.2	692.9	675.4	663.5	657.2	650.8	644.5	638.1
57.5°	622.7	605.0	587.4	576.2	571.4	566.5	561.7	556.9
60°	564.2	546.9	529.4	518.1	512.7	507.4	502.0	496.6
62.5°	506.7	490.7	474.6	464.4	460.1	455.9	451.6	447.3
65°	424.2	409.9	395.5	386.3	382.3	378.2	374.3	370.2
67.5°	348.6	336.1	323.8	315.4	310.9	306.5	302.1	297.7
70°	297.0	286.0	274.9	267.8	264.4	261.1	257.7	254.4
72.5°	250.8	241.4	232.0	225.7	222.6	219.6	216.5	213.4
75°	184.8	177.1	169.4	164.6	162.6	160.5	158.5	156.6
77.5°	130.7	126.2	121.8	119.2	118.6	118.0	117.4	116.8
80°	100.4	99.3	98.3	97.6	97.4	97.0	96.7	96.3
82.5°	78.0	77.3	76.5	76.0	75.7	75.3	75.0	74.6
85°	45.3	44.7	44.0	43.6	43.6	43.6	43.6	43.6
87.5°	20.3	20.2	20.2	20.2	20.6	21.1	21.2	21.5
90°	19.7	20.8	21.9	21.9	23.0	24.1	23.0	23.0
92.5°	215.1	161.8	128.8	106.9	94.0	88.0	84.4	84.4
95°	811.5	641.8	495.0	388.8	335.2	301.2	281.4	267.2
97.5°	1199.1	1136.0	1028.9	914.5	835.8	770.0	737.1	714.4
100°	1320.9	1342.7	1289.1	1208.1	1112.8	1045.9	1013.1	1004.4
102.5°	1314.8	1423.3	1438.9	1405.1	1346.7	1298.3	1263.7	1256.7
105°	1226.6	1416.2	1524.6	1569.4	1571.7	1562.9	1547.6	1541.0
107.5°	1101.5	1303.3	1456.0	1553.7	1607.8	1632.8	1643.7	1646.6
110°	1026.2	1215.7	1374.5	1495.0	1572.7	1618.7	1638.5	1648.3



TEST NUMBER: P333014-830

CATALOG NUMBER: S124RDIP-S1195D1205U830-4F0-1E-UDD-F4

CANDELA DISTRIBUTION (continued):

	55°	60°	65°	70°	75°	80°	85°	90°
112.5°	971.0	1138.6	1288.6	1409.1	1497.4	1553.0	1580.6	1596.7
115°	915.6	1050.4	1178.5	1283.6	1370.2	1435.9	1470.9	1479.7
117.5°	888.4	999.9	1100.7	1189.9	1263.7	1318.9	1354.3	1361.1
120°	876.2	978.1	1065.6	1143.4	1205.9	1254.1	1282.5	1294.6
122.5°	865.6	964.0	1043.8	1111.9	1164.7	1205.9	1229.9	1242.0
125°	847.7	941.9	1017.5	1077.7	1121.5	1153.3	1174.1	1180.6
127.5°	825.8	915.9	991.2	1048.4	1092.4	1120.7	1138.2	1144.7
130°	808.3	894.8	969.3	1027.4	1072.2	1099.6	1117.1	1123.7
132.5°	789.9	871.2	943.9	1001.9	1045.9	1076.9	1093.4	1100.0
135°	764.5	835.7	902.5	957.2	1001.1	1031.7	1049.2	1055.8
137.5°	741.5	801.7	858.0	907.5	948.5	978.7	993.2	1001.1
140°	728.3	779.8	829.1	875.1	913.4	937.5	952.8	961.6
142.5°	716.0	761.4	803.7	843.6	877.5	899.8	913.4	919.5
145°	698.8	736.0	768.8	799.6	826.9	845.6	856.5	862.0
147.5°	684.6	714.1	740.4	764.5	784.7	800.6	809.0	810.9
150°	675.8	701.0	722.8	742.5	760.1	774.3	780.9	782.0
152.5°	666.1	687.8	707.9	724.2	739.0	750.6	754.6	755.7
155°	651.7	669.2	685.6	698.8	709.7	718.5	721.8	721.8
157.5°	636.1	650.8	664.6	675.1	683.4	690.0	692.0	692.0
160°	626.5	638.5	650.5	659.3	665.9	672.5	673.5	673.5
162.5°	616.8	627.2	636.6	644.4	649.2	655.8	657.0	656.0
165°	603.5	610.0	617.7	623.2	627.5	632.0	630.8	629.8
167.5°	590.6	595.6	601.7	605.0	607.2	610.0	609.8	609.0
170°	582.7	586.0	590.3	593.6	595.8	596.9	595.8	595.8
172.5°	575.6	578.1	580.7	583.1	584.4	585.5	584.4	582.7
175°	566.3	567.3	569.5	569.5	569.5	571.7	569.5	567.3
177.5°	560.1	561.0	561.0	561.8	561.0	561.8	560.1	558.4
180°	557.5	557.5	557.5	557.5	557.5	557.5	557.5	557.5

(END OF REPORT)