

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: NEO-RAY

Report Number: P332695-840

Luminaire Tested: **S124DIP-S1195D810U840-4F0-1E-UDD-F1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-79-08  
Report Number: P332695-840  
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-10,  
Test Lab: INNOVATION CENTER  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: NEO-RAY  
Catalog Number: S124DIP-S1195D810U840-4F0-1E-UDD-F1  
Description: DEFINE 4 DIRECT-INDIRECT PENDANT LED LUMINAIRE  
DOWNLIGHT 1195 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER  
UPLIGHT 810 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER  
Light Source: -  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 7999.6 lumens  
Efficiency: N/A  
Efficacy: 131.8 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.3  
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')  
CIE Type: Semi-Direct


Input Watts (W): 60.7  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P332695-840

CATALOG NUMBER: S124DIP-S1195D810U840-4F0-1E-UDD-F1

### Luminous Intensity Polar Plot

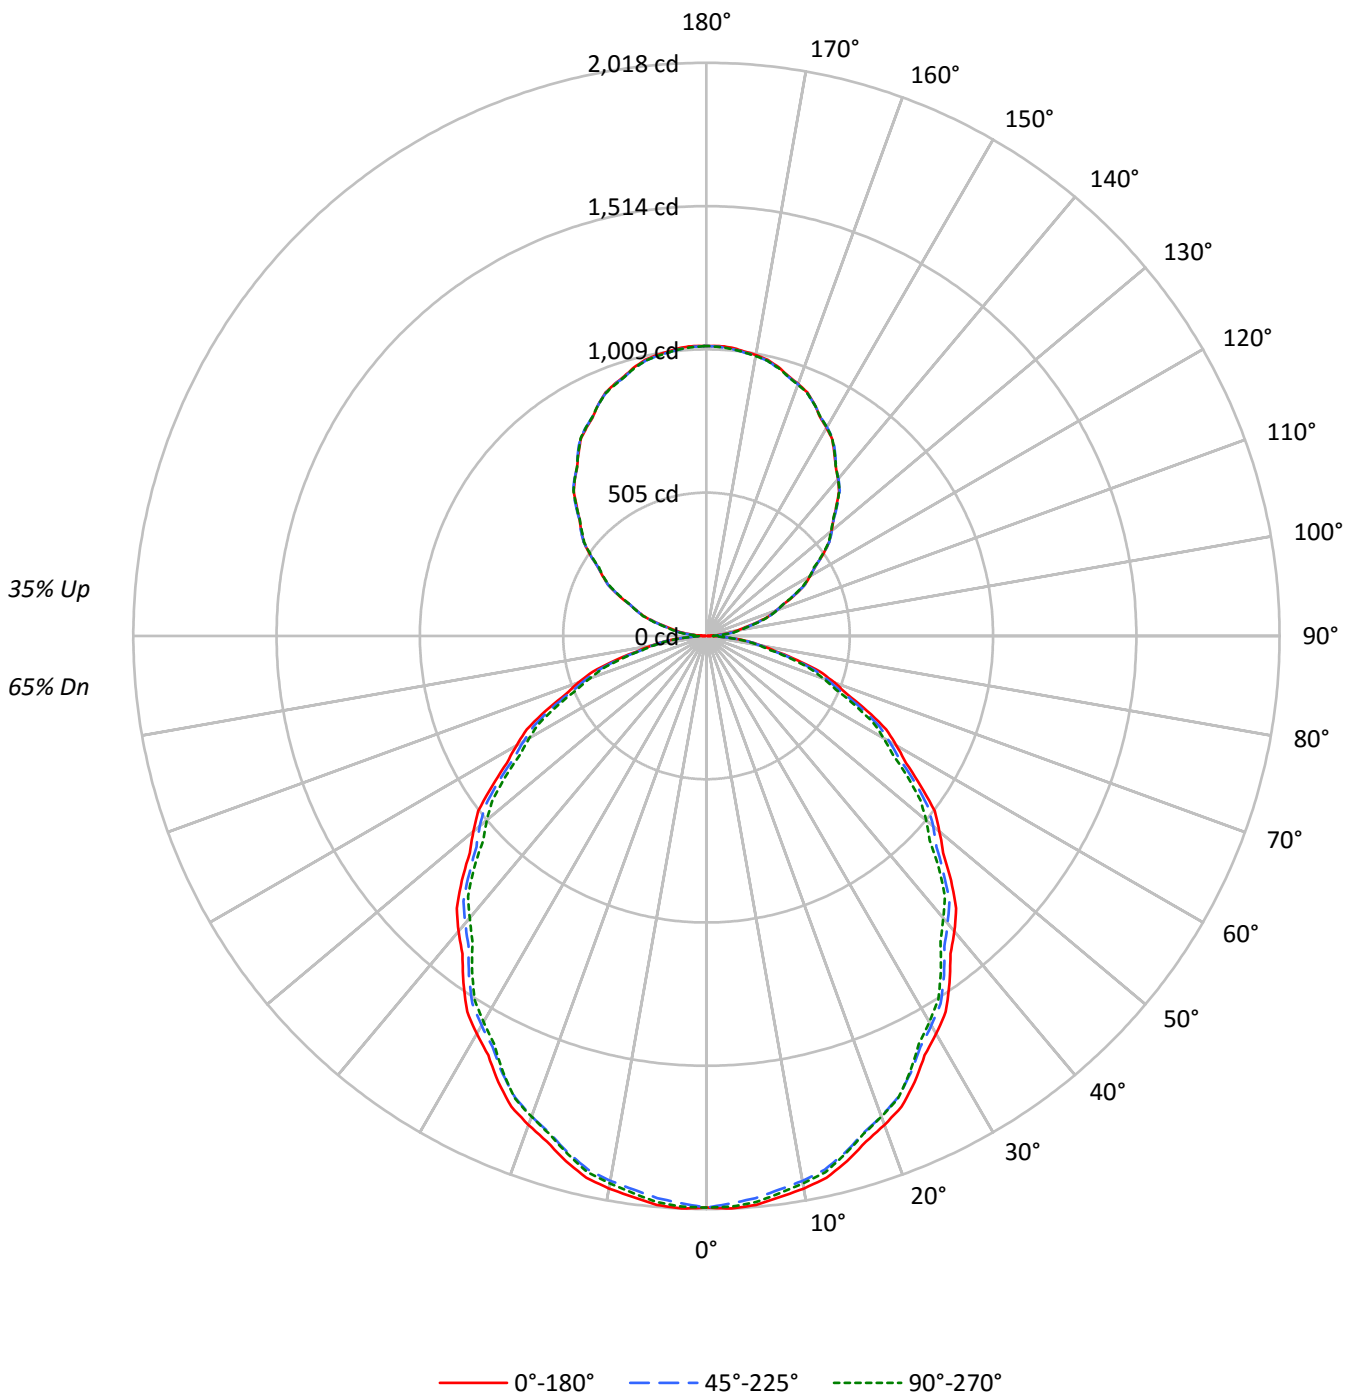



TEST NUMBER: P332695-840

CATALOG NUMBER: S124DIP-S1195D810U840-4F0-1E-UDD-F1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	111	111	111	111	104	104	104	104	91	91	91	80	80	80	70	70	70	65
1	101	97	93	89	95	91	87	84	80	78	75	70	68	67	61	60	59	54
2	92	84	78	73	86	79	74	69	70	66	62	62	59	56	54	52	49	45
3	84	74	67	61	79	70	63	58	62	57	52	55	51	47	48	45	42	38
4	77	66	58	51	72	62	55	49	55	49	45	49	44	40	43	39	36	33
5	71	59	50	44	66	55	48	42	49	43	39	44	39	35	39	35	32	29
6	65	53	44	38	61	50	42	37	45	38	34	40	35	31	35	31	28	25
7	60	48	39	34	56	45	38	32	41	34	30	36	31	27	32	28	25	22
8	56	43	35	30	53	41	34	29	37	31	27	33	28	24	29	25	22	20
9	52	40	32	27	49	38	31	26	34	28	24	30	26	22	27	23	20	18
10	49	36	29	24	46	35	28	23	31	26	22	28	23	20	25	21	18	16

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	16247	16247	16247
5°	16295	16100	16216
10°	16193	15969	16047
15°	15998	15742	15782
20°	15738	15460	15474
25°	15441	15139	15097
30°	15077	14762	14626
35°	14701	14366	14177
40°	14309	13918	13663
45°	13900	13476	13218
50°	13448	13083	12679
55°	12960	12573	12165
60°	12471	12003	11638
65°	11922	11459	10997
70°	11306	10733	10315
75°	10359	9860	9607
80°	9219	8847	8619
85°	8068	7762	7614



TEST NUMBER: P332695-840

CATALOG NUMBER: S124DIP-S1195D810U840-4F0-1E-UDD-F1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	189.5	2.4
10°-20°	534.0	6.7
20°-30°	786.0	9.8
30°-40°	913.7	11.4
40°-50°	913.7	11.4
50°-60°	799.3	10.0
60°-70°	593.6	7.4
70°-80°	337.2	4.2
80°-90°	100.4	1.3
90°-100°	67.3	0.8
100°-110°	199.5	2.5
110°-120°	338.5	4.2
120°-130°	446.4	5.6
130°-140°	501.3	6.3
140°-150°	492.6	6.2
150°-160°	414.3	5.2
160°-170°	275.7	3.4
170°-180°	96.5	1.2
0°-30°	1509.5	18.9
0°-40°	2423.2	30.3
0°-60°	4136.2	51.7
0°-90°	5167.4	64.6
90°-120°	605.4	7.6
90°-150°	2045.7	25.6
90°-180°	2832.0	35.4
0°-180°	7999.6	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	2012	2012	2012	2012	2012	
5°	2011	2004	1987	2003	2001	191
15°	1914	1907	1884	1892	1888	539
25°	1734	1722	1700	1701	1695	797
35°	1492	1480	1458	1447	1438	932
45°	1218	1205	1180	1163	1158	938
55°	921	915	893	875	864	824
65°	624	616	600	584	576	618
75°	332	324	316	310	308	353
85°	87	87	84	84	82	96
90°	2	11	17	22	24	8
95°	47	54	60	62	62	53
105°	184	185	188	190	193	195
115°	344	344	343	342	341	339
125°	501	501	501	499	497	447
135°	647	651	651	650	647	500
145°	786	789	790	789	786	491
155°	900	900	899	902	899	414
165°	980	977	976	980	977	276
175°	1019	1015	1014	1020	1014	97
180°	1021	1021	1021	1021	1021	



TEST NUMBER: P332695-840

CATALOG NUMBER: S124DIP-S1195D810U840-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5
2.5°	2017.6	2016.8	2015.9	2015.1	2014.2	2012.2	2009.0	2005.9	2002.8	1999.6	2002.5
5°	2010.8	2009.4	2008.0	2006.6	2005.2	2002.5	1998.5	1994.6	1990.6	1986.7	1990.6
7.5°	1992.2	1990.7	1989.3	1987.8	1986.4	1983.6	1979.1	1974.8	1970.4	1966.0	1969.2
10°	1975.4	1974.0	1972.6	1971.1	1969.6	1966.6	1962.0	1957.3	1952.7	1948.0	1950.9
12.5°	1953.5	1952.1	1950.6	1949.1	1947.7	1944.5	1939.6	1934.7	1929.8	1924.8	1927.9
15°	1914.1	1912.7	1911.3	1909.9	1908.3	1905.0	1899.6	1894.2	1888.9	1883.5	1885.6
17.5°	1866.7	1864.9	1863.1	1861.4	1859.6	1856.1	1851.0	1845.9	1840.9	1835.7	1837.1
20°	1831.9	1830.1	1828.3	1826.5	1824.7	1821.1	1815.7	1810.4	1805.0	1799.6	1800.7
22.5°	1794.4	1792.1	1789.8	1787.4	1785.0	1781.1	1775.7	1770.4	1765.0	1759.6	1761.6
25°	1733.5	1731.0	1728.5	1726.0	1723.4	1719.7	1714.6	1709.7	1704.7	1699.6	1700.0
27.5°	1663.9	1661.2	1658.7	1656.1	1653.6	1649.9	1645.3	1640.6	1636.0	1631.2	1630.4
30°	1617.4	1614.6	1611.6	1608.8	1606.0	1602.2	1597.5	1592.9	1588.2	1583.6	1582.2
32.5°	1568.4	1565.8	1563.3	1560.6	1558.0	1554.3	1549.3	1544.4	1539.4	1534.5	1532.8
35°	1491.7	1489.1	1486.6	1484.1	1481.6	1477.8	1472.8	1467.8	1462.8	1457.7	1455.2
37.5°	1410.7	1408.4	1406.1	1403.8	1401.5	1397.7	1392.3	1386.9	1381.5	1376.1	1373.4
40°	1357.8	1354.9	1352.0	1349.2	1346.4	1342.2	1336.9	1331.4	1326.1	1320.7	1317.1
42.5°	1301.0	1299.3	1297.6	1295.9	1294.1	1290.3	1284.3	1278.4	1272.4	1266.5	1262.3
45°	1217.5	1215.0	1212.4	1209.9	1207.5	1203.4	1197.6	1191.8	1186.1	1180.4	1176.5
47.5°	1130.0	1128.3	1126.6	1124.9	1123.2	1119.7	1114.4	1109.1	1103.8	1098.5	1094.1
50°	1070.8	1069.3	1067.8	1066.4	1065.0	1061.8	1056.7	1051.8	1046.7	1041.7	1036.7
52.5°	1012.7	1011.0	1009.3	1007.5	1005.8	1002.3	997.0	991.7	986.4	981.1	976.6
55°	920.8	919.7	918.7	917.6	916.5	913.4	908.4	903.4	898.4	893.3	889.1
57.5°	833.0	831.8	830.6	829.4	828.2	825.1	820.1	815.2	810.2	805.3	801.2
60°	772.4	770.6	768.8	767.1	765.3	762.0	757.4	752.8	748.0	743.4	740.1
62.5°	713.1	711.6	710.0	708.5	707.1	703.9	698.9	694.0	689.0	684.1	681.2
65°	624.1	622.3	620.5	618.6	616.9	614.2	610.7	607.0	603.5	599.9	596.3
67.5°	534.4	532.8	531.1	529.5	527.9	525.2	521.8	518.4	514.9	511.5	508.1
70°	479.0	476.5	473.9	471.4	468.9	466.3	463.3	460.5	457.6	454.7	451.9
72.5°	419.6	417.1	414.5	412.0	409.6	407.2	404.9	402.5	400.3	398.0	395.7
75°	332.1	330.4	328.6	326.8	325.0	323.3	321.4	319.6	317.9	316.1	314.7
77.5°	248.6	247.8	247.1	246.3	245.5	244.3	242.8	241.2	239.6	238.0	237.6
80°	198.3	197.2	196.2	195.1	194.1	193.2	192.5	191.7	191.0	190.3	189.6
82.5°	149.4	148.9	148.3	147.8	147.3	147.0	146.8	146.7	146.5	146.4	146.0
85°	87.1	87.1	87.1	87.1	87.1	86.7	86.0	85.3	84.5	83.8	83.8
87.5°	34.0	34.1	34.2	34.3	34.4	34.4	34.4	34.4	34.4	34.4	34.6
90°	2.3	4.3	6.3	8.2	10.1	11.7	13.1	14.5	16.0	17.4	18.4
92.5°	16.9	19.1	21.3	23.5	25.8	27.4	28.3	29.3	30.3	31.3	31.9
95°	47.4	49.0	50.5	52.1	53.7	55.1	56.4	57.6	58.8	60.0	60.5
97.5°	82.7	84.0	85.2	86.5	87.8	89.2	90.6	92.0	93.4	94.9	95.5
100°	110.6	111.2	111.9	112.6	113.3	114.5	116.0	117.6	119.2	120.8	121.2
102.5°	139.6	139.9	140.2	140.5	140.7	141.6	143.0	144.4	145.9	147.3	147.8
105°	184.0	184.1	184.3	184.5	184.7	185.1	185.8	186.5	187.2	187.9	188.4
107.5°	230.6	230.8	231.0	231.2	231.4	231.6	231.7	231.8	231.9	232.0	232.5
110°	262.2	262.5	262.8	263.2	263.5	263.6	263.5	263.3	263.1	262.9	262.6



TEST NUMBER: P332695-840

CATALOG NUMBER: S124DIP-S1195D810U840-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (continued):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
112.5°	295.0	295.0	295.1	295.2	295.3	295.1	294.8	294.5	294.2	293.9	293.8
115°	344.3	344.3	344.3	344.3	344.3	344.1	343.7	343.4	343.0	342.6	342.4
117.5°	390.6	390.8	390.9	391.0	391.2	391.1	390.9	390.6	390.4	390.2	389.6
120°	421.6	422.3	423.0	423.7	424.4	424.4	423.9	423.4	422.9	422.4	421.5
122.5°	453.8	454.0	454.3	454.6	454.9	454.9	454.7	454.4	454.2	453.9	453.3
125°	501.3	501.3	501.3	501.3	501.3	501.2	501.1	500.9	500.7	500.6	500.2
127.5°	544.4	544.9	545.5	546.0	546.5	546.6	546.3	546.1	545.8	545.5	545.2
130°	574.7	575.3	575.8	576.3	576.8	577.1	577.1	577.1	577.1	577.1	576.7
132.5°	605.7	606.1	606.5	606.8	607.2	607.3	607.2	607.1	606.9	606.8	606.4
135°	646.6	647.6	648.7	649.7	650.9	651.4	651.4	651.4	651.4	651.4	651.0
137.5°	691.2	691.7	692.1	692.6	693.1	693.5	693.8	694.1	694.3	694.6	694.2
140°	720.8	721.1	721.5	721.9	722.3	722.4	722.4	722.4	722.4	722.4	722.3
142.5°	748.0	748.3	748.7	749.0	749.4	749.5	749.3	749.2	749.0	748.9	748.9
145°	785.6	786.3	787.0	787.7	788.4	788.8	789.0	789.1	789.3	789.5	789.3
147.5°	822.8	823.6	824.5	825.4	826.2	826.6	826.4	826.3	826.1	826.0	825.9
150°	845.6	846.3	847.0	847.7	848.4	848.7	848.7	848.7	848.7	848.7	848.7
152.5°	867.1	867.5	867.9	868.3	868.7	869.0	869.1	869.3	869.4	869.6	870.0
155°	900.0	900.0	900.0	900.0	900.0	899.9	899.8	899.6	899.4	899.3	899.9
157.5°	927.9	927.5	927.2	926.9	926.6	926.3	926.3	926.3	926.2	926.2	926.8
160°	944.2	944.0	943.9	943.7	943.5	943.3	943.2	943.0	942.8	942.7	943.2
162.5°	959.4	959.0	958.5	958.1	957.6	957.3	957.0	956.9	956.7	956.5	957.6
165°	979.8	979.3	978.8	978.2	977.7	977.2	976.8	976.5	976.1	975.8	976.8
167.5°	995.4	994.6	993.9	993.2	992.5	992.1	992.1	992.2	992.2	992.2	993.3
170°	1004.2	1003.4	1002.5	1001.6	1000.8	1000.4	1000.6	1000.8	1000.9	1001.1	1002.1
172.5°	1010.6	1009.9	1009.1	1008.4	1007.6	1007.2	1007.3	1007.3	1007.3	1007.4	1008.6
175°	1019.3	1018.3	1017.4	1016.6	1015.7	1015.2	1015.0	1014.8	1014.7	1014.5	1015.7
177.5°	1022.1	1021.4	1020.7	1020.0	1019.3	1019.0	1019.0	1019.0	1019.0	1019.0	1019.9
180°	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8



TEST NUMBER: P332695-840

CATALOG NUMBER: S124DIP-S1195D810U840-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
0°	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5	2012.5
2.5°	2005.3	2008.2	2011.0	2012.4	2012.1	2011.8	2011.4	2011.1
5°	1994.6	1998.5	2002.5	2004.1	2003.4	2002.7	2002.0	2001.1
7.5°	1972.4	1975.5	1978.6	1980.0	1979.6	1979.1	1978.7	1978.3
10°	1953.7	1956.6	1959.4	1960.6	1959.8	1959.1	1958.3	1957.6
12.5°	1931.1	1934.2	1937.4	1938.4	1937.4	1936.4	1935.4	1934.4
15°	1887.7	1890.0	1892.1	1892.6	1891.6	1890.5	1889.4	1888.3
17.5°	1838.5	1839.9	1841.2	1841.5	1840.8	1840.1	1839.4	1838.7
20°	1801.8	1802.8	1803.9	1804.1	1803.4	1802.7	1802.0	1801.2
22.5°	1763.5	1765.4	1767.4	1767.7	1766.5	1765.1	1763.8	1762.5
25°	1700.4	1700.7	1701.1	1700.5	1699.1	1697.7	1696.3	1694.9
27.5°	1629.5	1628.7	1627.8	1626.5	1624.7	1623.0	1621.1	1619.3
30°	1580.6	1579.2	1577.8	1576.2	1574.4	1572.7	1570.8	1569.0
32.5°	1531.1	1529.3	1527.6	1525.9	1524.1	1522.3	1520.6	1518.7
35°	1452.8	1450.3	1447.7	1445.6	1443.8	1442.0	1440.2	1438.5
37.5°	1370.7	1368.0	1365.2	1362.7	1360.4	1358.0	1355.6	1353.2
40°	1313.5	1309.9	1306.4	1303.6	1301.9	1300.1	1298.3	1296.5
42.5°	1258.2	1254.1	1249.9	1247.2	1246.0	1244.8	1243.5	1242.3
45°	1172.6	1168.6	1164.7	1162.2	1161.0	1159.9	1158.9	1157.8
47.5°	1089.6	1085.2	1080.8	1077.1	1074.4	1071.7	1068.9	1066.2
50°	1031.7	1026.6	1021.7	1018.0	1015.9	1013.8	1011.6	1009.5
52.5°	972.2	967.8	963.3	959.8	957.0	954.3	951.6	948.9
55°	884.7	880.5	876.2	872.9	870.8	868.7	866.5	864.3
57.5°	797.2	793.0	789.0	785.9	783.9	781.7	779.6	777.6
60°	736.9	733.8	730.5	728.0	726.2	724.4	722.7	720.8
62.5°	678.1	675.2	672.3	669.9	668.1	666.3	664.6	662.8
65°	592.7	589.2	585.5	582.9	581.1	579.3	577.4	575.7
67.5°	504.6	501.2	497.8	495.7	495.2	494.7	494.2	493.7
70°	449.0	446.2	443.2	441.3	440.2	439.2	438.1	437.0
72.5°	393.4	391.1	388.8	387.1	386.1	385.0	383.8	382.8
75°	313.2	311.7	310.3	309.4	309.1	308.7	308.3	308.0
77.5°	237.1	236.7	236.3	235.6	234.7	233.8	232.8	231.9
80°	188.8	188.1	187.4	186.9	186.5	186.1	185.8	185.4
82.5°	145.5	145.1	144.7	144.3	143.9	143.6	143.2	142.9
85°	83.8	83.8	83.8	83.7	83.3	82.9	82.6	82.2
87.5°	34.8	35.0	35.2	35.4	35.4	35.5	35.6	35.6
90°	19.5	20.5	21.6	22.3	22.6	23.0	23.3	23.7
92.5°	32.5	33.1	33.8	34.2	34.4	34.6	34.8	35.0
95°	61.1	61.6	62.1	62.4	62.4	62.4	62.4	62.4
97.5°	96.1	96.7	97.5	97.8	97.8	97.8	97.8	97.8
100°	121.5	121.9	122.2	122.4	122.4	122.4	122.4	122.4
102.5°	148.3	148.8	149.3	149.6	149.8	149.9	150.1	150.2
105°	188.9	189.5	190.0	190.6	191.1	191.6	192.1	192.7
107.5°	233.0	233.4	233.9	234.2	234.1	234.1	234.1	234.0
110°	262.2	261.9	261.5	261.6	262.2	262.7	263.2	263.7





TEST NUMBER: P332695-840

CATALOG NUMBER: S124DIP-S1195D810U840-4F0-1E-UDD-F1

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
112.5°	293.7	293.7	293.6	293.6	293.7	293.8	293.9	294.0
115°	342.2	342.1	341.9	341.7	341.6	341.4	341.2	341.0
117.5°	389.0	388.4	387.8	387.3	387.0	386.6	386.3	385.9
120°	420.6	419.7	418.9	418.6	419.0	419.3	419.7	420.0
122.5°	452.7	452.2	451.6	451.0	450.3	449.7	449.1	448.5
125°	499.9	499.5	499.2	498.8	498.5	498.1	497.8	497.4
127.5°	544.8	544.5	544.1	543.8	543.5	543.3	543.0	542.7
130°	576.4	576.0	575.7	575.2	574.5	573.8	573.1	572.4
132.5°	606.1	605.7	605.4	605.1	604.8	604.5	604.2	604.0
135°	650.7	650.3	649.9	649.4	648.9	648.4	647.9	647.4
137.5°	693.7	693.3	692.8	692.6	692.7	692.8	692.9	693.1
140°	722.1	721.9	721.6	721.5	721.3	721.1	720.9	720.8
142.5°	748.8	748.8	748.8	748.7	748.7	748.7	748.6	748.6
145°	789.1	789.0	788.8	788.4	787.9	787.4	786.9	786.4
147.5°	825.7	825.6	825.4	825.3	825.1	824.9	824.8	824.6
150°	848.7	848.7	848.7	848.6	848.5	848.3	848.1	847.9
152.5°	870.4	870.8	871.2	871.2	870.8	870.3	869.9	869.4
155°	900.6	901.3	902.0	902.0	901.3	900.6	899.9	899.3
157.5°	927.3	927.9	928.4	928.3	927.8	927.2	926.6	925.9
160°	943.7	944.2	944.7	944.6	943.7	942.8	942.0	941.1
162.5°	958.5	959.4	960.4	960.4	959.5	958.7	957.8	956.8
165°	978.0	979.0	980.1	980.2	979.5	978.8	978.1	977.4
167.5°	994.3	995.4	996.4	996.4	995.3	994.2	993.2	992.1
170°	1003.2	1004.2	1005.3	1005.2	1004.0	1002.8	1001.5	1000.3
172.5°	1009.8	1011.0	1012.2	1012.2	1011.0	1009.7	1008.5	1007.2
175°	1016.9	1018.1	1019.5	1019.5	1018.1	1016.9	1015.7	1014.5
177.5°	1020.9	1021.9	1022.9	1022.8	1021.7	1020.6	1019.5	1018.2
180°	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8	1020.8

(END OF REPORT)