

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902157

Luminaire Tested: DFN2DIP-4P2F0-030D030US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902157
REPORT IS A COMBINATION OF REPORTS P900540 AND P897455
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P2F0-030D030US830-RLLONL
Description: 2 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5202.9 lumens
Efficiency: N/A
Efficacy: 102.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.07' x L: 2.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 51
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902157

CATALOG NUMBER: DFN2DIP-4P2F0-030D030US830-RLLONL

Luminous Intensity Polar Plot

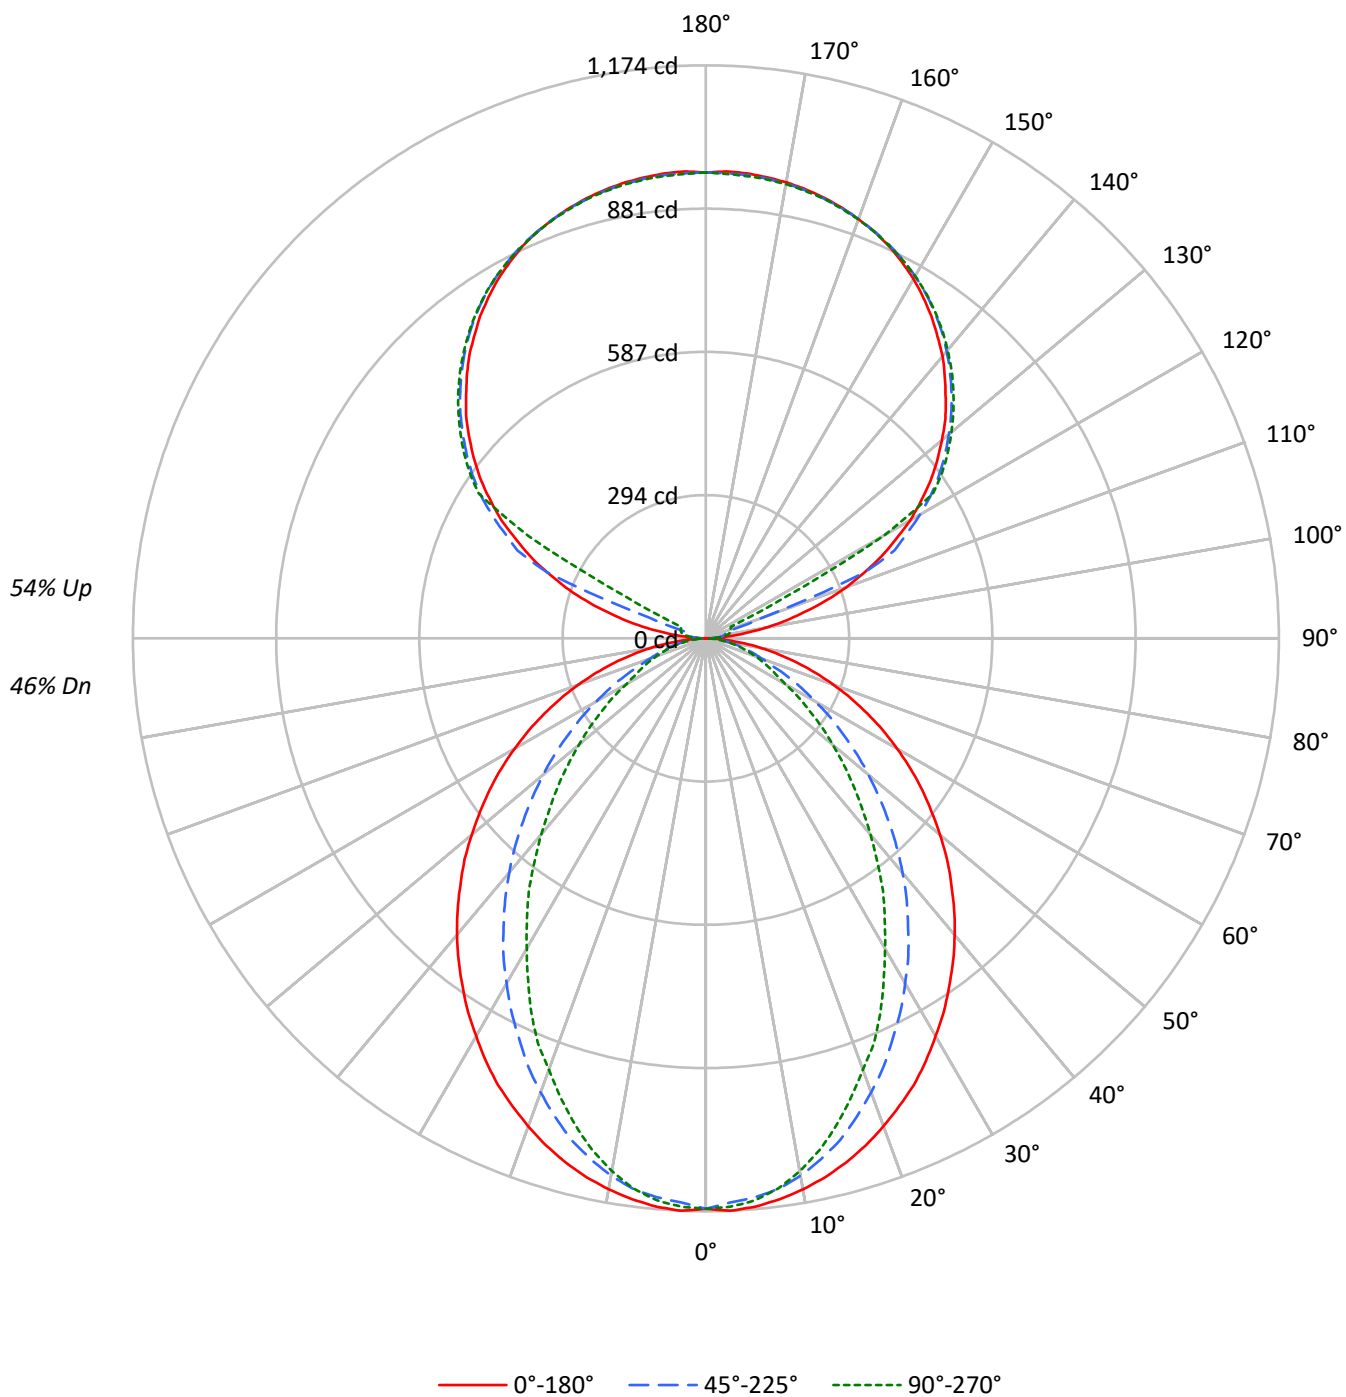

TEST NUMBER: P902157

CATALOG NUMBER: DFN2DIP-4P2F0-030D030US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2926	2926	2926
5°	2925	2872	2893
10°	2890	2809	2794
15°	2845	2708	2644
20°	2786	2574	2462
25°	2726	2424	2286
30°	2648	2271	2065
35°	2571	2108	1870
40°	2492	1939	1648
45°	2401	1753	1447
50°	2306	1566	1251
55°	2207	1367	1063
60°	2092	1160	870
65°	1959	951	778
70°	1798	756	697
75°	1595	652	625
80°	1306	527	528
85°	841	324	372

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2401 cd/sqm

TEST NUMBER: P902157

CATALOG NUMBER: DFN2DIP-4P2F0-030D030US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	109.5	2.1
10°-20°	300.7	5.8
20°-30°	422.1	8.1
30°-40°	460.2	8.8
40°-50°	422.9	8.1
50°-60°	332.2	6.4
60°-70°	216.2	4.2
70°-80°	111.3	2.1
80°-90°	30.1	0.6
90°-100°	31.5	0.6
100°-110°	117.3	2.3
110°-120°	311.1	6.0
120°-130°	516.0	9.9
130°-140°	548.1	10.5
140°-150°	509.4	9.8
150°-160°	409.6	7.9
160°-170°	263.9	5.1
170°-180°	90.8	1.7
0°-30°	832.3	16.0
0°-40°	1292.5	24.8
0°-60°	2047.6	39.4
0°-90°	2405.2	46.2
90°-120°	459.9	8.8
90°-150°	2033.4	39.1
90°-180°	2798.0	53.8
0°-180°	5202.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1169	1169	1169	1169	1169	
5°	1169	1163	1150	1159	1156	111
15°	1112	1100	1064	1044	1033	313
25°	1009	975	905	862	846	464
35°	869	815	722	656	632	544
45°	711	640	529	454	428	549
55°	540	458	344	280	260	483
65°	365	279	184	148	145	362
75°	194	121	85	77	76	206
85°	45	23	20	20	20	52
90°	1	8	14	17	19	5
95°	45	22	27	30	30	53
105°	210	231	42	50	52	224
115°	397	409	426	106	57	391
125°	561	570	584	588	590	501
135°	695	706	712	719	718	537
145°	806	805	817	822	818	504
155°	887	881	889	894	888	409
165°	935	931	933	938	933	264
175°	956	952	953	958	951	91
180°	954	954	954	954	954	

TEST NUMBER: P902157

CATALOG NUMBER: DFN2DIP-4P2F0-030D030US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1168.7	1168.7	1168.7	1168.7	1168.7
2.5°	1173.9	1168.7	1157.0	1167.6	1165.5
5°	1168.7	1163.4	1149.6	1159.1	1155.9
7.5°	1159.1	1152.8	1138.0	1142.2	1136.9
10°	1146.4	1139.1	1117.9	1114.7	1108.4
12.5°	1130.6	1121.1	1092.5	1086.2	1074.5
15°	1111.5	1099.9	1063.9	1043.9	1033.3
17.5°	1089.3	1072.4	1027.9	1004.8	987.8
20°	1063.9	1042.7	989.9	963.6	940.2
22.5°	1036.5	1012.1	950.7	914.8	899.0
25°	1009.0	975.1	905.3	862.0	846.0
27.5°	976.2	940.2	863.0	813.3	788.9
30°	941.3	901.1	816.4	762.6	734.0
32.5°	907.4	858.8	772.1	708.6	682.1
35°	869.4	815.4	722.4	655.7	632.4
37.5°	832.4	774.1	675.8	602.8	576.5
40°	793.2	729.8	627.2	552.0	524.6
42.5°	753.0	685.4	578.5	500.2	473.8
45°	710.8	639.8	528.9	453.6	428.3
47.5°	670.5	595.5	481.3	406.0	382.9
50°	626.1	551.0	434.7	361.7	339.5
52.5°	582.7	503.4	390.3	320.5	300.4
55°	540.4	457.9	343.7	280.3	260.2
57.5°	497.1	412.5	302.6	243.3	226.3
60°	452.6	368.1	259.1	205.2	188.3
62.5°	409.3	324.7	222.1	171.4	163.0
65°	364.9	279.2	184.0	148.1	144.9
67.5°	322.6	236.9	148.1	130.1	126.9
70°	278.1	195.7	122.6	112.1	107.8
72.5°	235.8	157.5	102.5	94.2	92.0
75°	194.5	120.6	84.6	77.2	76.2
77.5°	153.4	85.6	66.6	62.4	60.2
80°	115.3	61.4	50.7	46.6	46.6
82.5°	80.3	41.3	34.9	32.8	32.8
85°	45.4	23.2	20.1	20.1	20.1
87.5°	17.0	8.4	8.4	7.4	7.4
90°	0.7	8.3	13.8	17.3	18.6
92.5°	17.3	14.5	16.6	18.0	18.6
95°	44.9	22.1	26.9	30.4	29.7
97.5°	80.8	24.2	35.2	37.3	38.0
100°	122.2	27.6	39.4	44.9	46.3
102.5°	167.8	166.5	40.7	48.3	50.4
105°	209.9	230.6	42.1	49.7	52.5
107.5°	258.9	276.2	43.5	51.1	53.9
110°	305.9	320.4	120.8	51.8	54.6

TEST NUMBER: P902157

CATALOG NUMBER: DFN2DIP-4P2F0-030D030US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	350.2	362.5	350.8	53.2	55.2
115°	397.0	408.8	426.0	106.3	56.6
117.5°	437.8	451.6	463.4	364.6	183.7
120°	483.3	493.7	506.1	514.4	421.2
122.5°	522.0	533.1	547.0	551.0	551.8
125°	561.4	570.3	583.5	588.3	590.4
127.5°	597.3	606.9	617.4	624.2	624.9
130°	631.1	642.2	649.8	657.3	656.8
132.5°	665.6	674.7	682.2	688.4	687.8
135°	694.7	705.8	711.9	718.9	717.5
137.5°	725.0	733.3	740.3	747.2	745.1
140°	754.7	760.3	767.8	774.0	770.6
142.5°	779.7	784.5	793.4	798.9	795.5
145°	805.9	805.1	816.9	821.7	818.2
147.5°	828.6	826.5	838.3	841.7	839.0
150°	850.7	845.9	857.0	861.0	857.6
152.5°	869.3	863.8	874.2	878.4	873.5
155°	887.3	881.2	889.4	893.5	888.1
157.5°	901.8	896.4	902.6	907.4	901.8
160°	914.3	910.1	914.3	918.4	913.5
162.5°	925.3	921.1	924.6	929.4	923.2
165°	934.9	930.9	932.9	937.7	932.9
167.5°	942.5	938.4	940.5	945.4	939.1
170°	948.8	944.6	946.0	950.8	944.6
172.5°	952.9	948.8	950.2	955.0	948.8
175°	956.3	951.5	952.9	957.7	950.8
177.5°	957.7	952.9	953.7	958.5	952.3
180°	954.3	954.3	954.3	954.3	954.3

TEST NUMBER: P902157

CATALOG NUMBER: DFN2DIP-4P2F0-030D030US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.38	11.18	11.38	12.18	13.51	6.34	7.14	7.34	8.14	9.47
	3H	12.03	12.75	13.04	13.76	15.11	7.51	8.22	8.51	9.23	10.58
	4H	12.62	13.30	13.64	14.32	15.67	7.94	8.62	8.96	9.63	10.99
	6H	13.03	13.65	14.05	14.67	16.04	8.24	8.86	9.27	9.88	11.25
	8H	13.14	13.73	14.18	14.77	16.13	8.32	8.91	9.36	9.95	11.31
	12H	13.19	13.76	14.23	14.78	16.17	8.36	8.92	9.39	9.95	11.33
4H	2H	10.39	11.07	11.41	12.08	13.44	6.92	7.60	7.95	8.61	9.97
	3H	12.19	12.75	13.22	13.80	15.16	8.24	8.81	9.28	9.85	11.22
	4H	12.86	13.38	13.90	14.41	15.80	8.77	9.29	9.81	10.32	11.71
	6H	13.35	13.80	14.40	14.85	16.24	9.17	9.61	10.22	10.67	12.06
	8H	13.52	13.93	14.57	14.98	16.38	9.28	9.70	10.34	10.75	12.15
	12H	13.60	13.97	14.67	15.03	16.44	9.34	9.71	10.40	10.77	12.18
8H	4H	12.82	13.24	13.87	14.29	15.69	9.04	9.45	10.09	10.50	11.90
	6H	13.36	13.70	14.44	14.80	16.20	9.53	9.87	10.60	10.96	12.36
	8H	13.56	13.86	14.65	14.94	16.36	9.70	10.00	10.78	11.08	12.50
	12H	13.68	13.95	14.77	15.02	16.48	9.80	10.07	10.89	11.14	12.60
12H	4H	12.77	13.14	13.84	14.21	15.62	9.04	9.41	10.10	10.47	11.88
	6H	13.34	13.64	14.42	14.71	16.13	9.57	9.87	10.65	10.94	12.36
	8H	13.54	13.80	14.62	14.87	16.33	9.76	10.02	10.84	11.09	12.55

END OF REPORT