

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921241

Luminaire Tested: DFN2DIP-4P2F0-020D030US940-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921241
REPORT IS A COMBINATION OF REPORTS P900538 AND P897455
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P2F0-020D030US940-RLLONL
Description: 2 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4164.3 lumens
Efficiency: N/A
Efficacy: 104.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.07' x L: 2.07' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 40
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921241

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US940-RLLONL

Luminous Intensity Polar Plot

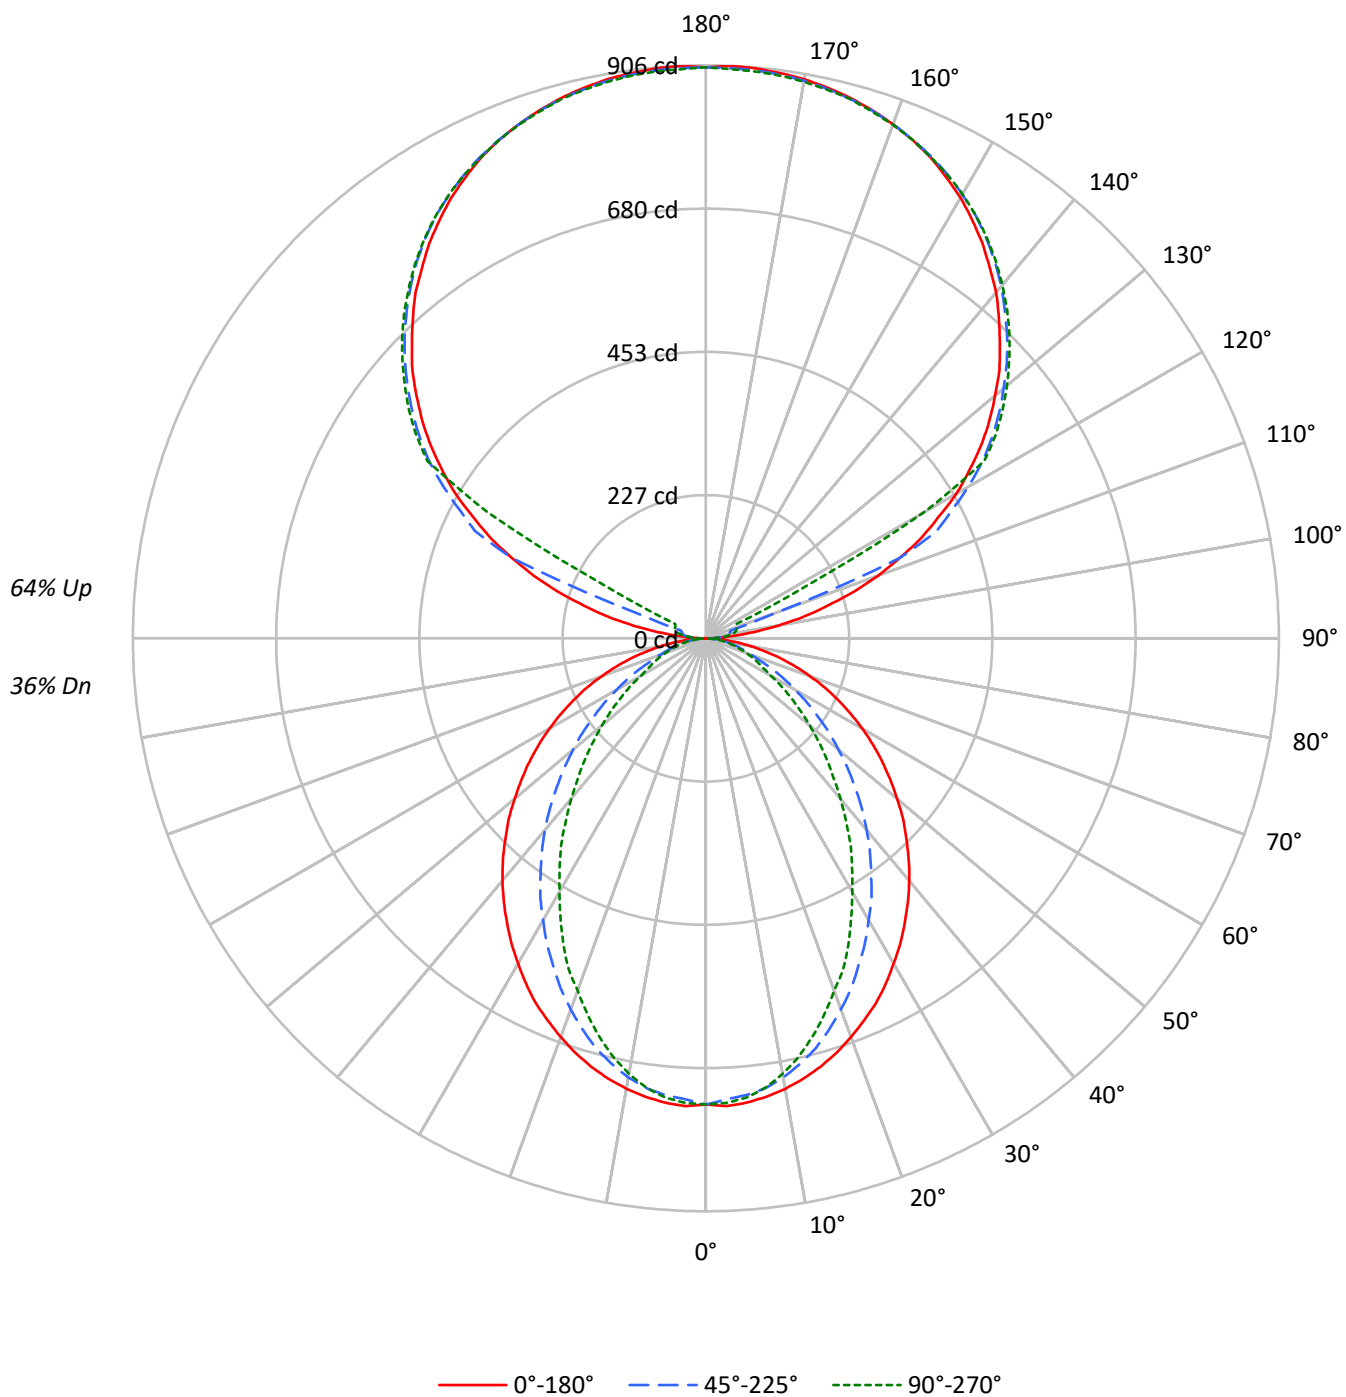

TEST NUMBER: P921241

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1846	1846	1846
5°	1845	1812	1825
10°	1823	1771	1763
15°	1794	1708	1668
20°	1757	1624	1553
25°	1720	1529	1442
30°	1670	1433	1302
35°	1621	1329	1180
40°	1571	1223	1039
45°	1514	1106	912
50°	1455	988	789
55°	1392	862	670
60°	1320	732	549
65°	1236	600	491
70°	1134	477	440
75°	1006	411	394
80°	823	333	332
85°	530	205	235

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1514 cd/sqm

TEST NUMBER: P921241

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	69.1	1.7
10°-20°	189.6	4.6
20°-30°	266.3	6.4
30°-40°	290.2	7.0
40°-50°	266.8	6.4
50°-60°	209.5	5.0
60°-70°	136.4	3.3
70°-80°	70.2	1.7
80°-90°	19.5	0.5
90°-100°	29.8	0.7
100°-110°	111.0	2.7
110°-120°	294.3	7.1
120°-130°	488.2	11.7
130°-140°	518.5	12.5
140°-150°	481.9	11.6
150°-160°	387.5	9.3
160°-170°	249.7	6.0
170°-180°	85.9	2.1
0°-30°	525.0	12.6
0°-40°	815.2	19.6
0°-60°	1291.4	31.0
0°-90°	1517.5	36.4
90°-120°	435.1	10.4
90°-150°	1923.7	46.2
90°-180°	2647.0	63.6
0°-180°	4164.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	737	737	737	737	737	
5°	737	734	725	731	729	70
15°	701	694	671	658	652	198
25°	636	615	571	544	534	293
35°	548	514	456	414	399	343
45°	448	404	334	286	270	346
55°	341	289	217	177	164	305
65°	230	176	116	94	91	228
75°	123	76	53	49	48	130
85°	29	15	13	13	13	33
90°	1	8	13	16	18	4
95°	42	21	25	29	28	50
105°	199	218	40	47	50	212
115°	376	387	403	101	54	370
125°	531	540	552	557	559	474
135°	657	668	674	680	679	508
145°	762	762	773	777	774	477
155°	840	834	841	845	840	387
165°	884	881	883	887	883	250
175°	905	900	902	906	900	86
180°	903	903	903	903	903	

TEST NUMBER: P921241

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	737.1	737.1	737.1	737.1	737.1
2.5°	740.4	737.1	729.7	736.5	735.1
5°	737.1	733.8	725.0	731.1	729.1
7.5°	731.1	727.1	717.7	720.4	717.0
10°	723.1	718.4	705.1	703.0	699.1
12.5°	713.1	707.0	689.0	685.1	677.7
15°	701.1	693.7	671.0	658.3	651.8
17.5°	687.1	676.4	648.4	633.6	623.0
20°	671.0	657.6	624.4	607.7	593.0
22.5°	653.7	638.4	599.7	577.0	567.0
25°	636.4	615.0	571.0	543.7	533.6
27.5°	615.7	593.0	544.3	512.9	497.6
30°	593.7	568.3	515.0	481.0	462.9
32.5°	572.3	541.6	487.0	446.9	430.3
35°	548.3	514.3	455.7	413.6	398.9
37.5°	524.9	488.2	426.2	380.2	363.6
40°	500.2	460.3	395.6	348.2	330.8
42.5°	474.9	432.3	364.9	315.5	298.9
45°	448.3	403.5	333.6	286.1	270.1
47.5°	422.9	375.6	303.5	256.1	241.5
50°	394.9	347.6	274.2	228.1	214.2
52.5°	367.5	317.4	246.1	202.2	189.5
55°	340.8	288.8	216.8	176.8	164.1
57.5°	313.5	260.1	190.8	153.5	142.8
60°	285.5	232.1	163.5	129.5	118.8
62.5°	258.2	204.8	140.1	108.1	102.7
65°	230.2	176.1	116.1	93.5	91.4
67.5°	203.5	149.4	93.5	82.0	80.1
70°	175.4	123.4	77.3	70.7	68.0
72.5°	148.7	99.3	64.6	59.4	58.1
75°	122.7	76.0	53.3	48.7	48.1
77.5°	96.8	54.0	42.0	39.3	38.0
80°	72.7	38.7	32.0	29.3	29.3
82.5°	50.6	26.0	22.0	20.7	20.7
85°	28.6	14.6	12.7	12.7	12.7
87.5°	10.7	5.4	5.4	4.6	4.6
90°	0.6	7.8	13.0	16.4	17.6
92.5°	16.4	13.7	15.7	17.0	17.6
95°	42.4	20.9	25.4	28.8	28.1
97.5°	76.4	22.9	33.3	35.3	35.9
100°	115.7	26.1	37.3	42.4	43.8
102.5°	158.7	157.5	38.5	45.7	47.7
105°	198.6	218.2	39.9	47.0	49.7
107.5°	245.0	261.3	41.2	48.3	51.0
110°	289.4	303.1	114.3	49.0	51.6

TEST NUMBER: P921241

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	331.3	343.0	331.9	50.3	52.3
115°	375.6	386.7	403.1	100.6	53.6
117.5°	414.2	427.2	438.4	344.9	173.8
120°	457.3	467.1	478.8	486.7	398.5
122.5°	493.8	504.4	517.5	521.3	522.0
125°	531.1	539.6	552.1	556.6	558.6
127.5°	565.1	574.2	584.1	590.6	591.2
130°	597.1	607.6	614.7	621.9	621.3
132.5°	629.7	638.3	645.4	651.3	650.7
135°	657.2	667.7	673.5	680.1	678.8
137.5°	685.9	693.8	700.3	706.9	704.9
140°	714.0	719.3	726.4	732.3	729.1
142.5°	737.6	742.2	750.6	755.8	752.6
145°	762.4	761.7	772.8	777.4	774.1
147.5°	783.9	781.9	793.1	796.3	793.7
150°	804.9	800.3	810.7	814.6	811.4
152.5°	822.4	817.3	827.1	831.0	826.4
155°	839.5	833.7	841.4	845.3	840.2
157.5°	853.2	848.0	853.9	858.4	853.2
160°	865.0	861.0	865.0	868.9	864.2
162.5°	875.4	871.5	874.8	879.3	873.4
165°	884.5	880.7	882.6	887.2	882.6
167.5°	891.7	887.8	889.7	894.4	888.5
170°	897.6	893.7	895.0	899.6	893.7
172.5°	901.5	897.6	898.9	903.5	897.6
175°	904.7	900.2	901.5	906.1	899.6
177.5°	906.1	901.5	902.2	906.8	900.9
180°	902.9	902.9	902.9	902.9	902.9

TEST NUMBER: P921241

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US940-RLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.73	8.46	8.80	9.53	10.98	3.69	4.42	4.76	5.49	6.94
	3H	9.37	10.03	10.45	11.10	12.58	4.85	5.50	5.93	6.58	8.05
	4H	9.96	10.58	11.05	11.66	13.14	5.28	5.90	6.37	6.98	8.46
	6H	10.36	10.93	11.46	12.01	13.50	5.58	6.15	6.68	7.23	8.72
	8H	10.47	11.01	11.58	12.11	13.60	5.66	6.20	6.76	7.29	8.78
	12H	10.52	11.04	11.63	12.13	13.64	5.69	6.20	6.79	7.29	8.80
4H	2H	7.73	8.35	8.82	9.42	10.90	4.26	4.88	5.36	5.96	7.44
	3H	9.52	10.03	10.62	11.14	12.63	5.58	6.09	6.68	7.20	8.69
	4H	10.19	10.66	11.30	11.76	13.27	6.10	6.58	7.21	7.67	9.18
	6H	10.68	11.08	11.79	12.20	13.71	6.49	6.90	7.61	8.02	9.52
	8H	10.84	11.22	11.95	12.33	13.85	6.61	6.99	7.72	8.10	9.62
	12H	10.92	11.26	12.05	12.38	13.91	6.66	7.00	7.79	8.12	9.65
8H	4H	10.15	10.52	11.26	11.63	13.16	6.36	6.74	7.48	7.85	9.37
	6H	10.68	10.99	11.82	12.15	13.67	6.85	7.16	7.98	8.31	9.83
	8H	10.88	11.16	12.03	12.29	13.83	7.02	7.29	8.16	8.43	9.97
	12H	11.00	11.24	12.15	12.37	13.94	7.12	7.36	8.27	8.49	10.06
12H	4H	10.09	10.43	11.22	11.56	13.08	6.36	6.70	7.49	7.82	9.35
	6H	10.66	10.93	11.80	12.06	13.60	6.89	7.16	8.03	8.30	9.83
	8H	10.86	11.09	12.00	12.22	13.80	7.08	7.32	8.22	8.45	10.02

END OF REPORT