

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923967

Luminaire Tested: DFN2DIP-4P2F0-020D030US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923967
REPORT IS A COMBINATION OF REPORTS P900537 AND P897455
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P2F0-020D030US950-FLLONL
Description: 2 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4722.3 lumens
Efficiency: N/A
Efficacy: 118.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.07' x L: 2.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 40
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923967

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US950-FLLONL

Luminous Intensity Polar Plot

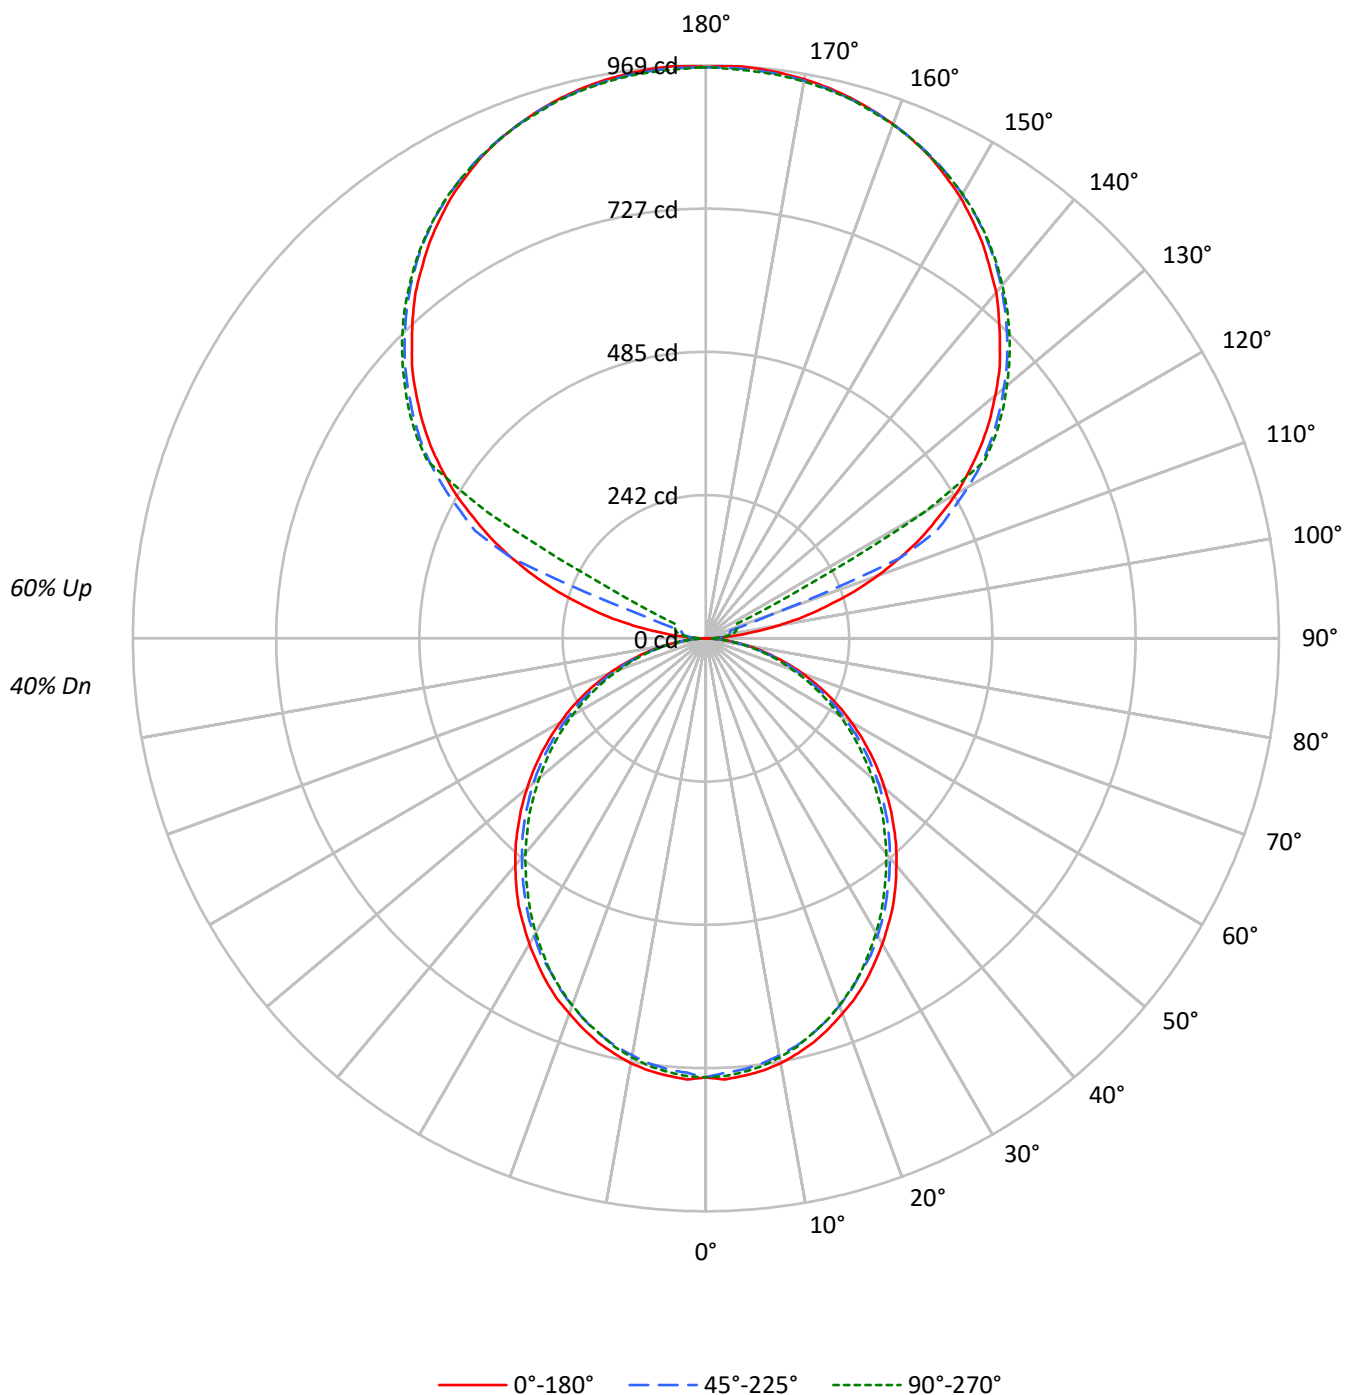

TEST NUMBER: P923967

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US950-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																				
0	105	105	105	105	95	95	95	95		78	78	78		62	62	62		47	47	47
1	96	91	87	84	87	83	80	77		68	66	64		54	53	51		41	41	40
2	87	80	74	69	79	73	68	63		60	56	53		48	45	43		37	35	33
3	79	70	63	57	72	64	58	53		53	48	44		42	39	36		32	30	28
4	73	62	54	48	66	57	50	45		47	42	38		37	34	31		29	26	24
5	67	55	47	41	60	50	44	38		42	37	33		34	30	27		26	23	21
6	61	49	41	36	56	45	38	33		38	32	28		30	26	23		24	21	19
7	57	45	37	31	51	41	34	29		34	29	25		28	24	21		22	19	17
8	52	40	33	27	48	37	30	26		31	26	22		25	21	18		20	17	15
9	49	37	29	24	44	34	27	23		28	23	20		23	19	17		18	15	13
10	46	34	27	22	41	31	25	20		26	21	18		21	18	15		17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1859	1859	1859
5°	1858	1828	1842
10°	1839	1799	1814
15°	1809	1765	1772
20°	1768	1719	1729
25°	1729	1665	1680
30°	1679	1615	1619
35°	1632	1556	1554
40°	1574	1496	1491
45°	1517	1436	1428
50°	1454	1373	1355
55°	1388	1300	1286
60°	1313	1215	1208
65°	1231	1126	1116
70°	1126	1017	1016
75°	983	886	919
80°	810	721	743
85°	541	450	463

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1517 cd/sqm

TEST NUMBER: P923967

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	69.9	1.5
10°-20°	196.6	4.2
20°-30°	288.9	6.1
30°-40°	335.6	7.1
40°-50°	335.2	7.1
50°-60°	292.2	6.2
60°-70°	216.0	4.6
70°-80°	122.2	2.6
80°-90°	34.0	0.7
90°-100°	31.9	0.7
100°-110°	118.7	2.5
110°-120°	314.9	6.7
120°-130°	522.3	11.1
130°-140°	554.8	11.7
140°-150°	515.6	10.9
150°-160°	414.5	8.8
160°-170°	267.1	5.7
170°-180°	91.9	1.9
0°-30°	555.4	11.8
0°-40°	891.0	18.9
0°-60°	1518.4	32.2
0°-90°	1890.6	40.0
90°-120°	465.5	9.9
90°-150°	2058.1	43.6
90°-180°	2832.0	60.0
0°-180°	4722.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	742	742	742	742	742	
5°	742	740	732	737	736	70
15°	707	702	693	696	692	199
25°	640	634	622	623	622	294
35°	552	545	533	529	525	345
45°	449	444	433	426	423	347
55°	340	336	327	318	315	304
65°	229	225	218	211	208	227
75°	120	119	115	111	112	128
85°	29	28	28	26	25	33
90°	1	8	14	18	19	4
95°	45	22	27	31	30	54
105°	212	233	43	50	53	227
115°	402	414	431	108	57	396
125°	568	577	591	596	598	507
135°	703	714	721	728	726	543
145°	816	815	827	832	828	510
155°	898	892	900	904	899	414
165°	946	942	944	949	944	267
175°	968	963	964	969	962	92
180°	966	966	966	966	966	

TEST NUMBER: P923967

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	742.4	742.4	742.4	742.4	742.4
2.5°	746.7	743.2	735.2	742.4	741.1
5°	742.4	739.6	731.7	737.4	736.0
7.5°	737.4	733.1	725.3	731.1	729.6
10°	729.6	724.7	716.1	721.7	719.6
12.5°	718.8	714.6	706.1	709.6	708.2
15°	706.7	702.5	693.2	696.0	692.5
17.5°	691.7	687.5	678.2	681.7	678.2
20°	675.3	671.0	661.0	663.2	660.4
22.5°	658.9	652.5	643.2	643.2	641.8
25°	639.7	633.9	621.8	623.2	621.8
27.5°	618.2	613.2	604.0	601.9	598.3
30°	596.8	591.1	580.4	578.3	575.4
32.5°	573.9	569.7	558.3	554.0	551.1
35°	551.9	544.7	533.3	529.0	525.4
37.5°	526.9	520.4	509.0	504.0	500.4
40°	501.1	495.4	484.0	477.7	474.7
42.5°	476.1	470.4	459.1	451.9	447.6
45°	449.0	444.1	433.3	425.5	422.6
47.5°	422.6	417.7	406.2	398.3	394.1
50°	394.8	391.2	381.2	371.2	367.7
52.5°	367.7	362.6	353.4	345.5	340.6
55°	339.8	335.5	326.9	318.4	314.8
57.5°	312.0	308.4	299.1	290.6	287.6
60°	284.1	281.3	271.3	263.4	261.3
62.5°	257.0	252.0	244.9	237.7	234.9
65°	229.2	224.9	217.8	211.3	207.8
67.5°	200.6	197.0	190.6	185.6	182.8
70°	174.2	171.3	164.9	159.9	157.1
72.5°	147.1	144.2	140.6	135.7	133.6
75°	119.9	118.6	114.9	110.7	112.1
77.5°	95.7	92.8	91.3	89.2	87.1
80°	71.5	70.7	69.3	67.1	65.6
82.5°	48.6	48.6	47.9	45.0	45.0
85°	29.2	28.5	27.9	25.7	25.0
87.5°	12.9	11.4	10.0	7.9	7.2
90°	0.7	8.4	13.9	17.6	18.8
92.5°	17.6	14.7	16.8	18.2	18.8
95°	45.4	22.3	27.2	30.8	30.1
97.5°	81.8	24.5	35.6	37.8	38.4
100°	123.7	28.0	39.9	45.4	46.8
102.5°	169.8	168.5	41.2	48.8	51.0
105°	212.5	233.4	42.6	50.3	53.1
107.5°	262.1	279.5	44.1	51.7	54.6
110°	309.7	324.3	122.3	52.5	55.2

TEST NUMBER: P923967

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	354.4	366.9	355.1	53.8	55.9
115°	401.8	413.7	431.2	107.6	57.3
117.5°	443.1	457.1	469.0	369.0	185.9
120°	489.2	499.7	512.3	520.7	426.3
122.5°	528.3	539.6	553.6	557.7	558.5
125°	568.2	577.3	590.6	595.5	597.6
127.5°	604.5	614.3	624.9	631.8	632.5
130°	638.8	650.1	657.7	665.3	664.7
132.5°	673.7	682.9	690.5	696.8	696.1
135°	703.1	714.4	720.6	727.6	726.2
137.5°	733.8	742.2	749.3	756.2	754.1
140°	763.9	769.5	777.1	783.4	780.0
142.5°	789.1	794.0	803.1	808.6	805.2
145°	815.7	814.9	826.8	831.7	828.2
147.5°	838.7	836.6	848.5	851.9	849.2
150°	861.1	856.2	867.4	871.5	868.0
152.5°	879.9	874.3	884.8	889.0	884.2
155°	898.1	891.9	900.2	904.4	898.9
157.5°	912.8	907.3	913.6	918.4	912.8
160°	925.4	921.2	925.4	929.6	924.6
162.5°	936.5	932.3	935.9	940.7	934.4
165°	946.3	942.2	944.3	949.1	944.3
167.5°	954.0	949.8	951.9	956.9	950.6
170°	960.3	956.1	957.5	962.4	956.1
172.5°	964.5	960.3	961.7	966.6	960.3
175°	967.9	963.1	964.5	969.4	962.4
177.5°	969.4	964.5	965.3	970.1	963.8
180°	965.9	965.9	965.9	965.9	965.9

TEST NUMBER: P923967

CATALOG NUMBER: DFN2DIP-4P2F0-020D030US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.29	9.07	9.33	10.12	11.52	7.85	8.63	8.89	9.67	11.08
	3H	9.93	10.62	10.97	11.68	13.10	9.44	10.13	10.48	11.19	12.61
	4H	10.49	11.16	11.55	12.21	13.64	10.00	10.66	11.06	11.72	13.15
	6H	10.87	11.48	11.94	12.54	13.99	10.37	10.98	11.44	12.04	13.49
	8H	10.97	11.55	12.04	12.62	14.06	10.46	11.04	11.54	12.12	13.56
	12H	11.00	11.55	12.08	12.62	14.09	10.50	11.05	11.57	12.12	13.58
4H	2H	8.73	9.39	9.80	10.45	11.88	8.38	9.04	9.44	10.09	11.53
	3H	10.56	11.12	11.64	12.20	13.64	10.16	10.71	11.23	11.79	13.24
	4H	11.26	11.76	12.34	12.84	14.30	10.83	11.34	11.91	12.41	13.88
	6H	11.75	12.18	12.83	13.28	14.74	11.31	11.75	12.40	12.85	14.31
	8H	11.88	12.29	12.97	13.38	14.86	11.45	11.85	12.53	12.94	14.42
	12H	11.94	12.31	13.05	13.41	14.89	11.49	11.86	12.60	12.96	14.45
8H	4H	11.43	11.84	12.52	12.93	14.41	11.06	11.46	12.14	12.55	14.03
	6H	12.03	12.37	13.15	13.50	14.97	11.65	11.98	12.76	13.12	14.59
	8H	12.24	12.53	13.36	13.65	15.14	11.84	12.14	12.96	13.25	14.75
	12H	12.35	12.61	13.47	13.72	15.25	11.94	12.20	13.06	13.31	14.84
12H	4H	11.41	11.78	12.52	12.88	14.36	11.04	11.41	12.15	12.51	13.99
	6H	12.06	12.35	13.18	13.47	14.96	11.68	11.98	12.80	13.09	14.58
	8H	12.28	12.54	13.40	13.65	15.18	11.90	12.15	13.02	13.26	14.80

END OF REPORT