

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902230

Luminaire Tested: DFN2DIP-4P3F0-040D060US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902230
REPORT IS A COMBINATION OF REPORTS P899073 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-040D060US830-FLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8737.4 lumens
Efficiency: N/A
Efficacy: 103.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 84.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902230

CATALOG NUMBER: DFN2DIP-4P3F0-040D060US830-FLLFLL

Luminous Intensity Polar Plot

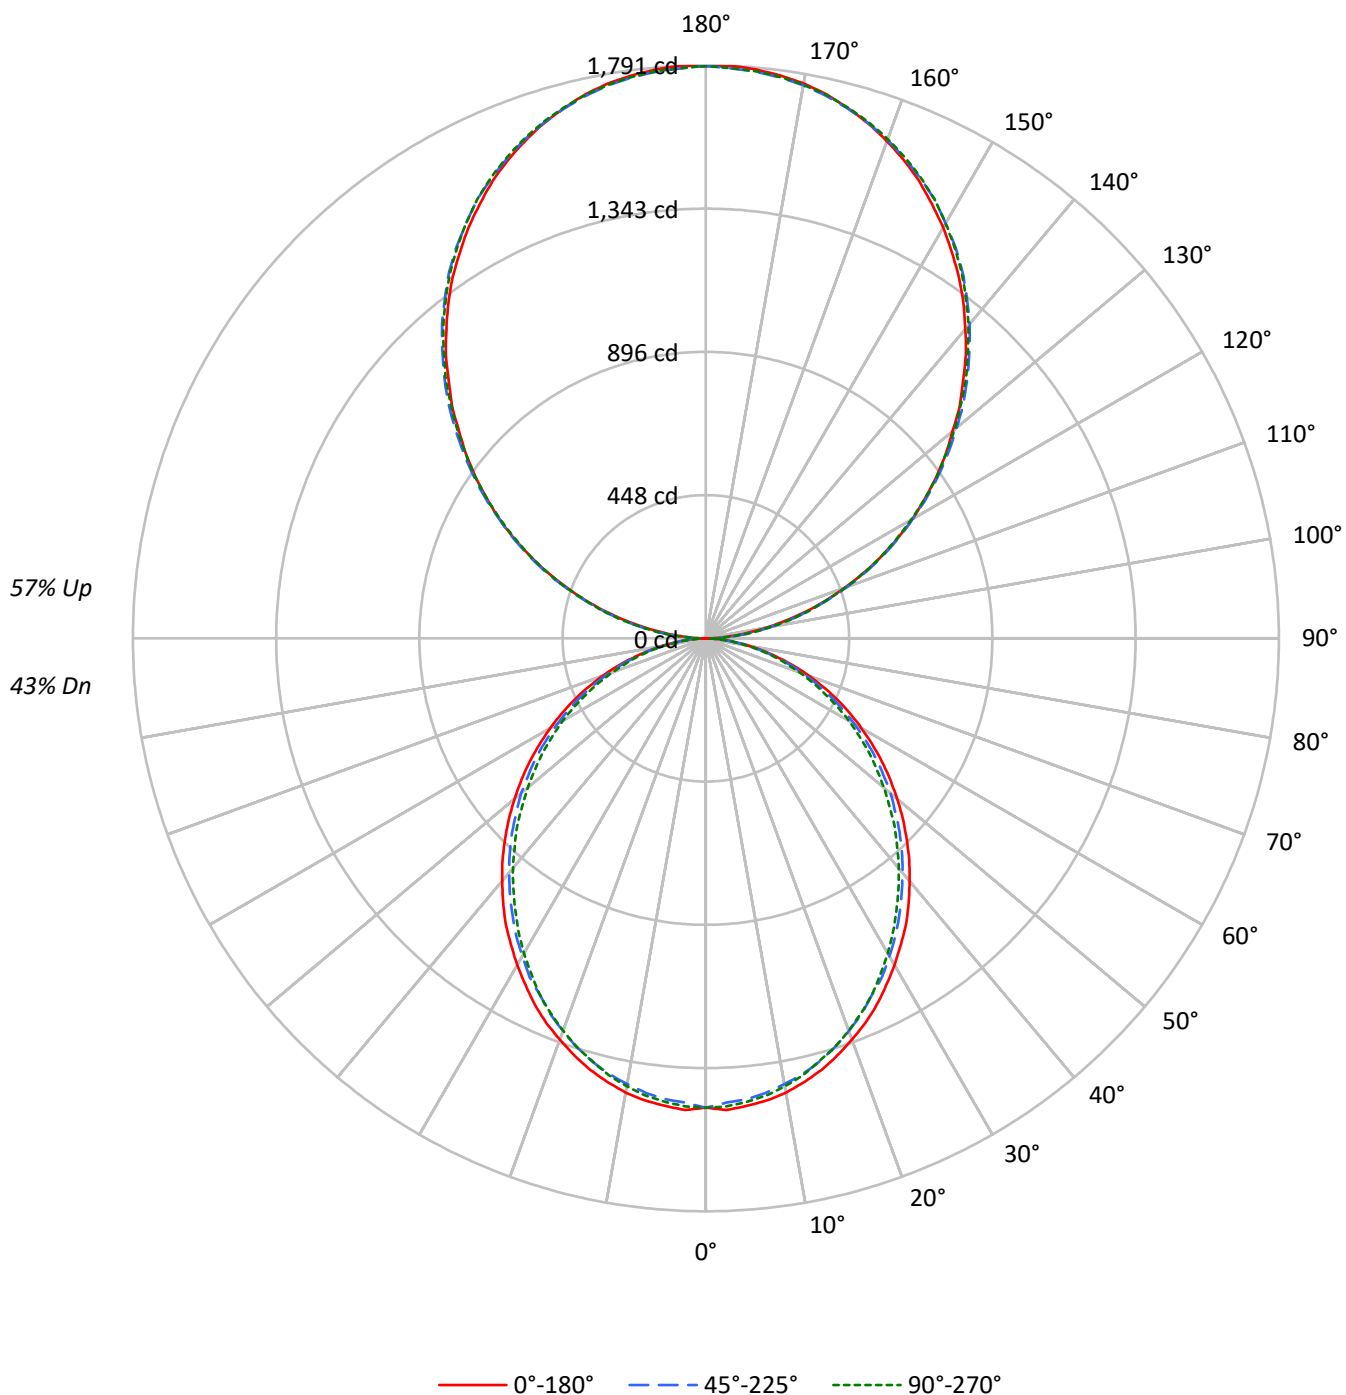

TEST NUMBER: P902230

CATALOG NUMBER: DFN2DIP-4P3F0-040D060US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1672	1672	1672
5°	1673	1647	1659
10°	1659	1624	1636
15°	1633	1596	1600
20°	1599	1558	1564
25°	1565	1513	1522
30°	1523	1470	1469
35°	1483	1420	1412
40°	1434	1370	1358
45°	1385	1319	1303
50°	1331	1266	1240
55°	1275	1205	1181
60°	1211	1132	1114
65°	1142	1056	1035
70°	1053	964	949
75°	931	853	870
80°	782	712	719
85°	551	471	471

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1793 cd/sqm

TEST NUMBER: P902230

CATALOG NUMBER: DFN2DIP-4P3F0-040D060US830-FLLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.1	1.6
10°-20°	388.5	4.4
20°-30°	570.9	6.5
30°-40°	663.1	7.6
40°-50°	662.3	7.6
50°-60°	577.5	6.6
60°-70°	426.9	4.9
70°-80°	241.5	2.8
80°-90°	68.8	0.8
90°-100°	110.7	1.3
100°-110°	351.6	4.0
110°-120°	601.8	6.9
120°-130°	791.4	9.1
130°-140°	888.4	10.2
140°-150°	871.1	10.0
150°-160°	730.8	8.4
160°-170°	484.6	5.5
170°-180°	169.4	1.9
0°-30°	1097.5	12.6
0°-40°	1760.6	20.1
0°-60°	3000.3	34.3
0°-90°	3737.5	42.8
90°-120°	1064.1	12.2
90°-150°	3615.0	41.4
90°-180°	5000.0	57.2
0°-180°	8737.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1461	1446	1457	1454	139
15°	1396	1388	1370	1375	1368	393
25°	1264	1253	1229	1231	1229	582
35°	1090	1076	1054	1045	1038	681
45°	887	878	856	841	835	685
55°	672	663	646	629	622	600
65°	453	444	430	418	411	448
75°	237	234	227	219	222	253
85°	58	56	55	51	49	64
90°	2	19	53	50	51	9
95°	79	94	96	96	94	88
105°	325	329	332	335	335	343
115°	604	613	610	608	604	597
125°	878	892	888	883	881	785
135°	1136	1153	1156	1154	1150	878
145°	1379	1390	1399	1400	1394	862
155°	1577	1582	1586	1594	1589	726
165°	1716	1714	1714	1725	1717	484
175°	1785	1781	1778	1789	1779	170
180°	1789	1789	1789	1789	1789	

TEST NUMBER: P902230

CATALOG NUMBER: DFN2DIP-4P3F0-040D060US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1475.5	1468.5	1452.9	1467.0	1464.3
5°	1467.0	1461.4	1445.9	1457.1	1454.4
7.5°	1457.1	1448.7	1433.1	1444.5	1441.7
10°	1441.7	1431.8	1414.9	1426.2	1421.9
12.5°	1420.4	1412.0	1395.2	1402.2	1399.3
15°	1396.5	1388.1	1369.7	1375.4	1368.4
17.5°	1366.9	1358.5	1340.1	1347.1	1340.1
20°	1334.4	1326.0	1306.3	1310.4	1304.9
22.5°	1302.0	1289.3	1270.9	1270.9	1268.1
25°	1263.9	1252.6	1228.7	1231.4	1228.7
27.5°	1221.5	1211.6	1193.4	1189.2	1182.2
30°	1179.3	1168.0	1146.9	1142.6	1137.0
32.5°	1134.2	1125.8	1103.2	1094.7	1088.9
35°	1090.4	1076.4	1053.8	1045.3	1038.2
37.5°	1041.0	1028.3	1005.7	995.9	988.8
40°	990.3	978.9	956.3	943.8	938.1
42.5°	940.9	929.5	907.1	892.9	884.5
45°	887.3	877.5	856.2	840.8	835.1
47.5°	835.1	825.2	802.7	787.1	778.7
50°	780.0	773.0	753.3	733.5	726.4
52.5°	726.4	716.6	698.3	682.8	672.9
55°	671.6	663.0	646.1	629.1	622.2
57.5°	616.4	609.4	591.0	574.1	568.4
60°	561.4	555.8	536.1	520.6	516.3
62.5°	507.8	497.9	483.9	469.8	464.1
65°	452.9	444.3	430.3	417.5	410.6
67.5°	396.4	389.3	376.7	366.8	361.2
70°	344.2	338.6	325.8	315.9	310.4
72.5°	290.7	284.9	278.0	268.1	263.8
75°	237.0	234.2	227.1	218.7	221.5
77.5°	189.0	183.3	180.5	176.3	172.1
80°	141.1	139.6	136.8	132.6	129.8
82.5°	96.0	96.0	94.6	88.9	88.9
85°	57.8	56.5	55.0	50.7	49.4
87.5°	25.4	22.6	19.8	15.6	14.0
90°	1.6	19.4	52.9	49.6	51.2
92.5°	33.5	45.3	46.9	48.5	48.5
95°	78.7	93.8	96.5	96.5	93.8
97.5°	131.0	145.1	151.0	151.0	151.0
100°	191.4	203.8	208.1	208.1	206.5
102.5°	255.1	264.2	270.1	271.7	270.1
105°	324.6	328.9	332.2	334.9	334.9
107.5°	393.6	400.1	400.1	401.1	393.6
110°	460.5	469.1	469.1	469.1	464.8

TEST NUMBER: P902230

CATALOG NUMBER: DFN2DIP-4P3F0-040D060US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	532.7	541.9	540.3	535.9	532.7
115°	603.9	612.6	609.8	608.2	603.9
117.5°	674.6	686.5	678.8	674.6	670.2
120°	745.7	757.6	745.7	745.7	740.8
122.5°	810.4	825.5	817.9	813.7	810.4
125°	878.4	891.8	887.5	882.7	881.1
127.5°	944.7	961.4	955.5	949.0	944.7
130°	1006.7	1026.1	1023.4	1020.2	1014.3
132.5°	1076.3	1091.4	1092.4	1084.9	1080.5
135°	1136.1	1152.8	1156.0	1154.4	1150.1
137.5°	1203.0	1216.4	1219.2	1218.0	1211.6
140°	1261.8	1275.3	1282.8	1282.8	1276.9
142.5°	1322.1	1335.6	1339.9	1341.5	1335.6
145°	1379.3	1390.1	1398.7	1400.3	1394.4
147.5°	1430.5	1444.0	1450.5	1453.1	1447.2
150°	1483.4	1492.5	1498.5	1503.3	1498.5
152.5°	1530.2	1539.5	1547.0	1552.9	1547.0
155°	1577.2	1581.5	1586.3	1593.9	1589.0
157.5°	1617.6	1620.9	1623.5	1634.4	1626.8
160°	1653.8	1657.0	1658.6	1667.7	1661.3
162.5°	1687.2	1687.2	1688.8	1699.0	1691.5
165°	1715.7	1714.1	1714.1	1724.9	1717.4
167.5°	1741.6	1736.8	1736.8	1747.6	1740.0
170°	1761.0	1756.7	1755.1	1765.9	1756.7
172.5°	1774.5	1770.2	1768.6	1779.3	1770.2
175°	1785.3	1781.0	1777.7	1788.6	1779.3
177.5°	1791.2	1787.0	1783.7	1792.8	1783.7
180°	1788.6	1788.6	1788.6	1788.6	1788.6

TEST NUMBER: P902230

CATALOG NUMBER: DFN2DIP-4P3F0-040D060US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.31	9.11	9.33	10.14	11.51	7.87	8.67	8.89	9.70	11.07
	3H	9.97	10.68	10.99	11.72	13.11	9.48	10.19	10.50	11.23	12.62
	4H	10.55	11.23	11.59	12.27	13.66	10.05	10.73	11.09	11.77	13.17
	6H	10.94	11.57	11.99	12.61	14.02	10.44	11.07	11.49	12.11	13.52
	8H	11.04	11.64	12.10	12.70	14.10	10.54	11.14	11.60	12.19	13.60
	12H	11.09	11.65	12.15	12.71	14.14	10.58	11.14	11.64	12.20	13.63
4H	2H	8.76	9.44	9.81	10.48	11.88	8.41	9.09	9.46	10.13	11.53
	3H	10.62	11.19	11.67	12.25	13.66	10.21	10.78	11.27	11.84	13.26
	4H	11.33	11.85	12.39	12.90	14.34	10.90	11.42	11.96	12.48	13.91
	6H	11.84	12.28	12.90	13.36	14.79	11.40	11.85	12.47	12.93	14.36
	8H	11.98	12.40	13.05	13.47	14.91	11.54	11.96	12.61	13.03	14.48
	12H	12.05	12.43	13.14	13.51	14.96	11.60	11.98	12.69	13.06	14.51
8H	4H	11.52	11.93	12.59	13.00	14.45	11.14	11.56	12.21	12.63	14.07
	6H	12.14	12.48	13.23	13.60	15.04	11.75	12.10	12.85	13.21	14.65
	8H	12.36	12.66	13.46	13.75	15.21	11.96	12.27	13.06	13.36	14.82
	12H	12.48	12.75	13.58	13.84	15.34	12.07	12.34	13.17	13.43	14.93
12H	4H	11.50	11.87	12.59	12.96	14.41	11.13	11.51	12.22	12.59	14.04
	6H	12.17	12.47	13.27	13.57	15.03	11.79	12.10	12.89	13.19	14.65
	8H	12.40	12.67	13.50	13.76	15.26	12.02	12.29	13.12	13.38	14.88

END OF REPORT