

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902249

Luminaire Tested: DFN2DIP-4P3F0-050D050US830-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902249
REPORT IS A COMBINATION OF REPORTS P900586 AND P897473
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-050D050US830-RLLONL
Description: 3 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8671.4 lumens
Efficiency: N/A
Efficacy: 99.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 87
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902249

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US830-RLLONL

Luminous Intensity Polar Plot

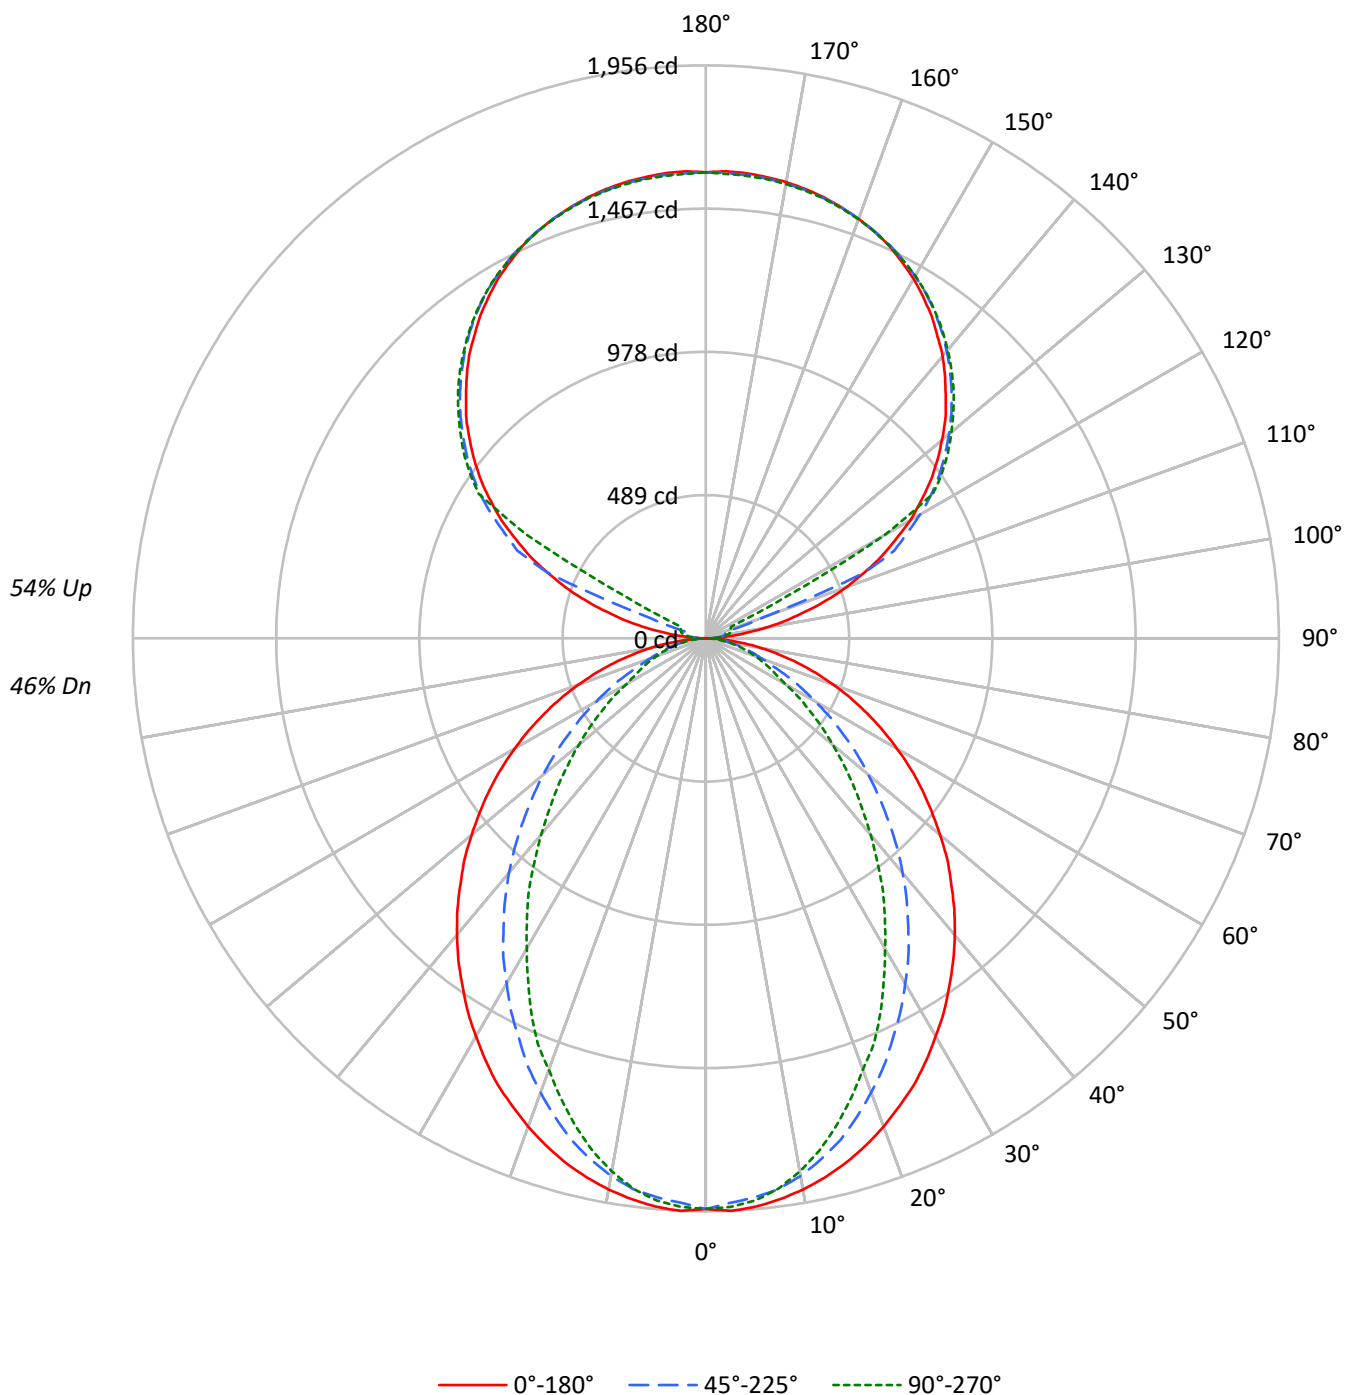

TEST NUMBER: P902249

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US830-RLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2220	2220	2220
5°	2222	2183	2198
10°	2198	2139	2125
15°	2167	2067	2014
20°	2125	1968	1878
25°	2083	1857	1746
30°	2026	1744	1580
35°	1971	1623	1434
40°	1914	1497	1266
45°	1849	1358	1114
50°	1781	1218	966
55°	1710	1068	823
60°	1628	912	677
65°	1533	753	609
70°	1418	605	550
75°	1273	530	499
80°	1064	440	430
85°	722	287	319

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1849 cd/sqm

TEST NUMBER: P902249

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.5	2.1
10°-20°	501.1	5.8
20°-30°	703.6	8.1
30°-40°	766.9	8.8
40°-50°	704.9	8.1
50°-60°	553.6	6.4
60°-70°	360.3	4.2
70°-80°	185.5	2.1
80°-90°	50.2	0.6
90°-100°	52.5	0.6
100°-110°	195.5	2.3
110°-120°	518.5	6.0
120°-130°	860.0	9.9
130°-140°	913.5	10.5
140°-150°	849.0	9.8
150°-160°	682.6	7.9
160°-170°	439.8	5.1
170°-180°	151.4	1.7
0°-30°	1387.2	16.0
0°-40°	2154.2	24.8
0°-60°	3412.7	39.4
0°-90°	4008.6	46.2
90°-120°	766.5	8.8
90°-150°	3389.0	39.1
90°-180°	4663.0	53.8
0°-180°	8671.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1948	1948	1948	1948	1948	
5°	1948	1939	1916	1932	1927	185
15°	1853	1833	1773	1740	1722	522
25°	1682	1625	1509	1437	1410	773
35°	1449	1359	1204	1093	1054	907
45°	1185	1066	881	756	714	915
55°	901	763	573	467	434	805
65°	608	465	307	247	242	603
75°	324	201	141	129	127	343
85°	76	39	34	34	34	87
90°	1	14	23	29	31	8
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P902249

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1947.8	1947.8	1947.8	1947.8	1947.8
2.5°	1956.5	1947.8	1928.3	1946.1	1942.5
5°	1947.8	1939.0	1916.0	1931.8	1926.7
7.5°	1931.8	1921.4	1896.7	1903.7	1894.8
10°	1910.7	1898.4	1863.2	1857.8	1847.3
12.5°	1884.3	1868.5	1820.8	1810.3	1790.8
15°	1852.6	1833.2	1773.3	1739.8	1722.2
17.5°	1815.5	1787.3	1713.3	1674.5	1646.2
20°	1773.3	1738.0	1649.8	1605.9	1567.0
22.5°	1727.5	1686.9	1584.6	1524.8	1498.4
25°	1681.6	1625.1	1508.8	1436.6	1410.0
27.5°	1627.0	1567.0	1438.3	1355.5	1314.9
30°	1568.9	1501.8	1360.7	1270.9	1223.2
32.5°	1512.4	1431.3	1286.9	1181.0	1136.9
35°	1449.0	1359.1	1204.0	1092.9	1054.0
37.5°	1387.2	1290.2	1126.4	1004.7	960.7
40°	1322.0	1216.4	1045.2	920.1	874.3
42.5°	1255.1	1142.3	964.2	833.7	789.8
45°	1184.6	1066.4	881.4	756.1	713.8
47.5°	1117.6	992.5	802.1	676.8	638.1
50°	1043.6	918.4	724.5	602.8	565.9
52.5°	971.2	839.0	650.4	534.1	500.7
55°	900.7	763.2	572.8	467.1	433.7
57.5°	828.5	687.5	504.2	405.5	377.2
60°	754.4	613.4	431.8	342.0	313.8
62.5°	682.2	541.2	370.1	285.6	271.5
65°	608.1	465.3	306.7	246.9	241.5
67.5°	537.6	394.8	246.9	216.8	211.5
70°	463.6	326.1	204.4	186.8	179.7
72.5°	393.1	262.6	171.0	156.9	153.4
75°	324.3	200.9	141.0	128.7	127.0
77.5°	255.6	142.7	111.1	104.0	100.4
80°	192.1	102.3	84.5	77.6	77.6
82.5°	133.9	68.8	58.2	54.6	54.6
85°	75.8	38.7	33.5	33.5	33.5
87.5°	28.3	14.0	14.0	12.3	12.3
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9



TEST NUMBER: P902249

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P902249

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.52	10.32	10.52	11.32	12.65	5.48	6.28	6.48	7.28	8.61
	3H	11.19	11.91	12.20	12.92	14.27	6.66	7.38	7.67	8.39	9.74
	4H	11.80	12.47	12.81	13.49	14.84	7.11	7.78	8.13	8.80	10.15
	6H	12.21	12.84	13.24	13.85	15.22	7.42	8.04	8.45	9.06	10.43
	8H	12.34	12.93	13.37	13.96	15.33	7.51	8.10	8.54	9.13	10.50
	12H	12.39	12.96	13.43	13.99	15.37	7.55	8.11	8.59	9.14	10.53
4H	2H	9.53	10.21	10.56	11.23	12.58	6.07	6.75	7.10	7.76	9.12
	3H	11.35	11.92	12.39	12.96	14.33	7.41	7.97	8.44	9.02	10.39
	4H	12.04	12.56	13.08	13.59	14.98	7.95	8.47	8.99	9.50	10.89
	6H	12.55	12.99	13.60	14.05	15.44	8.36	8.81	9.41	9.86	11.25
	8H	12.72	13.14	13.77	14.19	15.59	8.49	8.90	9.54	9.95	11.35
	12H	12.81	13.19	13.88	14.25	15.66	8.55	8.92	9.62	9.99	11.39
8H	4H	12.01	12.42	13.06	13.47	14.87	8.23	8.64	9.28	9.69	11.09
	6H	12.57	12.91	13.64	14.00	15.40	8.74	9.08	9.81	10.17	11.57
	8H	12.78	13.08	13.86	14.16	15.57	8.92	9.22	10.00	10.30	11.72
	12H	12.91	13.18	14.00	14.25	15.71	9.04	9.30	10.12	10.37	11.83
12H	4H	11.96	12.33	13.03	13.39	14.80	8.23	8.60	9.30	9.67	11.08
	6H	12.54	12.84	13.62	13.92	15.34	8.78	9.08	9.87	10.16	11.58
	8H	12.76	13.02	13.84	14.09	15.55	8.99	9.25	10.07	10.32	11.78

END OF REPORT