

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902254

Luminaire Tested: DFN2DIP-4P3F0-060D020US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902254
REPORT IS A COMBINATION OF REPORTS P899037 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-060D020US830-FLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7267.0 lumens
Efficiency: N/A
Efficacy: 93.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 77.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902254

CATALOG NUMBER: DFN2DIP-4P3F0-060D020US830-FLLFLL

Luminous Intensity Polar Plot

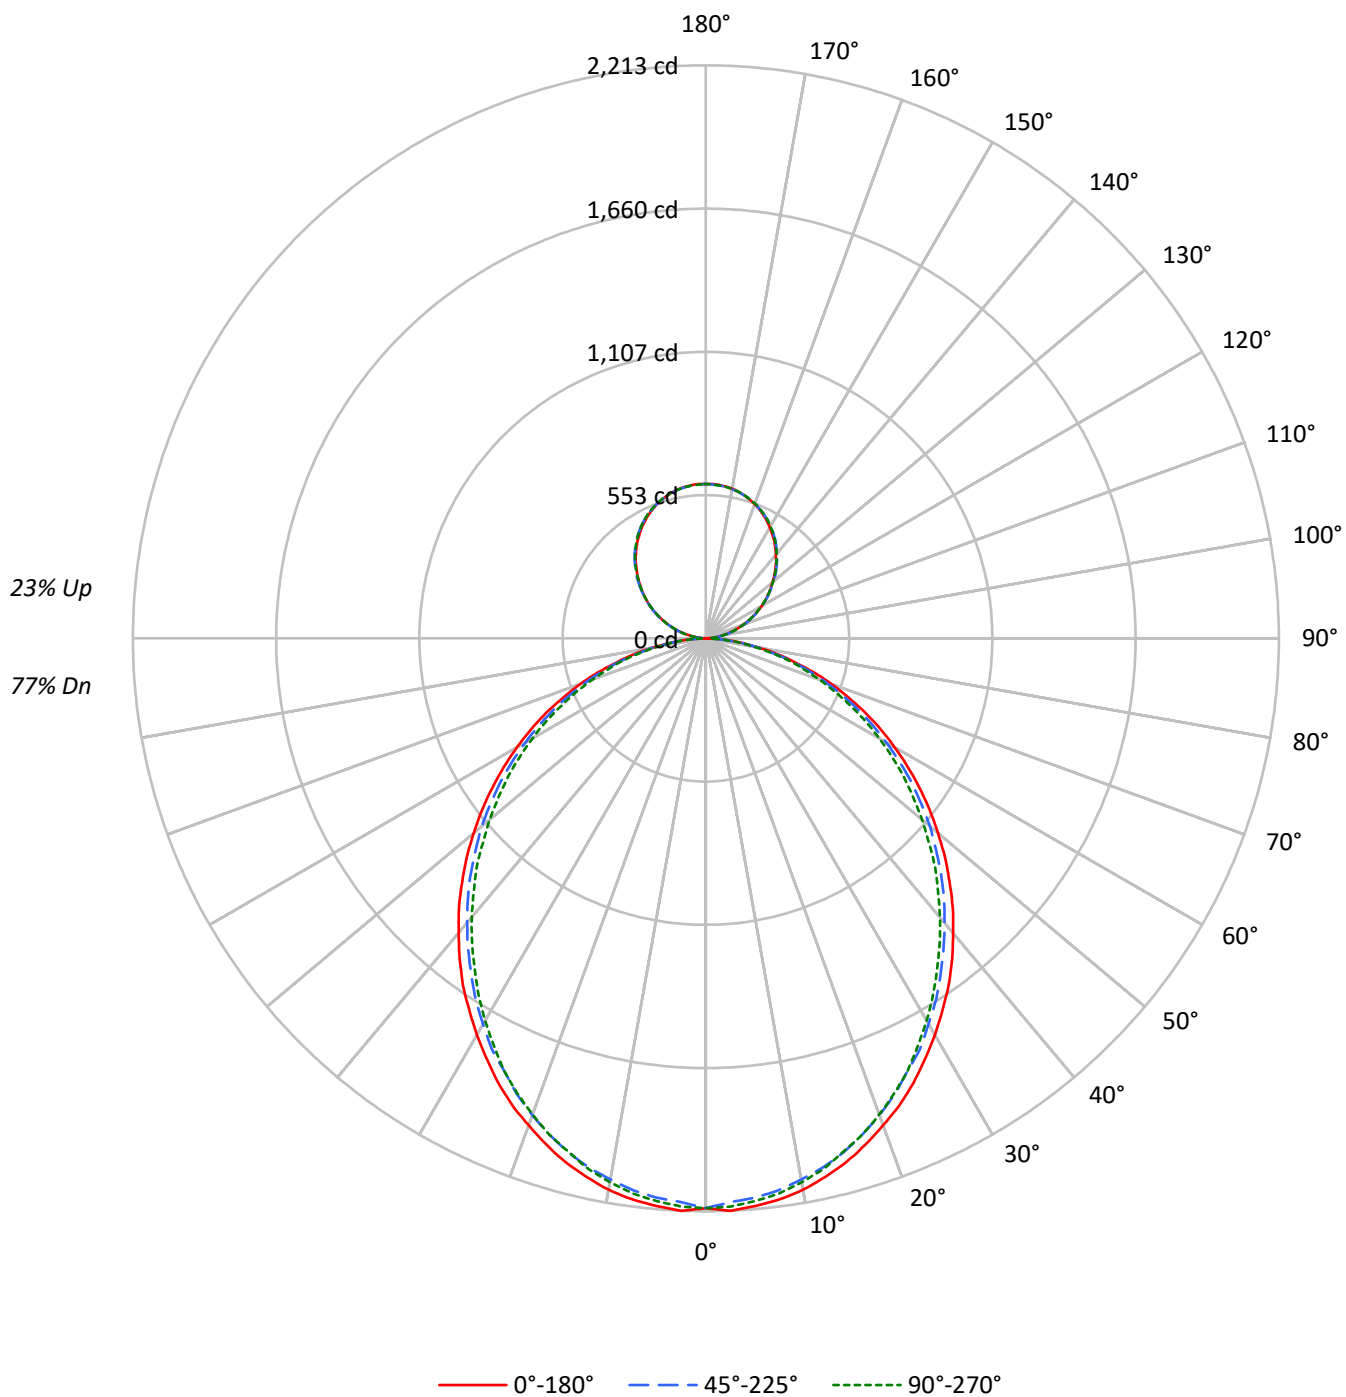

TEST NUMBER: P902254

CATALOG NUMBER: DFN2DIP-4P3F0-060D020US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	114	114	114	114	108	108	108	108	98	98	98	89	89	89	81	81	81
1	104	99	95	92	99	95	91	88	86	84	81	79	77	75	72	70	68
2	95	87	80	75	90	83	77	72	76	71	67	69	66	62	63	60	58
3	86	76	69	63	82	73	66	61	67	61	57	61	57	53	56	52	49
4	79	68	59	53	75	65	57	52	60	53	48	55	50	45	50	46	42
5	73	61	52	46	69	58	50	44	53	47	42	49	44	39	45	41	37
6	67	55	46	40	64	52	45	39	48	42	37	45	39	35	41	36	33
7	62	49	41	35	59	48	40	34	44	37	33	41	35	31	37	33	29
8	58	45	37	31	55	43	36	31	40	34	29	37	32	28	34	30	26
9	54	41	33	28	52	40	32	27	37	31	26	34	29	25	32	27	24
10	51	38	30	25	48	37	30	25	34	28	24	32	26	23	30	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2508	2508	2508
5°	2510	2471	2489
10°	2488	2436	2454
15°	2450	2394	2401
20°	2399	2337	2346
25°	2348	2269	2283
30°	2285	2205	2203
35°	2225	2130	2118
40°	2151	2055	2038
45°	2078	1979	1955
50°	1997	1899	1860
55°	1912	1807	1772
60°	1817	1698	1671
65°	1712	1584	1552
70°	1579	1446	1424
75°	1395	1280	1304
80°	1173	1068	1078
85°	825	708	706

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2078 cd/sqm

TEST NUMBER: P902254

CATALOG NUMBER: DFN2DIP-4P3F0-060D020US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.9
10°-20°	582.7	8.0
20°-30°	856.4	11.8
30°-40°	994.6	13.7
40°-50°	993.4	13.7
50°-60°	866.2	11.9
60°-70°	640.3	8.8
70°-80°	362.3	5.0
80°-90°	97.3	1.3
90°-100°	36.9	0.5
100°-110°	117.2	1.6
110°-120°	200.6	2.8
120°-130°	263.8	3.6
130°-140°	296.1	4.1
140°-150°	290.4	4.0
150°-160°	243.6	3.4
160°-170°	161.5	2.2
170°-180°	56.5	0.8
0°-30°	1646.2	22.7
0°-40°	2640.9	36.3
0°-60°	4500.5	61.9
0°-90°	5600.4	77.1
90°-120°	354.7	4.9
90°-150°	1205.0	16.6
90°-180°	1667.0	22.9
0°-180°	7267.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	6	18	16	17	7
95°	26	31	32	32	31	29
105°	108	110	111	112	112	114
115°	201	204	203	203	201	199
125°	293	297	296	294	294	262
135°	379	384	385	385	383	293
145°	460	463	466	467	465	287
155°	526	527	529	531	530	242
165°	572	571	571	575	572	161
175°	595	594	593	596	593	57
180°	596	596	596	596	596	

TEST NUMBER: P902254

CATALOG NUMBER: DFN2DIP-4P3F0-060D020US830-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	0.6	6.5	17.6	16.5	17.1
92.5°	11.1	15.1	15.6	16.2	16.2
95°	26.2	31.3	32.1	32.1	31.3
97.5°	43.6	48.4	50.3	50.3	50.3
100°	63.8	68.0	69.4	69.4	68.8
102.5°	85.0	88.0	90.0	90.6	90.0
105°	108.2	109.6	110.7	111.6	111.6
107.5°	131.2	133.4	133.4	133.7	131.2
110°	153.5	156.4	156.4	156.4	155.0

TEST NUMBER: P902254

CATALOG NUMBER: DFN2DIP-4P3F0-060D020US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	177.6	180.6	180.1	178.6	177.6
115°	201.3	204.2	203.3	202.7	201.3
117.5°	224.9	228.8	226.3	224.9	223.4
120°	248.5	252.5	248.5	248.5	246.9
122.5°	270.1	275.1	272.7	271.3	270.1
125°	292.8	297.3	295.9	294.3	293.7
127.5°	314.9	320.5	318.5	316.3	314.9
130°	335.5	342.0	341.1	340.1	338.1
132.5°	358.7	363.8	364.1	361.7	360.1
135°	378.7	384.3	385.3	384.8	383.3
137.5°	401.0	405.5	406.4	406.0	403.9
140°	420.6	425.1	427.6	427.6	425.7
142.5°	440.7	445.2	446.7	447.1	445.2
145°	459.8	463.4	466.3	466.7	464.8
147.5°	476.8	481.4	483.5	484.4	482.4
150°	494.5	497.5	499.5	501.1	499.5
152.5°	510.1	513.1	515.7	517.6	515.7
155°	525.8	527.2	528.8	531.3	529.7
157.5°	539.2	540.3	541.2	544.8	542.2
160°	551.3	552.3	552.9	555.9	553.7
162.5°	562.4	562.4	562.9	566.4	563.8
165°	571.9	571.4	571.4	575.0	572.5
167.5°	580.5	578.9	578.9	582.5	580.0
170°	587.0	585.6	585.0	588.6	585.6
172.5°	591.5	590.0	589.6	593.1	590.0
175°	595.1	593.7	592.6	596.2	593.1
177.5°	597.1	595.7	594.6	597.6	594.6
180°	596.2	596.2	596.2	596.2	596.2

TEST NUMBER: P902254

CATALOG NUMBER: DFN2DIP-4P3F0-060D020US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.63	13.80	13.32	14.50	15.33	12.19	13.36	12.87	14.06	14.88
	3H	14.31	15.36	15.01	16.07	16.93	13.82	14.87	14.52	15.58	16.44
	4H	14.91	15.90	15.62	16.62	17.49	14.41	15.41	15.13	16.13	17.00
	6H	15.32	16.24	16.05	16.97	17.85	14.82	15.74	15.55	16.47	17.35
	8H	15.43	16.31	16.17	17.06	17.95	14.93	15.81	15.67	16.56	17.44
	12H	15.49	16.32	16.23	17.07	17.98	14.98	15.81	15.73	16.56	17.47
4H	2H	13.12	14.12	13.84	14.84	15.71	12.77	13.76	13.49	14.49	15.36
	3H	15.01	15.84	15.74	16.60	17.49	14.60	15.44	15.34	16.19	17.08
	4H	15.74	16.49	16.48	17.25	18.17	15.31	16.07	16.06	16.83	17.74
	6H	16.26	16.92	17.03	17.70	18.63	15.83	16.49	16.60	17.27	18.20
	8H	16.42	17.03	17.19	17.81	18.75	15.98	16.59	16.75	17.38	18.31
	12H	16.50	17.05	17.30	17.86	18.80	16.06	16.61	16.85	17.41	18.35
8H	4H	15.95	16.56	16.72	17.35	18.28	15.58	16.19	16.35	16.97	17.91
	6H	16.59	17.10	17.39	17.92	18.86	16.21	16.71	17.01	17.54	18.48
	8H	16.81	17.26	17.62	18.09	19.04	16.42	16.87	17.23	17.69	18.65
	12H	16.95	17.35	17.77	18.17	19.18	16.54	16.94	17.36	17.75	18.77
12H	4H	15.95	16.50	16.74	17.31	18.25	15.58	16.13	16.38	16.94	17.88
	6H	16.62	17.07	17.43	17.90	18.85	16.25	16.70	17.06	17.52	18.48
	8H	16.87	17.27	17.69	18.09	19.10	16.49	16.89	17.31	17.71	18.72

END OF REPORT