

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904987

Luminaire Tested: DFN2DIP-4P3F0-060D030US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904987
REPORT IS A COMBINATION OF REPORTS P900567 AND P897473
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-060D030US835-FLLONL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8910.0 lumens
Efficiency: N/A
Efficacy: 105.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 84.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904987

CATALOG NUMBER: DFN2DIP-4P3F0-060D030US835-FLLONL

Luminous Intensity Polar Plot

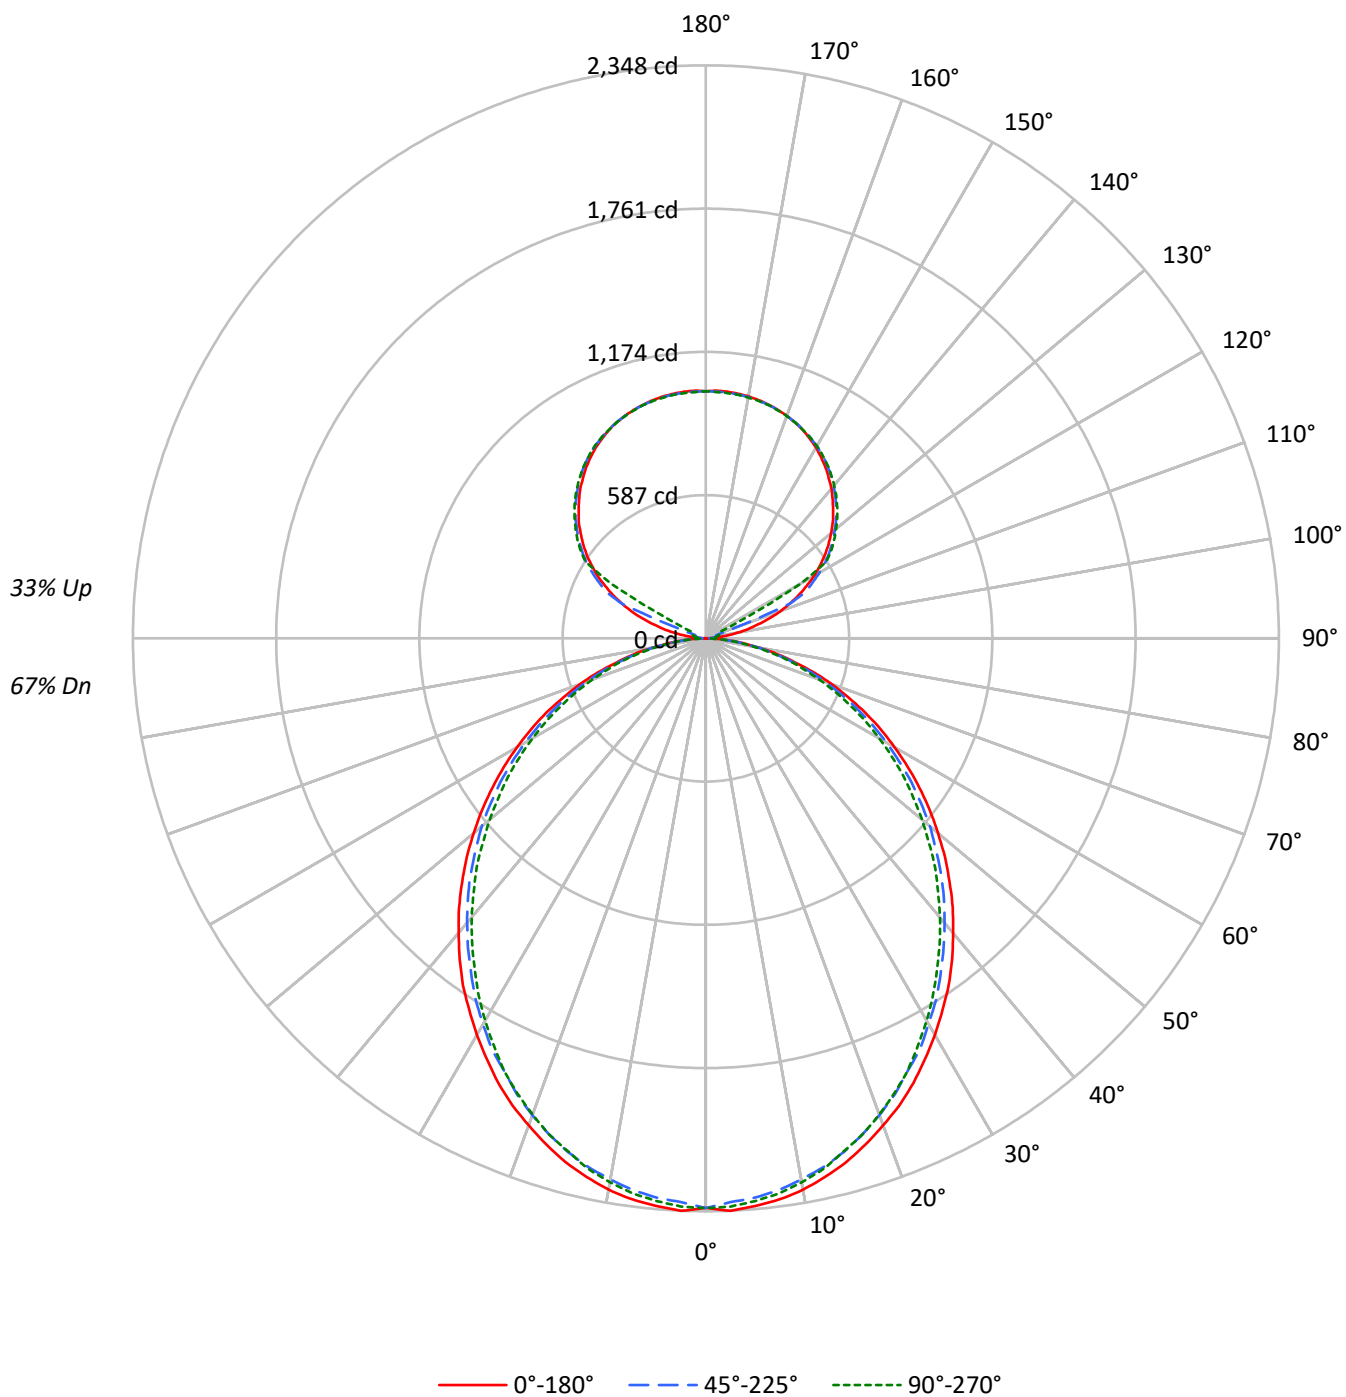

TEST NUMBER: P904987

CATALOG NUMBER: DFN2DIP-4P3F0-060D030US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	71	71	71
1	102	97	93	90	95	92	88	85	81	79	76	72	70	68	63	62	60
2	92	85	79	73	87	80	75	70	71	67	63	63	60	57	56	53	51
3	84	75	67	61	79	71	64	58	63	58	53	56	52	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	33
6	66	53	45	39	62	50	43	37	45	39	34	41	35	32	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	26
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	50	38	31	26	35	29	24	31	26	23	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2661	2661	2661
5°	2663	2622	2640
10°	2640	2585	2604
15°	2599	2540	2547
20°	2545	2480	2489
25°	2491	2407	2422
30°	2424	2340	2337
35°	2360	2260	2247
40°	2282	2180	2162
45°	2204	2099	2074
50°	2119	2015	1973
55°	2029	1917	1880
60°	1928	1801	1773
65°	1817	1681	1647
70°	1675	1534	1511
75°	1480	1358	1384
80°	1244	1133	1144
85°	876	751	749

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2204 cd/sqm

TEST NUMBER: P904987

CATALOG NUMBER: DFN2DIP-4P3F0-060D030US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	2.5
10°-20°	618.3	6.9
20°-30°	908.6	10.2
30°-40°	1055.3	11.8
40°-50°	1054.0	11.8
50°-60°	919.0	10.3
60°-70°	679.4	7.6
70°-80°	384.4	4.3
80°-90°	103.2	1.2
90°-100°	33.4	0.4
100°-110°	124.4	1.4
110°-120°	330.1	3.7
120°-130°	547.5	6.1
130°-140°	581.5	6.5
140°-150°	540.5	6.1
150°-160°	434.5	4.9
160°-170°	280.0	3.1
170°-180°	96.4	1.1
0°-30°	1746.6	19.6
0°-40°	2801.8	31.4
0°-60°	4774.8	53.6
0°-90°	5941.8	66.7
90°-120°	487.9	5.5
90°-150°	2157.3	24.2
90°-180°	2968.0	33.3
0°-180°	8910.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	1	9	15	18	20	8
95°	48	23	28	32	32	56
105°	223	245	45	53	56	238
115°	421	434	452	113	60	415
125°	596	605	619	624	626	531
135°	737	749	755	763	761	569
145°	855	854	867	872	868	535
155°	941	935	944	948	942	434
165°	992	988	990	995	990	280
175°	1015	1010	1011	1016	1009	97
180°	1012	1012	1012	1012	1012	

TEST NUMBER: P904987

CATALOG NUMBER: DFN2DIP-4P3F0-060D030US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	0.7	8.8	14.6	18.4	19.7
92.5°	18.4	15.4	17.6	19.1	19.7
95°	47.6	23.4	28.5	32.3	31.5
97.5°	85.7	25.7	37.3	39.6	40.3
100°	129.7	29.3	41.8	47.6	49.1
102.5°	178.0	176.6	43.2	51.2	53.5
105°	222.7	244.7	44.7	52.7	55.7
107.5°	274.7	293.0	46.2	54.2	57.2
110°	324.6	339.9	128.2	55.0	57.9



TEST NUMBER: P904987

CATALOG NUMBER: DFN2DIP-4P3F0-060D030US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	371.5	384.6	372.2	56.4	58.6
115°	421.2	433.7	452.0	112.8	60.1
117.5°	464.5	479.1	491.6	386.8	194.9
120°	512.8	523.8	537.0	545.8	446.9
122.5°	553.8	565.6	580.3	584.6	585.4
125°	595.6	605.1	619.1	624.2	626.4
127.5°	633.7	643.9	655.0	662.3	663.0
130°	669.6	681.4	689.4	697.4	696.8
132.5°	706.2	715.8	723.8	730.4	729.7
135°	737.0	748.8	755.3	762.7	761.2
137.5°	769.2	778.0	785.4	792.7	790.5
140°	800.7	806.6	814.6	821.2	817.6
142.5°	827.2	832.3	841.8	847.6	844.0
145°	855.0	854.2	866.7	871.8	868.1
147.5°	879.1	876.9	889.4	893.0	890.1
150°	902.6	897.5	909.2	913.5	909.9
152.5°	922.3	916.5	927.5	931.9	926.8
155°	941.4	934.9	943.6	948.0	942.2
157.5°	956.8	951.0	957.6	962.7	956.8
160°	970.0	965.6	970.0	974.4	969.2
162.5°	981.7	977.3	981.0	986.1	979.5
165°	991.9	987.6	989.8	994.9	989.8
167.5°	1000.0	995.6	997.8	1003.0	996.4
170°	1006.6	1002.2	1003.7	1008.8	1002.2
172.5°	1011.0	1006.6	1008.1	1013.2	1006.6
175°	1014.6	1009.5	1011.0	1016.1	1008.8
177.5°	1016.1	1011.0	1011.8	1016.9	1010.3
180°	1012.5	1012.5	1012.5	1012.5	1012.5

TEST NUMBER: P904987

CATALOG NUMBER: DFN2DIP-4P3F0-060D030US835-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.05	13.09	12.85	13.91	14.92	11.61	12.64	12.41	13.46	14.47
	3H	13.72	14.65	14.53	15.48	16.52	13.23	14.16	14.04	14.99	16.03
	4H	14.31	15.19	15.14	16.03	17.08	13.82	14.70	14.65	15.54	16.59
	6H	14.72	15.53	15.56	16.37	17.44	14.22	15.03	15.06	15.87	16.94
	8H	14.83	15.60	15.68	16.46	17.53	14.32	15.10	15.17	15.96	17.03
	12H	14.88	15.61	15.73	16.47	17.56	14.37	15.10	15.23	15.96	17.05
4H	2H	12.53	13.41	13.36	14.25	15.30	12.17	13.05	13.01	13.89	14.94
	3H	14.41	15.14	15.25	16.01	17.08	14.00	14.73	14.84	15.60	16.67
	4H	15.12	15.79	15.98	16.66	17.75	14.70	15.37	15.56	16.24	17.33
	6H	15.64	16.22	16.52	17.11	18.21	15.21	15.79	16.09	16.68	17.78
	8H	15.79	16.33	16.67	17.22	18.33	15.36	15.90	16.24	16.79	17.90
	12H	15.87	16.36	16.77	17.27	18.38	15.43	15.91	16.32	16.82	17.94
8H	4H	15.33	15.87	16.21	16.76	17.87	14.95	15.49	15.83	16.38	17.49
	6H	15.96	16.41	16.87	17.34	18.45	15.58	16.02	16.48	16.96	18.07
	8H	16.18	16.58	17.10	17.50	18.63	15.79	16.18	16.70	17.11	18.23
	12H	16.32	16.67	17.24	17.58	18.76	15.91	16.26	16.82	17.17	18.35
12H	4H	15.32	15.81	16.22	16.72	17.83	14.95	15.44	15.85	16.35	17.46
	6H	15.99	16.39	16.91	17.31	18.44	15.62	16.02	16.53	16.94	18.07
	8H	16.24	16.59	17.16	17.50	18.68	15.86	16.21	16.78	17.12	18.30