

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907676

Luminaire Tested: DFN2DIP-4P3F0-040D030US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907676
REPORT IS A COMBINATION OF REPORTS P899044 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-040D030US840-RLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6114.7 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 59.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907676

CATALOG NUMBER: DFN2DIP-4P3F0-040D030US840-RLLFLL

Luminous Intensity Polar Plot

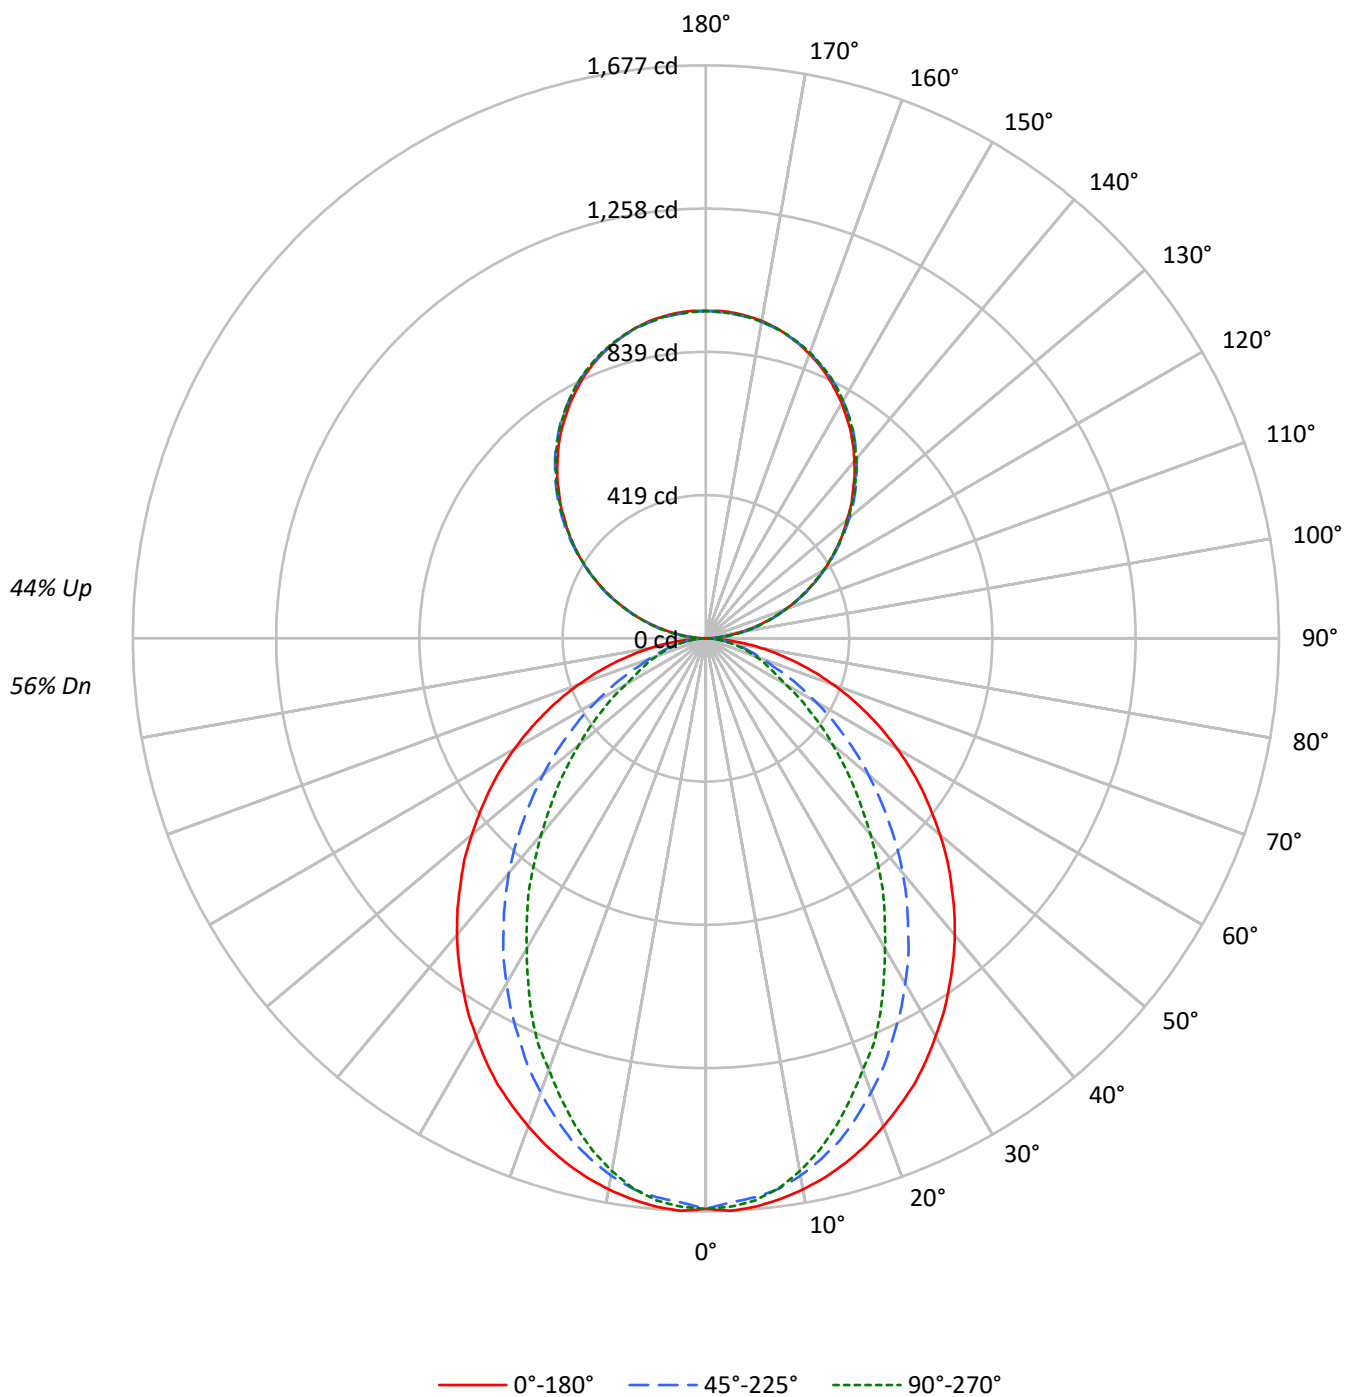

TEST NUMBER: P907676

CATALOG NUMBER: DFN2DIP-4P3F0-040D030US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	55	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	49	47	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	30
6	65	53	46	40	61	50	43	38	44	38	34	38	34	31	33	30	27
7	61	48	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1903	1903	1903
5°	1904	1871	1884
10°	1884	1833	1822
15°	1857	1771	1727
20°	1822	1687	1610
25°	1785	1592	1497
30°	1737	1495	1354
35°	1689	1391	1229
40°	1641	1283	1085
45°	1585	1164	955
50°	1526	1044	828
55°	1466	915	706
60°	1395	781	580
65°	1314	645	522
70°	1215	518	471
75°	1091	454	428
80°	912	377	369
85°	619	246	274

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1585 cd/sqm

TEST NUMBER: P907676

CATALOG NUMBER: DFN2DIP-4P3F0-040D030US840-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.5	2.6
10°-20°	429.5	7.0
20°-30°	603.0	9.9
30°-40°	657.4	10.8
40°-50°	604.2	9.9
50°-60°	474.5	7.8
60°-70°	308.9	5.1
70°-80°	159.0	2.6
80°-90°	43.3	0.7
90°-100°	59.3	1.0
100°-110°	188.4	3.1
110°-120°	322.4	5.3
120°-130°	424.0	6.9
130°-140°	475.9	7.8
140°-150°	466.7	7.6
150°-160°	391.5	6.4
160°-170°	259.6	4.2
170°-180°	90.7	1.5
0°-30°	1189.0	19.4
0°-40°	1846.4	30.2
0°-60°	2925.1	47.8
0°-90°	3436.3	56.2
90°-120°	570.1	9.3
90°-150°	1936.6	31.7
90°-180°	2678.0	43.8
0°-180°	6114.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1670	1670	1670	1670	1670	
5°	1670	1662	1642	1656	1651	158
15°	1588	1571	1520	1491	1476	447
25°	1441	1393	1293	1231	1209	663
35°	1242	1165	1032	937	903	777
45°	1015	914	756	648	612	784
55°	772	654	491	400	372	690
65°	521	399	263	212	207	517
75°	278	172	121	110	109	294
85°	65	33	29	29	29	75
90°	1	10	28	27	28	6
95°	42	50	52	52	50	47
105°	174	176	178	179	179	184
115°	324	328	327	326	324	320
125°	471	478	475	473	472	420
135°	609	618	619	618	616	470
145°	739	745	749	750	747	462
155°	845	847	850	854	851	389
165°	919	918	918	924	920	259
175°	956	954	952	958	953	91
180°	958	958	958	958	958	

TEST NUMBER: P907676

CATALOG NUMBER: DFN2DIP-4P3F0-040D030US840-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1669.5	1669.5	1669.5	1669.5	1669.5
2.5°	1677.1	1669.5	1652.8	1668.1	1665.0
5°	1669.5	1661.9	1642.2	1655.9	1651.4
7.5°	1655.9	1646.9	1625.8	1631.6	1624.2
10°	1637.8	1627.2	1597.0	1592.4	1583.5
12.5°	1615.2	1601.5	1560.6	1551.7	1535.0
15°	1587.9	1571.2	1519.9	1491.3	1476.2
17.5°	1556.2	1532.0	1468.4	1435.3	1411.1
20°	1519.9	1489.7	1414.1	1376.4	1343.1
22.5°	1480.7	1445.9	1358.2	1306.9	1284.3
25°	1441.4	1393.0	1293.2	1231.4	1208.6
27.5°	1394.6	1343.1	1232.8	1161.9	1127.0
30°	1344.7	1287.2	1166.3	1089.3	1048.5
32.5°	1296.4	1226.8	1103.0	1012.3	974.4
35°	1242.0	1164.9	1032.0	936.8	903.4
37.5°	1189.1	1105.9	965.4	861.1	823.4
40°	1133.2	1042.6	896.0	788.7	749.4
42.5°	1075.7	979.1	826.5	714.6	676.9
45°	1015.3	914.0	755.5	648.1	611.9
47.5°	958.0	850.7	687.5	580.2	546.9
50°	894.4	787.2	621.0	516.6	485.0
52.5°	832.4	719.1	557.5	457.8	429.1
55°	772.0	654.2	491.0	400.4	371.7
57.5°	710.1	589.3	432.1	347.5	323.4
60°	646.6	525.7	370.1	293.2	269.0
62.5°	584.8	463.9	317.2	244.8	232.8
65°	521.3	398.8	262.9	211.6	206.9
67.5°	460.9	338.4	211.6	185.8	181.3
70°	397.4	279.5	175.2	160.2	154.0
72.5°	337.0	225.1	146.5	134.5	131.5
75°	277.9	172.2	120.9	110.3	108.9
77.5°	219.1	122.3	95.2	89.2	86.0
80°	164.6	87.7	72.4	66.6	66.6
82.5°	114.8	59.0	49.9	46.8	46.8
85°	64.9	33.2	28.7	28.7	28.7
87.5°	24.2	12.0	12.0	10.6	10.6
90°	0.9	10.4	28.3	26.6	27.5
92.5°	17.9	24.2	25.1	26.0	26.0
95°	42.2	50.3	51.7	51.7	50.3
97.5°	70.2	77.7	80.9	80.9	80.9
100°	102.5	109.2	111.5	111.5	110.7
102.5°	136.6	141.6	144.7	145.6	144.7
105°	173.9	176.2	177.9	179.4	179.4
107.5°	210.9	214.3	214.3	214.9	210.9
110°	246.7	251.4	251.4	251.4	249.0

TEST NUMBER: P907676

CATALOG NUMBER: DFN2DIP-4P3F0-040D030US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	285.4	290.3	289.4	287.1	285.4
115°	323.6	328.1	326.7	325.9	323.6
117.5°	361.3	367.7	363.7	361.3	359.0
120°	399.5	405.9	399.5	399.5	396.9
122.5°	434.1	442.2	438.2	435.9	434.1
125°	470.6	477.8	475.4	472.8	472.0
127.5°	506.0	515.0	511.9	508.4	506.0
130°	539.3	549.7	548.3	546.5	543.3
132.5°	576.5	584.6	585.2	581.2	578.9
135°	608.6	617.5	619.4	618.4	616.1
137.5°	644.4	651.7	653.1	652.6	649.0
140°	675.9	683.2	687.2	687.2	684.0
142.5°	708.3	715.5	717.8	718.7	715.5
145°	738.9	744.7	749.3	750.1	747.0
147.5°	766.4	773.6	777.0	778.5	775.3
150°	794.7	799.6	802.7	805.4	802.7
152.5°	819.8	824.7	828.7	831.9	828.7
155°	845.0	847.2	849.8	853.8	851.3
157.5°	866.6	868.3	869.8	875.6	871.5
160°	886.0	887.7	888.6	893.4	890.0
162.5°	903.8	903.8	904.7	910.2	906.2
165°	919.2	918.3	918.3	924.0	920.0
167.5°	933.0	930.4	930.4	936.1	932.1
170°	943.4	941.1	940.3	946.0	941.1
172.5°	950.6	948.4	947.5	953.2	948.4
175°	956.4	954.1	952.4	958.2	953.2
177.5°	959.6	957.3	955.5	960.5	955.5
180°	958.2	958.2	958.2	958.2	958.2

TEST NUMBER: P907676

CATALOG NUMBER: DFN2DIP-4P3F0-040D030US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.91	10.79	10.82	11.71	12.90	5.87	6.75	6.78	7.67	8.86
	3H	11.58	12.37	12.51	13.31	14.51	7.05	7.84	7.98	8.78	9.98
	4H	12.19	12.94	13.13	13.88	15.09	7.50	8.25	8.44	9.19	10.40
	6H	12.61	13.30	13.56	14.24	15.47	7.82	8.51	8.77	9.45	10.68
	8H	12.74	13.39	13.69	14.35	15.58	7.91	8.56	8.86	9.52	10.75
	12H	12.80	13.42	13.76	14.38	15.63	7.95	8.57	8.91	9.53	10.78
4H	2H	9.93	10.68	10.87	11.61	12.83	6.47	7.21	7.41	8.15	9.37
	3H	11.76	12.38	12.71	13.35	14.58	7.82	8.44	8.77	9.40	10.63
	4H	12.45	13.02	13.41	13.98	15.23	8.36	8.93	9.32	9.89	11.14
	6H	12.96	13.45	13.94	14.44	15.69	8.78	9.26	9.75	10.25	11.50
	8H	13.14	13.59	14.11	14.57	15.84	8.90	9.36	9.88	10.34	11.60
	12H	13.23	13.64	14.23	14.64	15.91	8.97	9.38	9.96	10.37	11.65
8H	4H	12.42	12.87	13.40	13.85	15.12	8.64	9.10	9.62	10.08	11.34
	6H	12.98	13.36	13.98	14.38	15.65	9.15	9.53	10.15	10.55	11.82
	8H	13.20	13.53	14.21	14.54	15.82	9.34	9.67	10.35	10.68	11.97
	12H	13.33	13.62	14.35	14.63	15.96	9.46	9.75	10.47	10.75	12.08
12H	4H	12.37	12.78	13.37	13.78	15.05	8.65	9.06	9.64	10.05	11.33
	6H	12.96	13.29	13.97	14.30	15.58	9.20	9.53	10.21	10.54	11.83
	8H	13.18	13.47	14.19	14.47	15.80	9.41	9.70	10.42	10.70	12.04

END OF REPORT