

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907722

Luminaire Tested: DFN2DIP-4P3F0-060D050US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907722
REPORT IS A COMBINATION OF REPORTS P899067 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-060D050US840-FLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10467.2 lumens
Efficiency: N/A
Efficacy: 104.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 100.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907722

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US840-FLLFLL

Luminous Intensity Polar Plot

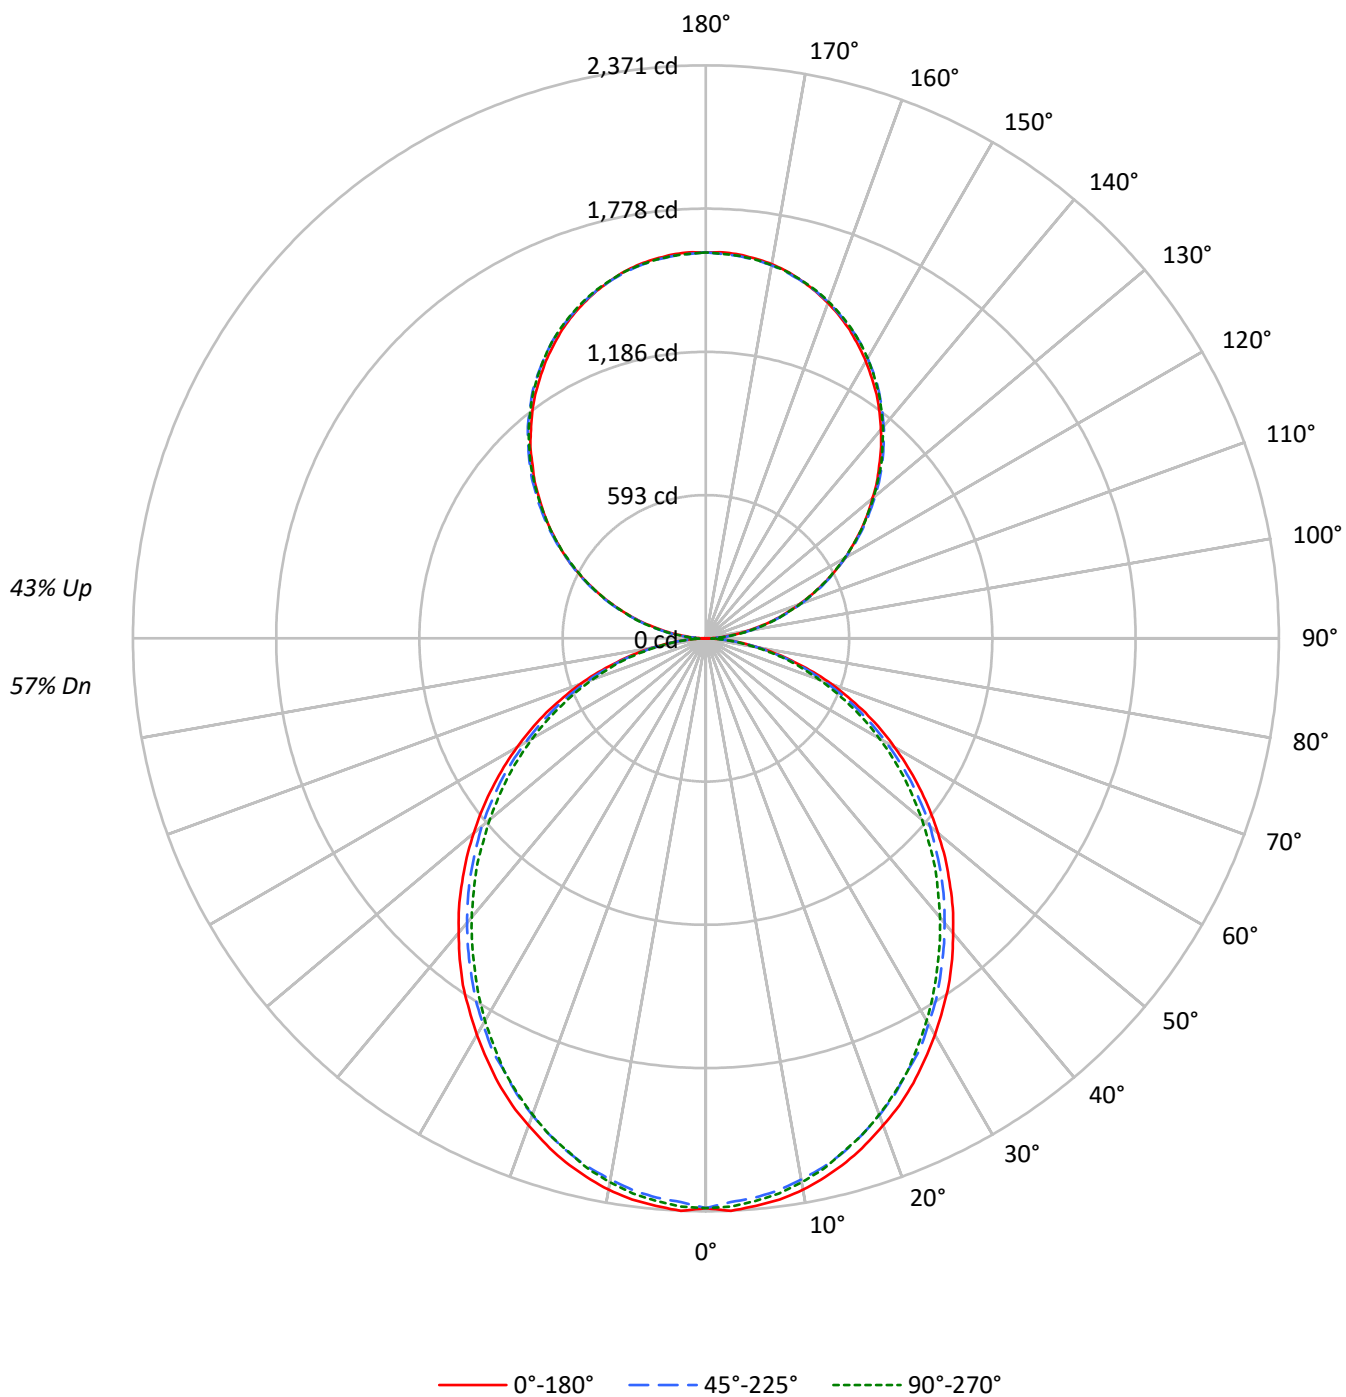

TEST NUMBER: P907722

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	75	75	75	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	56	54	53
2	91	83	77	72	84	78	72	67	67	63	60	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	41	38
4	76	65	57	51	70	61	53	48	53	47	43	46	41	38	39	36	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	23	30	24	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2687	2687	2687
5°	2689	2648	2666
10°	2666	2610	2629
15°	2625	2565	2572
20°	2570	2504	2514
25°	2516	2431	2446
30°	2448	2363	2360
35°	2384	2282	2269
40°	2305	2201	2183
45°	2226	2120	2095
50°	2140	2035	1993
55°	2049	1936	1898
60°	1947	1819	1790
65°	1835	1697	1663
70°	1692	1549	1526
75°	1495	1371	1398
80°	1257	1144	1155
85°	884	758	757

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2226 cd/sqm

TEST NUMBER: P907722

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	2.1
10°-20°	624.4	6.0
20°-30°	917.5	8.8
30°-40°	1065.7	10.2
40°-50°	1064.4	10.2
50°-60°	928.1	8.9
60°-70°	686.1	6.6
70°-80°	388.2	3.7
80°-90°	107.0	1.0
90°-100°	98.8	0.9
100°-110°	314.0	3.0
110°-120°	537.3	5.1
120°-130°	706.6	6.8
130°-140°	793.2	7.6
140°-150°	777.8	7.4
150°-160°	652.5	6.2
160°-170°	432.7	4.1
170°-180°	151.2	1.4
0°-30°	1763.8	16.9
0°-40°	2829.5	27.0
0°-60°	4821.9	46.1
0°-90°	6003.1	57.4
90°-120°	950.1	9.1
90°-150°	3227.7	30.8
90°-180°	4464.0	42.6
0°-180°	10467.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	17	47	44	46	10
95°	70	84	86	86	84	78
105°	290	294	297	299	299	306
115°	539	547	544	543	539	533
125°	784	796	792	788	787	701
135°	1014	1029	1032	1031	1027	784
145°	1232	1241	1249	1250	1245	769
155°	1408	1412	1416	1423	1419	648
165°	1532	1530	1530	1540	1533	432
175°	1594	1590	1587	1597	1589	151
180°	1597	1597	1597	1597	1597	

TEST NUMBER: P907722

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.4	17.4	47.2	44.3	45.7
92.5°	29.9	40.4	41.9	43.3	43.3
95°	70.3	83.8	86.1	86.1	83.8
97.5°	116.9	129.5	134.8	134.8	134.8
100°	170.9	182.0	185.8	185.8	184.4
102.5°	227.7	235.9	241.2	242.7	241.2
105°	289.8	293.7	296.6	298.9	298.9
107.5°	351.4	357.2	357.2	358.2	351.4
110°	411.1	418.9	418.9	418.9	415.0

TEST NUMBER: P907722

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US840-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	475.6	483.8	482.4	478.6	475.6
115°	539.2	546.9	544.5	543.1	539.2
117.5°	602.3	612.9	606.1	602.3	598.4
120°	665.8	676.4	665.8	665.8	661.5
122.5°	723.6	737.1	730.3	726.5	723.6
125°	784.3	796.3	792.4	788.1	786.7
127.5°	843.4	858.4	853.1	847.3	843.4
130°	898.9	916.2	913.7	910.9	905.5
132.5°	961.0	974.4	975.4	968.7	964.8
135°	1014.4	1029.3	1032.2	1030.8	1026.9
137.5°	1074.1	1086.1	1088.5	1087.5	1081.8
140°	1126.5	1138.6	1145.3	1145.3	1140.0
142.5°	1180.4	1192.6	1196.4	1197.8	1192.6
145°	1231.5	1241.1	1248.8	1250.3	1245.0
147.5°	1277.3	1289.3	1295.1	1297.5	1292.1
150°	1324.4	1332.6	1337.9	1342.2	1337.9
152.5°	1366.3	1374.5	1381.2	1386.5	1381.2
155°	1408.2	1412.0	1416.3	1423.1	1418.8
157.5°	1444.3	1447.1	1449.6	1459.3	1452.5
160°	1476.5	1479.5	1480.9	1489.0	1483.3
162.5°	1506.4	1506.4	1507.8	1517.0	1510.3
165°	1532.0	1530.5	1530.5	1540.1	1533.4
167.5°	1555.0	1550.6	1550.6	1560.3	1553.6
170°	1572.4	1568.5	1567.1	1576.7	1568.5
172.5°	1584.4	1580.5	1579.1	1588.7	1580.5
175°	1594.1	1590.1	1587.3	1596.9	1588.7
177.5°	1599.3	1595.5	1592.6	1600.7	1592.6
180°	1596.9	1596.9	1596.9	1596.9	1596.9

TEST NUMBER: P907722

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.32	12.26	12.22	13.17	14.33	10.88	11.81	11.77	12.72	13.88
	3H	12.99	13.82	13.89	14.74	15.93	12.49	13.33	13.40	14.25	15.44
	4H	13.57	14.36	14.49	15.29	16.49	13.08	13.87	14.00	14.80	15.99
	6H	13.97	14.70	14.90	15.63	16.84	13.47	14.20	14.40	15.13	16.34
	8H	14.08	14.77	15.02	15.72	16.93	13.58	14.27	14.51	15.22	16.43
	12H	14.13	14.79	15.07	15.73	16.97	13.62	14.28	14.56	15.22	16.46
4H	2H	11.79	12.58	12.71	13.51	14.70	11.43	12.23	12.36	13.15	14.35
	3H	13.66	14.32	14.59	15.27	16.48	13.25	13.91	14.18	14.87	16.08
	4H	14.37	14.97	15.31	15.92	17.16	13.95	14.55	14.89	15.50	16.74
	6H	14.88	15.40	15.84	16.38	17.62	14.45	14.97	15.41	15.95	17.18
	8H	15.03	15.52	15.99	16.49	17.74	14.60	15.08	15.56	16.05	17.30
	12H	15.11	15.55	16.09	16.53	17.79	14.66	15.10	15.64	16.08	17.34
8H	4H	14.57	15.05	15.53	16.02	17.27	14.19	14.68	15.15	15.65	16.90
	6H	15.20	15.60	16.18	16.61	17.86	14.81	15.21	15.80	16.23	17.47
	8H	15.41	15.77	16.41	16.77	18.04	15.02	15.38	16.02	16.38	17.64
	12H	15.55	15.86	16.54	16.85	18.17	15.14	15.45	16.13	16.44	17.75
12H	4H	14.56	14.99	15.54	15.98	17.24	14.19	14.63	15.17	15.61	16.87
	6H	15.22	15.58	16.22	16.58	17.85	14.85	15.21	15.85	16.21	17.47
	8H	15.47	15.78	16.46	16.77	18.09	15.09	15.40	16.08	16.39	17.70

END OF REPORT