

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918542

Luminaire Tested: DFN2DIP-4P3F0-020D020US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918542
REPORT IS A COMBINATION OF REPORTS P899029 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-020D020US935-FLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3228.7 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 31
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918542

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US935-FLLFLL

Luminous Intensity Polar Plot

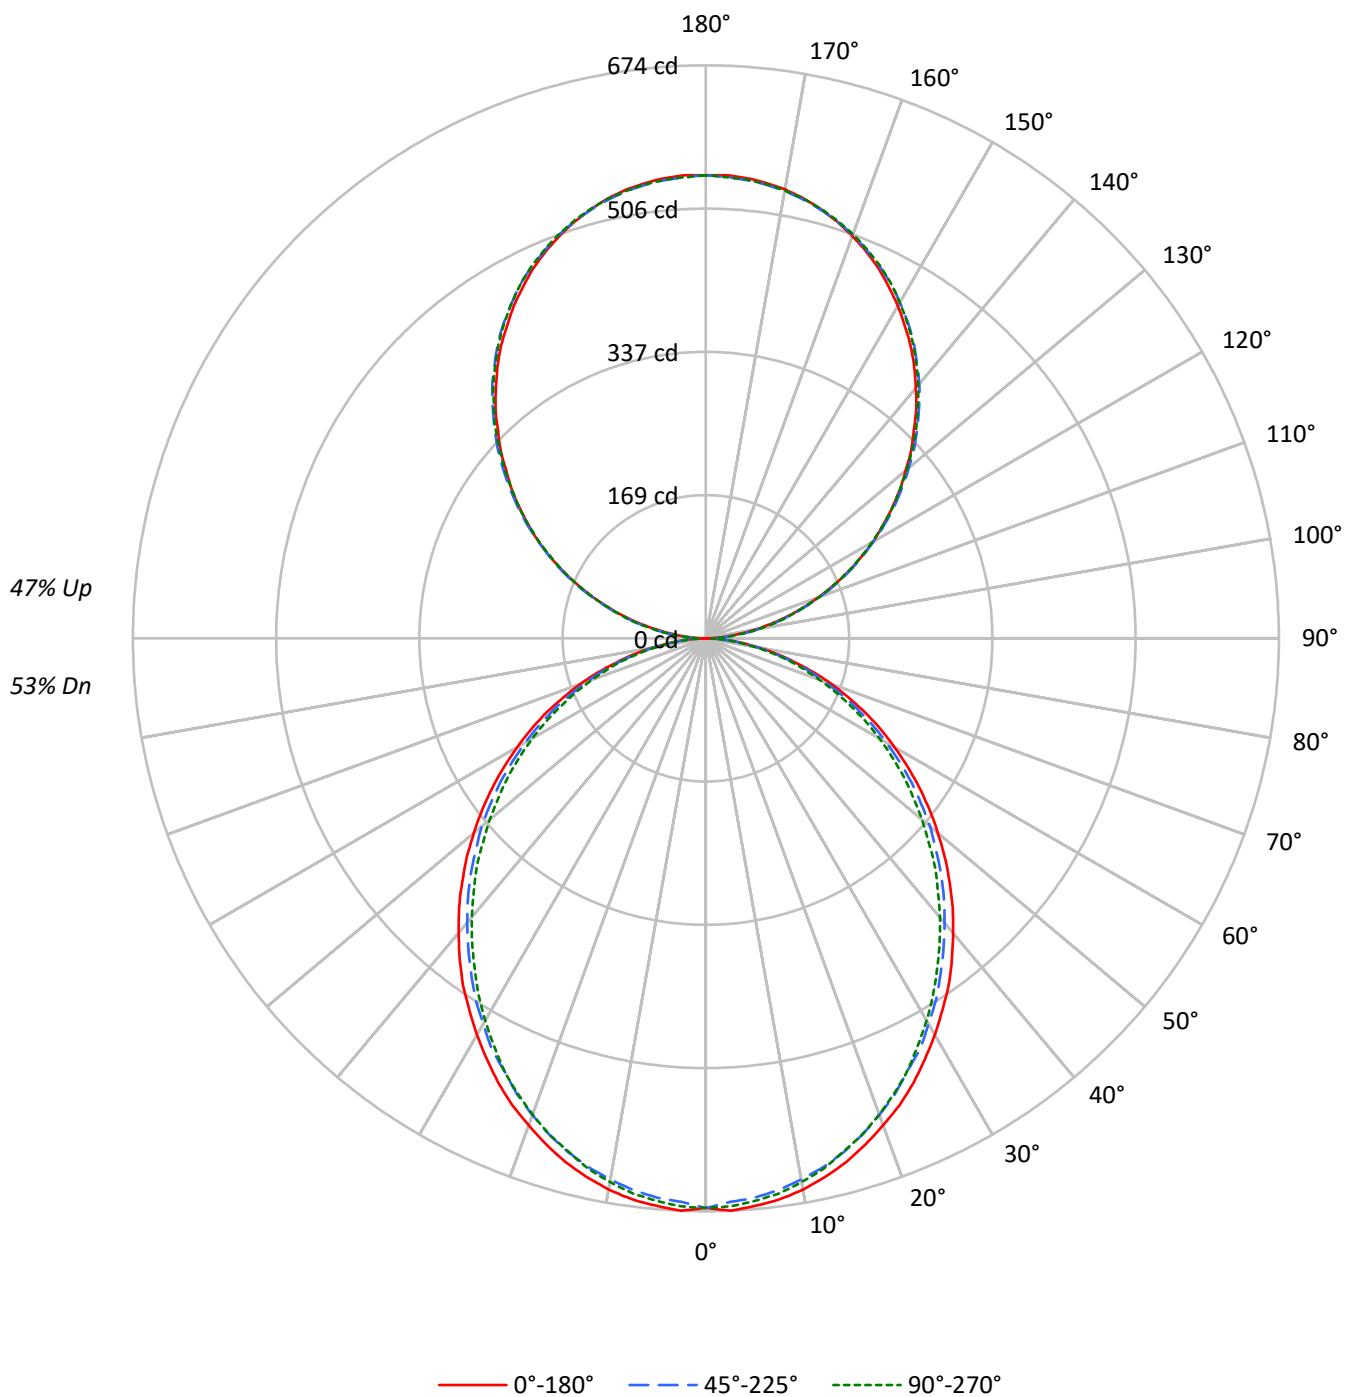

TEST NUMBER: P918542

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	764	764	764
5°	764	752	758
10°	758	742	747
15°	746	729	731
20°	731	712	714
25°	715	691	695
30°	696	671	671
35°	678	649	645
40°	655	626	620
45°	633	603	595
50°	608	578	566
55°	582	550	539
60°	553	517	509
65°	521	483	473
70°	481	440	434
75°	425	390	397
80°	357	325	328
85°	251	215	215

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 633 cd/sqm

TEST NUMBER: P918542

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.1	2.0
10°-20°	177.4	5.5
20°-30°	260.8	8.1
30°-40°	302.9	9.4
40°-50°	302.5	9.4
50°-60°	263.8	8.2
60°-70°	195.0	6.0
70°-80°	110.3	3.4
80°-90°	30.6	0.9
90°-100°	33.7	1.0
100°-110°	107.1	3.3
110°-120°	183.2	5.7
120°-130°	241.0	7.5
130°-140°	270.5	8.4
140°-150°	265.3	8.2
150°-160°	222.5	6.9
160°-170°	147.6	4.6
170°-180°	51.6	1.6
0°-30°	501.3	15.5
0°-40°	804.1	24.9
0°-60°	1370.4	42.4
0°-90°	1706.3	52.8
90°-120°	324.0	10.0
90°-150°	1100.8	34.1
90°-180°	1522.0	47.1
0°-180°	3228.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	670	670	670	670	670	
5°	670	668	660	666	664	64
15°	638	634	626	628	625	180
25°	577	572	561	562	561	266
35°	498	492	481	477	474	311
45°	405	401	391	384	381	313
55°	307	303	295	287	284	274
65°	207	203	197	191	188	205
75°	108	107	104	100	101	116
85°	26	26	25	23	23	29
90°	0	6	16	15	16	3
95°	24	29	29	29	29	27
105°	99	100	101	102	102	104
115°	184	186	186	185	184	182
125°	267	272	270	269	268	239
135°	346	351	352	352	350	267
145°	420	423	426	426	425	262
155°	480	482	483	485	484	221
165°	522	522	522	525	523	147
175°	544	542	541	545	542	52
180°	545	545	545	545	545	

TEST NUMBER: P918542

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	670.0	670.0	670.0	670.0	670.0
2.5°	673.9	670.7	663.6	670.0	668.8
5°	670.0	667.5	660.4	665.6	664.3
7.5°	665.6	661.7	654.6	659.8	658.5
10°	658.5	654.0	646.3	651.3	649.5
12.5°	648.8	645.0	637.2	640.4	639.1
15°	637.8	634.0	625.6	628.2	625.0
17.5°	624.3	620.5	612.1	615.3	612.1
20°	609.5	605.6	596.6	598.6	596.0
22.5°	594.7	588.9	580.5	580.5	579.2
25°	577.3	572.1	561.2	562.4	561.2
27.5°	557.9	553.4	545.1	543.2	539.9
30°	538.6	533.5	523.8	521.9	519.3
32.5°	518.0	514.2	503.9	500.0	497.4
35°	498.1	491.6	481.3	477.4	474.2
37.5°	475.5	469.7	459.3	454.9	451.6
40°	452.3	447.1	436.8	431.1	428.4
42.5°	429.7	424.6	414.3	407.9	404.0
45°	405.3	400.8	391.1	384.0	381.4
47.5°	381.4	376.9	366.6	359.5	355.7
50°	356.3	353.1	344.1	335.0	331.8
52.5°	331.8	327.3	318.9	311.9	307.4
55°	306.7	302.8	295.1	287.4	284.1
57.5°	281.5	278.4	269.9	262.3	259.6
60°	256.4	253.9	244.9	237.7	235.8
62.5°	232.0	227.4	221.0	214.6	212.0
65°	206.8	202.9	196.6	190.7	187.5
67.5°	181.1	177.8	172.0	167.6	165.0
70°	157.2	154.6	148.8	144.3	141.8
72.5°	132.8	130.2	126.9	122.4	120.5
75°	108.2	107.0	103.7	99.9	101.2
77.5°	86.4	83.8	82.4	80.5	78.6
80°	64.5	63.8	62.5	60.5	59.2
82.5°	43.8	43.8	43.2	40.6	40.6
85°	26.3	25.7	25.1	23.2	22.6
87.5°	11.6	10.3	9.0	7.1	6.5
90°	0.5	5.9	16.1	15.1	15.6
92.5°	10.2	13.8	14.3	14.8	14.8
95°	23.9	28.6	29.4	29.4	28.6
97.5°	39.9	44.2	46.0	46.0	46.0
100°	58.3	62.1	63.4	63.4	62.9
102.5°	77.7	80.4	82.2	82.7	82.2
105°	98.8	100.1	101.2	101.9	101.9
107.5°	119.9	121.8	121.8	122.2	119.9
110°	140.3	142.8	142.8	142.8	141.5



TEST NUMBER: P918542

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	162.2	165.0	164.5	163.2	162.2
115°	183.9	186.5	185.7	185.2	183.9
117.5°	205.4	209.1	206.7	205.4	204.1
120°	227.0	230.7	227.0	227.0	225.6
122.5°	246.8	251.3	249.1	247.8	246.8
125°	267.4	271.6	270.3	268.8	268.3
127.5°	287.7	292.7	290.9	289.0	287.7
130°	306.5	312.5	311.6	310.6	308.8
132.5°	327.7	332.3	332.6	330.4	329.0
135°	345.9	351.0	352.0	351.5	350.2
137.5°	366.3	370.4	371.3	370.9	368.9
140°	384.2	388.3	390.6	390.6	388.8
142.5°	402.6	406.6	408.0	408.5	406.6
145°	420.0	423.3	425.9	426.4	424.6
147.5°	435.6	439.7	441.7	442.5	440.7
150°	451.7	454.4	456.2	457.7	456.2
152.5°	466.0	468.7	471.1	472.9	471.1
155°	480.3	481.6	483.0	485.3	483.9
157.5°	492.6	493.5	494.4	497.7	495.3
160°	503.6	504.5	505.1	507.8	505.8
162.5°	513.8	513.8	514.2	517.4	515.0
165°	522.5	521.9	521.9	525.2	523.0
167.5°	530.3	528.8	528.8	532.1	529.9
170°	536.2	534.9	534.4	537.7	534.9
172.5°	540.4	539.0	538.6	541.8	539.0
175°	543.6	542.3	541.3	544.6	541.8
177.5°	545.4	544.2	543.1	545.9	543.1
180°	544.6	544.6	544.6	544.6	544.6

TEST NUMBER: P918542

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.56	7.45	7.49	8.40	9.63	6.12	7.00	7.05	7.95	9.18
	3H	8.22	9.01	9.16	9.97	11.23	7.73	8.52	8.67	9.48	10.74
	4H	8.80	9.56	9.76	10.52	11.78	8.31	9.06	9.27	10.03	11.29
	6H	9.20	9.90	10.17	10.87	12.14	8.70	9.40	9.67	10.36	11.64
	8H	9.31	9.97	10.28	10.95	12.23	8.80	9.47	9.78	10.45	11.72
	12H	9.35	9.98	10.33	10.96	12.26	8.84	9.47	9.83	10.45	11.75
4H	2H	7.02	7.77	7.98	8.74	10.00	6.67	7.42	7.63	8.38	9.65
	3H	8.88	9.51	9.86	10.51	11.78	8.48	9.11	9.45	10.10	11.37
	4H	9.60	10.17	10.58	11.16	12.46	9.17	9.75	10.15	10.73	12.03
	6H	10.11	10.60	11.10	11.61	12.91	9.68	10.17	10.67	11.18	12.48
	8H	10.26	10.72	11.25	11.72	13.04	9.82	10.28	10.81	11.28	12.60
	12H	10.33	10.75	11.34	11.77	13.08	9.88	10.30	10.89	11.32	12.63
8H	4H	9.79	10.25	10.79	11.26	12.57	9.41	9.88	10.41	10.88	12.19
	6H	10.42	10.80	11.44	11.84	13.16	10.03	10.41	11.05	11.46	12.77
	8H	10.63	10.97	11.66	12.00	13.33	10.24	10.58	11.27	11.61	12.94
	12H	10.76	11.06	11.80	12.09	13.46	10.35	10.65	11.39	11.68	13.05
12H	4H	9.78	10.19	10.79	11.21	12.53	9.41	9.83	10.42	10.85	12.16
	6H	10.44	10.78	11.47	11.81	13.14	10.07	10.41	11.10	11.44	12.77
	8H	10.68	10.98	11.72	12.01	13.38	10.30	10.60	11.34	11.63	13.00

END OF REPORT