

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918636

Luminaire Tested: DFN2DIP-4P3F0-060D050US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918636
REPORT IS A COMBINATION OF REPORTS P899068 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-060D050US935-RLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8201.0 lumens
Efficiency: N/A
Efficacy: 81.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 100.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918636

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US935-RLLFLL

Luminous Intensity Polar Plot

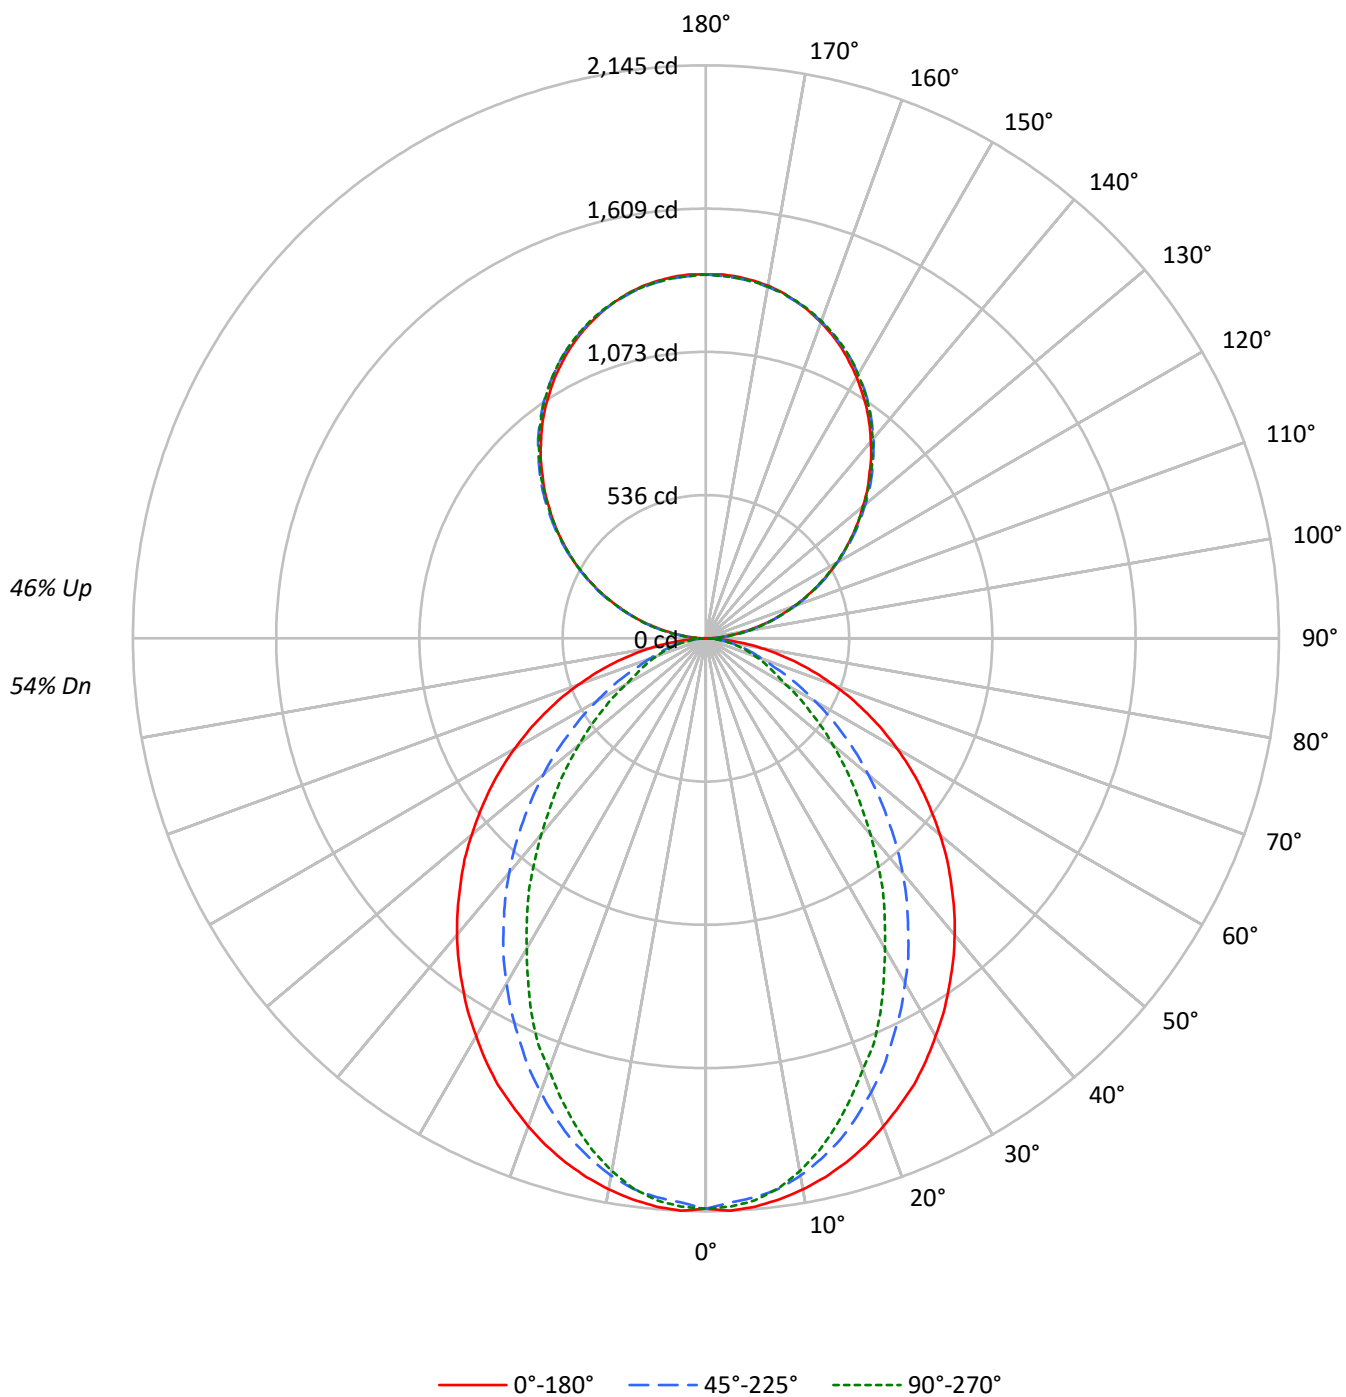

TEST NUMBER: P918636

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2433	2433	2433
5°	2436	2393	2409
10°	2410	2345	2330
15°	2375	2265	2208
20°	2330	2157	2059
25°	2283	2036	1915
30°	2221	1912	1732
35°	2161	1779	1572
40°	2098	1641	1388
45°	2027	1489	1221
50°	1952	1335	1059
55°	1874	1171	903
60°	1784	999	742
65°	1681	825	667
70°	1554	663	603
75°	1396	581	547
80°	1166	482	471
85°	791	314	350

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2027 cd/sqm

TEST NUMBER: P918636

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	2.4
10°-20°	549.3	6.7
20°-30°	771.2	9.4
30°-40°	840.7	10.3
40°-50°	772.7	9.4
50°-60°	606.8	7.4
60°-70°	395.0	4.8
70°-80°	203.3	2.5
80°-90°	55.8	0.7
90°-100°	84.2	1.0
100°-110°	267.7	3.3
110°-120°	458.1	5.6
120°-130°	602.5	7.3
130°-140°	676.3	8.2
140°-150°	663.1	8.1
150°-160°	556.3	6.8
160°-170°	368.9	4.5
170°-180°	128.9	1.6
0°-30°	1520.7	18.5
0°-40°	2361.4	28.8
0°-60°	3740.9	45.6
0°-90°	4394.9	53.6
90°-120°	810.0	9.9
90°-150°	2751.9	33.6
90°-180°	3806.0	46.4
0°-180°	8201.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	1	15	40	38	39	8
95°	60	72	73	73	72	67
105°	247	250	253	255	255	261
115°	460	466	464	463	460	455
125°	669	679	676	672	671	598
135°	865	878	880	879	876	669
145°	1050	1058	1065	1066	1061	656
155°	1201	1204	1208	1213	1210	553
165°	1306	1305	1305	1313	1307	368
175°	1359	1356	1353	1362	1354	129
180°	1362	1362	1362	1362	1362	

TEST NUMBER: P918636

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	1.2	14.8	40.2	37.8	39.0
92.5°	25.5	34.4	35.7	36.9	36.9
95°	59.9	71.5	73.4	73.4	71.5
97.5°	99.7	110.4	114.9	114.9	114.9
100°	145.7	155.2	158.4	158.4	157.2
102.5°	194.2	201.1	205.6	206.9	205.6
105°	247.1	250.4	252.9	254.9	254.9
107.5°	299.6	304.5	304.5	305.4	299.6
110°	350.5	357.1	357.1	357.1	353.8

TEST NUMBER: P918636

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	405.5	412.5	411.3	408.0	405.5
115°	459.7	466.3	464.3	463.0	459.7
117.5°	513.5	522.5	516.8	513.5	510.2
120°	567.7	576.7	567.7	567.7	564.0
122.5°	616.9	628.4	622.7	619.4	616.9
125°	668.7	678.9	675.6	671.9	670.7
127.5°	719.1	731.8	727.4	722.4	719.1
130°	766.4	781.1	779.0	776.6	772.1
132.5°	819.3	830.8	831.6	825.9	822.6
135°	864.9	877.5	880.0	878.8	875.5
137.5°	915.8	926.0	928.1	927.2	922.3
140°	960.4	970.8	976.5	976.5	972.0
142.5°	1006.4	1016.8	1020.0	1021.2	1016.8
145°	1050.0	1058.2	1064.7	1066.0	1061.4
147.5°	1089.0	1099.2	1104.1	1106.2	1101.6
150°	1129.2	1136.2	1140.6	1144.4	1140.6
152.5°	1164.9	1171.9	1177.6	1182.2	1177.6
155°	1200.6	1203.8	1207.5	1213.3	1209.6
157.5°	1231.4	1233.8	1235.9	1244.1	1238.4
160°	1258.9	1261.4	1262.6	1269.5	1264.6
162.5°	1284.4	1284.4	1285.6	1293.4	1287.6
165°	1306.1	1304.8	1304.8	1313.1	1307.3
167.5°	1325.8	1322.1	1322.1	1330.3	1324.6
170°	1340.6	1337.3	1336.1	1344.3	1337.3
172.5°	1350.8	1347.5	1346.3	1354.5	1347.5
175°	1359.1	1355.7	1353.3	1361.5	1354.5
177.5°	1363.6	1360.3	1357.8	1364.8	1357.8
180°	1361.5	1361.5	1361.5	1361.5	1361.5

TEST NUMBER: P918636

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.53	11.39	11.46	12.34	13.56	6.49	7.35	7.42	8.30	9.52
	3H	12.21	12.98	13.15	13.93	15.18	7.68	8.45	8.62	9.40	10.65
	4H	12.81	13.54	13.77	14.50	15.75	8.12	8.85	9.08	9.81	11.06
	6H	13.23	13.90	14.20	14.87	16.13	8.44	9.11	9.41	10.07	11.34
	8H	13.36	13.99	14.33	14.98	16.24	8.53	9.17	9.51	10.15	11.41
	12H	13.42	14.02	14.40	15.00	16.29	8.57	9.18	9.55	10.15	11.44
4H	2H	10.55	11.28	11.52	12.24	13.49	7.09	7.82	8.05	8.77	10.03
	3H	12.38	12.98	13.35	13.97	15.24	8.43	9.04	9.41	10.03	11.30
	4H	13.07	13.62	14.05	14.60	15.89	8.98	9.53	9.96	10.51	11.80
	6H	13.58	14.05	14.57	15.06	16.35	9.39	9.87	10.39	10.87	12.16
	8H	13.75	14.20	14.75	15.19	16.50	9.52	9.96	10.51	10.96	12.26
	12H	13.85	14.25	14.86	15.26	16.57	9.58	9.98	10.59	10.99	12.30
8H	4H	13.04	13.48	14.03	14.48	15.78	9.26	9.70	10.25	10.70	12.00
	6H	13.60	13.96	14.62	15.00	16.31	9.77	10.13	10.79	11.18	12.48
	8H	13.81	14.13	14.84	15.16	16.48	9.95	10.28	10.98	11.30	12.63
	12H	13.95	14.23	14.98	15.25	16.62	10.07	10.35	11.10	11.37	12.74
12H	4H	12.99	13.39	14.00	14.40	15.71	9.26	9.66	10.28	10.68	11.99
	6H	13.57	13.89	14.60	14.92	16.24	9.82	10.14	10.85	11.17	12.49
	8H	13.79	14.07	14.82	15.10	16.46	10.02	10.31	11.05	11.33	12.69

END OF REPORT