

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921271

Luminaire Tested: DFN2DIP-4P3F0-020D020US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921271
REPORT IS A COMBINATION OF REPORTS P900549 AND P897473
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-020D020US940-FLLONL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3531.2 lumens
Efficiency: N/A
Efficacy: 113.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 31
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921271

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US940-FLLONL

Luminous Intensity Polar Plot

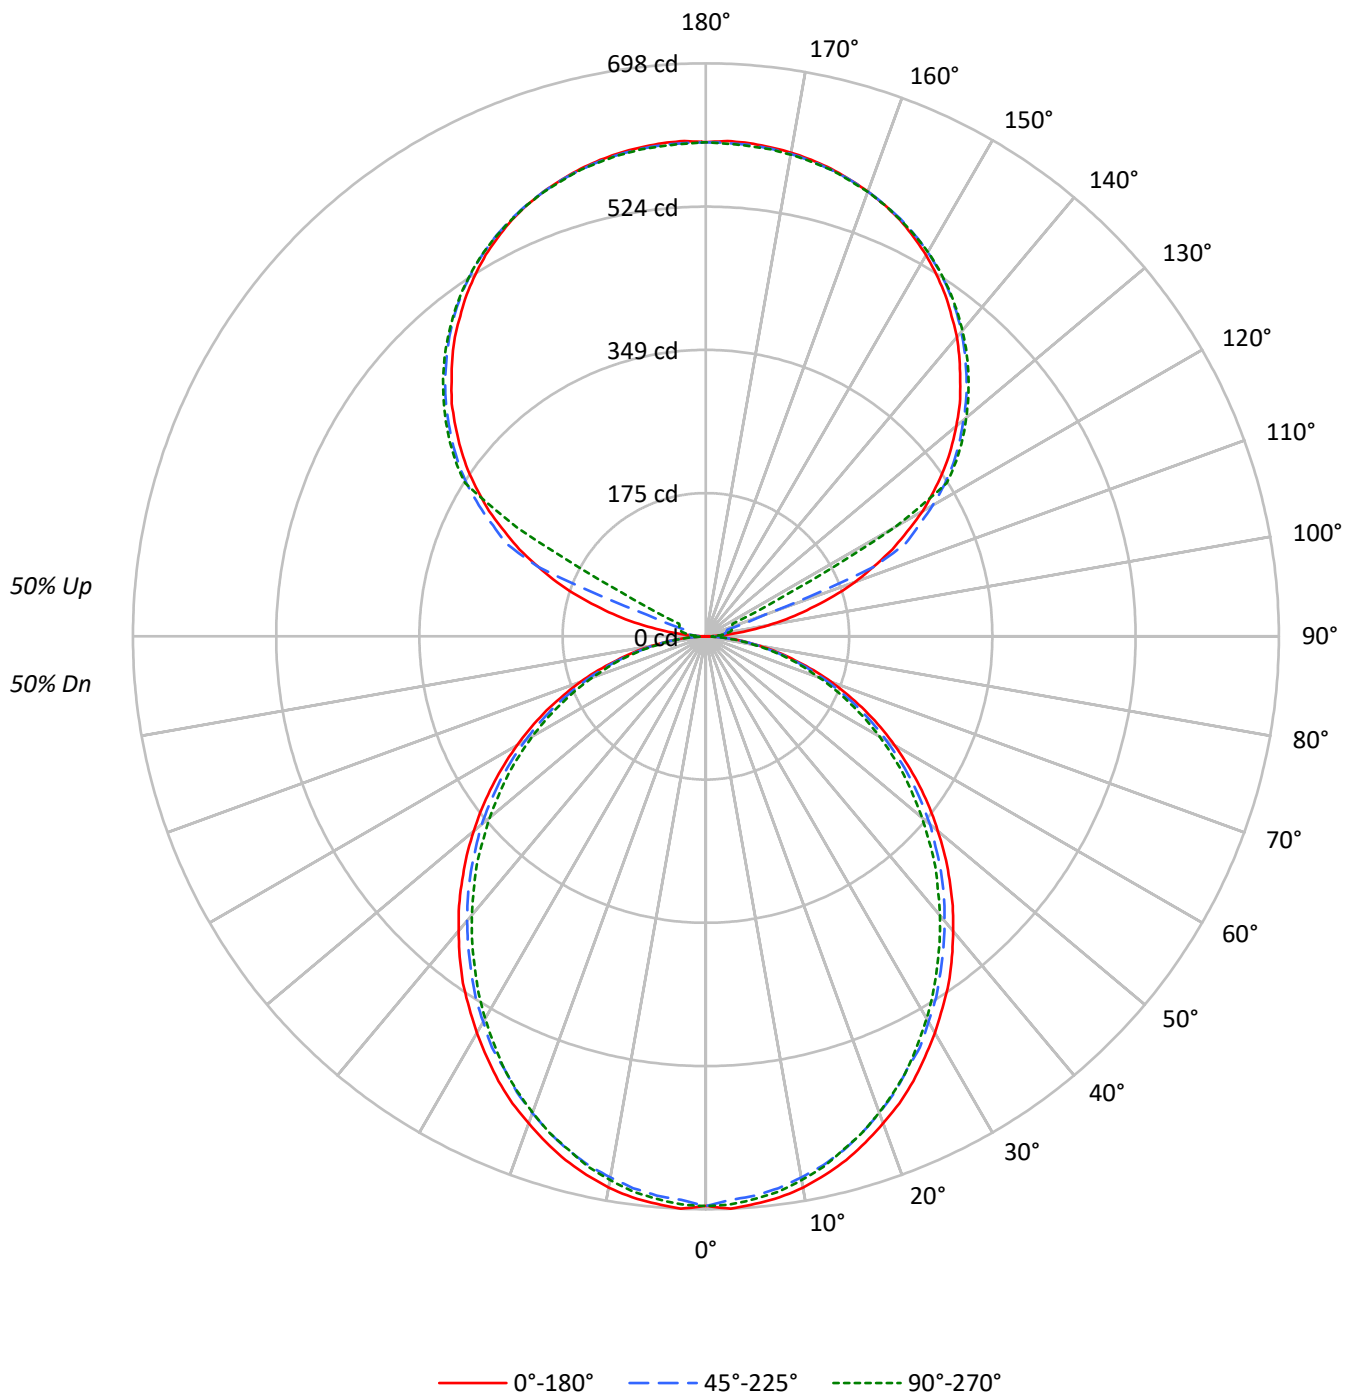

TEST NUMBER: P921271

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	791	791	791
5°	792	779	785
10°	785	768	774
15°	773	755	757
20°	757	737	740
25°	741	715	720
30°	721	695	695
35°	702	672	668
40°	678	648	643
45°	655	624	617
50°	630	599	587
55°	603	570	559
60°	573	535	527
65°	540	500	490
70°	498	456	449
75°	440	404	411
80°	370	337	340
85°	260	223	223

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 655 cd/sqm

TEST NUMBER: P921271

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	65.3	1.8
10°-20°	183.8	5.2
20°-30°	270.1	7.6
30°-40°	313.7	8.9
40°-50°	313.3	8.9
50°-60°	273.2	7.7
60°-70°	201.9	5.7
70°-80°	114.2	3.2
80°-90°	31.2	0.9
90°-100°	19.8	0.6
100°-110°	74.0	2.1
110°-120°	196.2	5.6
120°-130°	325.4	9.2
130°-140°	345.7	9.8
140°-150°	321.3	9.1
150°-160°	258.3	7.3
160°-170°	166.4	4.7
170°-180°	57.3	1.6
0°-30°	519.1	14.7
0°-40°	832.8	23.6
0°-60°	1419.3	40.2
0°-90°	1766.7	50.0
90°-120°	290.0	8.2
90°-150°	1282.5	36.3
90°-180°	1765.0	50.0
0°-180°	3531.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	694	694	694	694	694	
5°	694	691	684	689	688	66
15°	661	657	648	651	647	186
25°	598	592	581	582	581	275
35°	516	509	498	494	491	322
45°	420	415	405	398	395	324
55°	318	314	306	298	294	284
65°	214	210	204	198	194	212
75°	112	111	107	103	105	120
85°	27	27	26	24	23	30
90°	0	5	9	11	12	3
95°	28	14	17	19	19	33
105°	132	145	27	31	33	141
115°	250	258	269	67	36	247
125°	354	360	368	371	372	316
135°	438	445	449	453	452	338
145°	508	508	515	518	516	318
155°	560	556	561	564	560	258
165°	590	587	588	592	588	167
175°	603	600	601	604	600	57
180°	602	602	602	602	602	

TEST NUMBER: P921271

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	693.9	693.9	693.9	693.9	693.9
2.5°	697.9	694.6	687.2	693.9	692.7
5°	693.9	691.3	683.9	689.3	688.0
7.5°	689.3	685.3	678.0	683.3	682.0
10°	682.0	677.3	669.3	674.6	672.6
12.5°	671.9	668.0	660.0	663.3	661.9
15°	660.6	656.7	647.9	650.6	647.3
17.5°	646.6	642.7	633.9	637.2	633.9
20°	631.2	627.2	617.9	619.9	617.2
22.5°	615.9	609.9	601.2	601.2	599.9
25°	597.9	592.5	581.2	582.5	581.2
27.5°	577.8	573.2	564.5	562.6	559.2
30°	557.9	552.5	542.5	540.6	537.8
32.5°	536.5	532.5	521.8	517.8	515.1
35°	515.9	509.2	498.5	494.5	491.1
37.5°	492.5	486.4	475.7	471.1	467.7
40°	468.4	463.1	452.4	446.5	443.7
42.5°	445.1	439.7	429.1	422.4	418.4
45°	419.7	415.1	405.0	397.7	395.0
47.5°	395.0	390.4	379.7	372.3	368.4
50°	369.0	365.7	356.3	347.0	343.7
52.5°	343.7	338.9	330.3	323.0	318.3
55°	317.6	313.6	305.6	297.7	294.3
57.5°	291.6	288.3	279.6	271.6	268.9
60°	265.6	263.0	253.6	246.2	244.2
62.5°	240.2	235.5	228.9	222.2	219.5
65°	214.2	210.2	203.6	197.5	194.2
67.5°	187.5	184.1	178.2	173.5	170.9
70°	162.8	160.2	154.1	149.5	146.9
72.5°	137.5	134.8	131.4	126.8	124.8
75°	112.1	110.8	107.4	103.4	104.8
77.5°	89.4	86.8	85.3	83.4	81.4
80°	66.8	66.1	64.7	62.7	61.3
82.5°	45.4	45.4	44.8	42.1	42.1
85°	27.3	26.7	26.0	24.0	23.4
87.5°	12.0	10.7	9.4	7.4	6.7
90°	0.4	5.3	8.6	10.9	11.8
92.5°	10.9	9.2	10.4	11.3	11.8
95°	28.3	13.9	16.9	19.2	18.7
97.5°	50.9	15.2	22.2	23.5	24.0
100°	77.1	17.4	24.8	28.3	29.2
102.5°	105.8	105.0	25.7	30.5	31.8
105°	132.4	145.4	26.6	31.3	33.1
107.5°	163.4	174.2	27.5	32.2	34.0
110°	193.0	202.1	76.2	32.7	34.4

TEST NUMBER: P921271

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	220.8	228.6	221.2	33.5	34.9
115°	250.4	257.8	268.8	67.1	35.8
117.5°	276.1	284.8	292.2	230.0	115.8
120°	304.9	311.4	319.2	324.5	265.6
122.5°	329.2	336.2	344.9	347.5	348.0
125°	354.1	359.7	368.0	371.0	372.4
127.5°	376.7	382.8	389.4	393.7	394.1
130°	398.1	405.0	409.8	414.6	414.2
132.5°	419.8	425.5	430.3	434.2	433.8
135°	438.2	445.1	449.0	453.4	452.5
137.5°	457.3	462.5	466.9	471.3	469.9
140°	476.0	479.6	484.3	488.2	486.1
142.5°	491.7	494.8	500.4	503.9	501.7
145°	508.3	507.8	515.2	518.3	516.1
147.5°	522.6	521.3	528.7	530.8	529.1
150°	536.5	533.5	540.5	543.1	540.9
152.5°	548.3	544.8	551.3	554.0	550.9
155°	559.6	555.7	561.0	563.6	560.1
157.5°	568.8	565.3	569.3	572.3	568.8
160°	576.7	574.0	576.7	579.3	576.2
162.5°	583.5	580.9	583.2	586.2	582.3
165°	589.7	587.1	588.4	591.5	588.4
167.5°	594.5	591.8	593.2	596.3	592.3
170°	598.4	595.8	596.6	599.7	595.8
172.5°	601.0	598.4	599.3	602.4	598.4
175°	603.2	600.1	601.0	604.0	599.7
177.5°	604.0	601.0	601.5	604.5	600.6
180°	601.9	601.9	601.9	601.9	601.9

TEST NUMBER: P921271

CATALOG NUMBER: DFN2DIP-4P3F0-020D020US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.43	7.29	7.38	8.26	9.53	5.98	6.84	6.94	7.82	9.09
	3H	8.08	8.85	9.05	9.84	11.13	7.59	8.37	8.56	9.35	10.64
	4H	8.67	9.40	9.65	10.38	11.69	8.17	8.90	9.16	9.89	11.19
	6H	9.06	9.74	10.06	10.73	12.04	8.56	9.24	9.56	10.23	11.54
	8H	9.17	9.81	10.17	10.82	12.13	8.66	9.31	9.66	10.31	11.62
	12H	9.21	9.82	10.22	10.82	12.16	8.70	9.31	9.71	10.32	11.65
4H	2H	6.88	7.62	7.87	8.60	9.90	6.53	7.26	7.52	8.25	9.55
	3H	8.74	9.35	9.74	10.37	11.68	8.34	8.95	9.33	9.96	11.28
	4H	9.46	10.01	10.46	11.02	12.36	9.03	9.59	10.04	10.60	11.94
	6H	9.97	10.45	10.98	11.48	12.81	9.53	10.01	10.55	11.04	12.38
	8H	10.11	10.56	11.13	11.59	12.94	9.68	10.13	10.69	11.15	12.50
	12H	10.18	10.59	11.22	11.63	12.99	9.74	10.14	10.77	11.18	12.54
8H	4H	9.65	10.10	10.67	11.12	12.47	9.27	9.72	10.29	10.74	12.09
	6H	10.27	10.64	11.32	11.71	13.06	9.89	10.26	10.93	11.33	12.67
	8H	10.49	10.82	11.54	11.87	13.24	10.10	10.42	11.15	11.48	12.84
	12H	10.62	10.91	11.67	11.95	13.36	10.21	10.50	11.26	11.54	12.95
12H	4H	9.63	10.04	10.67	11.08	12.43	9.26	9.67	10.30	10.71	12.06
	6H	10.30	10.63	11.35	11.68	13.05	9.93	10.26	10.98	11.31	12.67
	8H	10.54	10.83	11.59	11.87	13.28	10.16	10.45	11.21	11.49	12.90

END OF REPORT