

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921285

Luminaire Tested: DFN2DIP-4P3F0-020D050US940-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921285
REPORT IS A COMBINATION OF REPORTS P900580 AND P897473
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-020D050US940-RLLONL
Description: 3 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5929.9 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 53.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921285

CATALOG NUMBER: DFN2DIP-4P3F0-020D050US940-RLLONL

Luminous Intensity Polar Plot

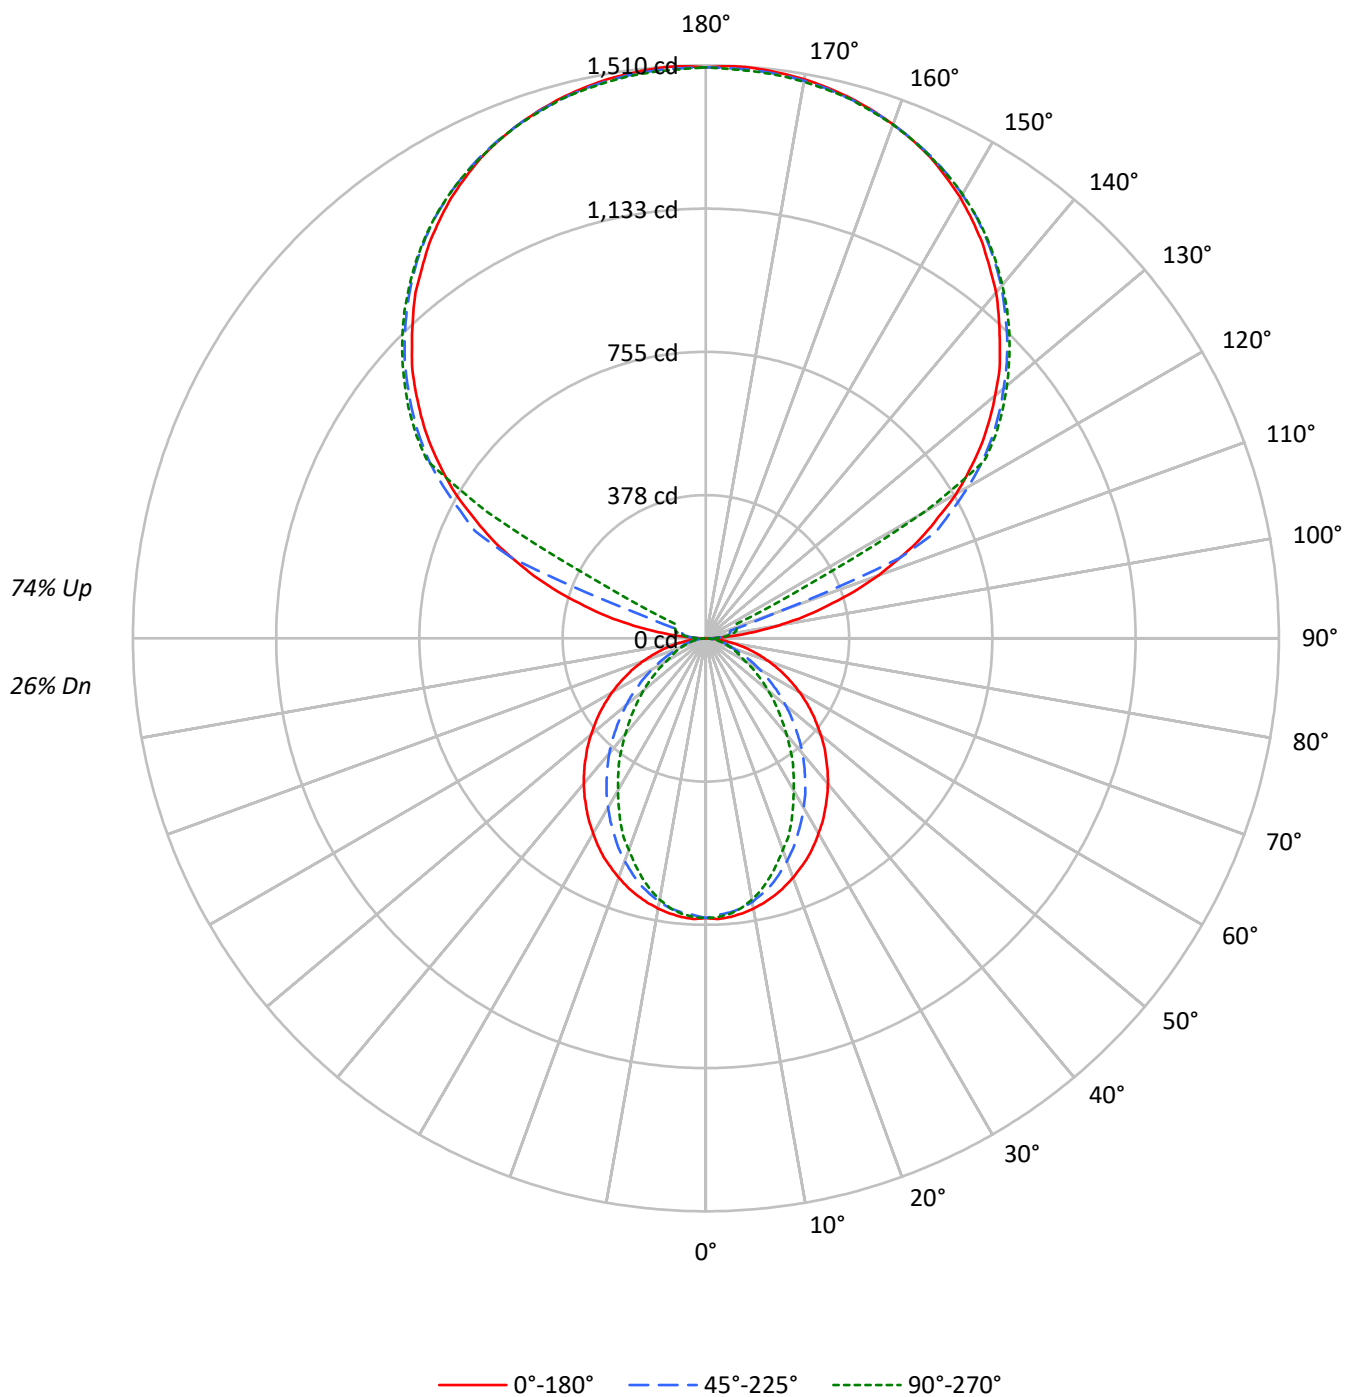

TEST NUMBER: P921285

CATALOG NUMBER: DFN2DIP-4P3F0-020D050US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	101	101	101	101	90	90	90	90	70	70	70	51	51	51	34	34	34
1	93	88	85	82	82	79	76	73	61	59	58	45	44	43	30	29	29
2	84	77	72	67	75	69	65	60	54	51	48	40	38	36	27	26	25
3	77	68	61	56	69	61	55	51	48	44	41	35	33	31	24	23	21
4	71	60	53	47	63	54	48	43	43	38	35	32	29	26	22	20	19
5	65	54	46	41	58	48	42	37	38	33	30	28	25	23	19	18	16
6	60	48	41	35	53	43	37	32	34	30	26	26	23	20	18	16	14
7	55	43	36	31	49	39	33	28	31	26	23	23	20	18	16	14	13
8	51	39	32	27	45	36	29	25	28	24	20	21	18	16	15	13	12
9	47	36	29	24	42	32	26	22	26	21	18	20	16	14	14	12	10
10	44	33	26	21	39	30	24	20	24	19	16	18	15	13	13	11	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	840	840	840
5°	841	826	832
10°	832	809	804
15°	820	782	762
20°	804	745	711
25°	788	703	661
30°	767	660	598
35°	746	614	543
40°	724	567	479
45°	700	514	422
50°	674	461	366
55°	647	404	312
60°	616	345	256
65°	580	285	230
70°	536	229	208
75°	482	200	189
80°	403	167	162
85°	273	109	121

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1026 cd/sqm

TEST NUMBER: P921285

CATALOG NUMBER: DFN2DIP-4P3F0-020D050US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	69.1	1.2
10°-20°	189.6	3.2
20°-30°	266.3	4.5
30°-40°	290.2	4.9
40°-50°	266.8	4.5
50°-60°	209.5	3.5
60°-70°	136.4	2.3
70°-80°	70.2	1.2
80°-90°	20.6	0.3
90°-100°	49.6	0.8
100°-110°	185.0	3.1
110°-120°	490.6	8.3
120°-130°	813.6	13.7
130°-140°	864.3	14.6
140°-150°	803.2	13.5
150°-160°	645.8	10.9
160°-170°	416.1	7.0
170°-180°	143.2	2.4
0°-30°	525.0	8.9
0°-40°	815.2	13.7
0°-60°	1291.4	21.8
0°-90°	1518.6	25.6
90°-120°	725.2	12.2
90°-150°	3206.2	54.1
90°-180°	4411.0	74.4
0°-180°	5929.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	737	737	737	737	737	
5°	737	734	725	731	729	70
15°	701	694	671	658	652	198
25°	636	615	571	544	534	293
35°	548	514	456	414	399	343
45°	448	404	334	286	270	346
55°	341	289	217	177	164	305
65°	230	176	116	94	91	228
75°	123	76	53	49	48	130
85°	29	15	13	13	13	33
90°	1	13	22	27	29	6
95°	71	35	42	48	47	84
105°	331	364	66	78	83	354
115°	626	644	672	168	89	616
125°	885	899	920	928	931	789
135°	1095	1113	1122	1134	1131	846
145°	1271	1270	1288	1296	1290	795
155°	1399	1389	1402	1409	1400	645
165°	1474	1468	1471	1478	1471	416
175°	1508	1500	1502	1510	1499	144
180°	1505	1505	1505	1505	1505	

TEST NUMBER: P921285

CATALOG NUMBER: DFN2DIP-4P3F0-020D050US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	737.1	737.1	737.1	737.1	737.1
2.5°	740.4	737.1	729.7	736.5	735.1
5°	737.1	733.8	725.0	731.1	729.1
7.5°	731.1	727.1	717.7	720.4	717.0
10°	723.1	718.4	705.1	703.0	699.1
12.5°	713.1	707.0	689.0	685.1	677.7
15°	701.1	693.7	671.0	658.3	651.8
17.5°	687.1	676.4	648.4	633.6	623.0
20°	671.0	657.6	624.4	607.7	593.0
22.5°	653.7	638.4	599.7	577.0	567.0
25°	636.4	615.0	571.0	543.7	533.6
27.5°	615.7	593.0	544.3	512.9	497.6
30°	593.7	568.3	515.0	481.0	462.9
32.5°	572.3	541.6	487.0	446.9	430.3
35°	548.3	514.3	455.7	413.6	398.9
37.5°	524.9	488.2	426.2	380.2	363.6
40°	500.2	460.3	395.6	348.2	330.8
42.5°	474.9	432.3	364.9	315.5	298.9
45°	448.3	403.5	333.6	286.1	270.1
47.5°	422.9	375.6	303.5	256.1	241.5
50°	394.9	347.6	274.2	228.1	214.2
52.5°	367.5	317.4	246.1	202.2	189.5
55°	340.8	288.8	216.8	176.8	164.1
57.5°	313.5	260.1	190.8	153.5	142.8
60°	285.5	232.1	163.5	129.5	118.8
62.5°	258.2	204.8	140.1	108.1	102.7
65°	230.2	176.1	116.1	93.5	91.4
67.5°	203.5	149.4	93.5	82.0	80.1
70°	175.4	123.4	77.3	70.7	68.0
72.5°	148.7	99.3	64.6	59.4	58.1
75°	122.7	76.0	53.3	48.7	48.1
77.5°	96.8	54.0	42.0	39.3	38.0
80°	72.7	38.7	32.0	29.3	29.3
82.5°	50.6	26.0	22.0	20.7	20.7
85°	28.6	14.6	12.7	12.7	12.7
87.5°	10.7	5.4	5.4	4.6	4.6
90°	1.1	13.0	21.8	27.3	29.3
92.5°	27.3	22.9	26.1	28.4	29.3
95°	70.7	34.8	42.4	48.0	46.8
97.5°	127.3	38.2	55.5	58.9	59.8
100°	192.8	43.6	62.1	70.7	72.9
102.5°	264.6	262.4	64.3	76.2	79.5
105°	331.0	363.7	66.4	78.4	82.8
107.5°	408.3	435.4	68.7	80.5	85.0
110°	482.4	505.2	190.6	81.7	86.0

TEST NUMBER: P921285

CATALOG NUMBER: DFN2DIP-4P3F0-020D050US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	552.1	571.6	553.1	83.8	87.1
115°	626.1	644.5	671.8	167.7	89.3
117.5°	690.3	712.0	730.7	574.8	289.6
120°	762.1	778.5	798.1	811.2	664.1
122.5°	823.0	840.5	862.4	868.9	870.0
125°	885.1	899.4	920.1	927.6	930.9
127.5°	941.7	957.0	973.5	984.3	985.3
130°	995.1	1012.6	1024.5	1036.5	1035.5
132.5°	1049.6	1063.8	1075.7	1085.6	1084.5
135°	1095.4	1112.9	1122.5	1133.5	1131.3
137.5°	1143.2	1156.3	1167.2	1178.1	1174.9
140°	1190.0	1198.8	1210.7	1220.5	1215.1
142.5°	1229.3	1237.0	1251.1	1259.7	1254.3
145°	1270.7	1269.5	1288.0	1295.7	1290.2
147.5°	1306.5	1303.2	1321.8	1327.2	1322.9
150°	1341.4	1333.8	1351.2	1357.7	1352.3
152.5°	1370.7	1362.1	1378.4	1385.0	1377.3
155°	1399.1	1389.4	1402.4	1408.9	1400.3
157.5°	1421.9	1413.3	1423.1	1430.7	1421.9
160°	1441.6	1435.0	1441.6	1448.0	1440.5
162.5°	1458.9	1452.5	1457.9	1465.5	1455.7
165°	1474.2	1467.8	1471.0	1478.5	1471.0
167.5°	1486.2	1479.6	1483.0	1490.6	1480.8
170°	1496.0	1489.4	1491.7	1499.2	1489.4
172.5°	1502.5	1496.0	1498.3	1505.8	1496.0
175°	1508.0	1500.3	1502.5	1510.1	1499.2
177.5°	1510.1	1502.5	1503.7	1511.3	1501.5
180°	1504.7	1504.7	1504.7	1504.7	1504.7

TEST NUMBER: P921285

CATALOG NUMBER: DFN2DIP-4P3F0-020D050US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	3.63	4.30	4.78	5.43	7.01	0.00	0.26	0.74	1.39	2.98
	3H	5.29	5.89	6.45	7.03	8.62	0.76	1.36	1.92	2.50	4.10
	4H	5.89	6.45	7.05	7.59	9.20	1.20	1.77	2.37	2.91	4.51
	6H	6.30	6.82	7.47	7.96	9.58	1.51	2.03	2.68	3.17	4.78
	8H	6.42	6.91	7.59	8.07	9.68	1.59	2.08	2.76	3.24	4.85
	12H	6.47	6.94	7.65	8.09	9.72	1.63	2.09	2.80	3.25	4.87
4H	2H	3.63	4.19	4.80	5.33	6.94	0.17	0.73	1.34	1.87	3.48
	3H	5.44	5.91	6.61	7.07	8.69	1.49	1.96	2.67	3.13	4.75
	4H	6.12	6.55	7.29	7.70	9.34	2.03	2.46	3.21	3.62	5.25
	6H	6.62	6.99	7.80	8.17	9.79	2.43	2.80	3.61	3.98	5.60
	8H	6.79	7.13	7.97	8.30	9.94	2.56	2.90	3.73	4.07	5.71
	12H	6.87	7.19	8.07	8.36	10.01	2.61	2.92	3.80	4.10	5.75
8H	4H	6.07	6.42	7.25	7.58	9.23	2.30	2.64	3.48	3.81	5.45
	6H	6.63	6.91	7.83	8.12	9.76	2.80	3.08	4.00	4.29	5.93
	8H	6.84	7.09	8.04	8.27	9.93	2.98	3.23	4.19	4.42	6.08
	12H	6.97	7.18	8.17	8.37	10.06	3.09	3.31	4.30	4.49	6.18
12H	4H	6.02	6.33	7.21	7.51	9.15	2.29	2.60	3.49	3.78	5.43
	6H	6.60	6.85	7.81	8.04	9.69	2.85	3.09	4.05	4.28	5.94
	8H	6.81	7.03	8.02	8.21	9.90	3.04	3.26	4.25	4.45	6.14

END OF REPORT