

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924065

Luminaire Tested: DFN2DIP-4P3F0-050D030US950-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924065
REPORT IS A COMBINATION OF REPORTS P900566 AND P897473
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-050D030US950-RLLONL
Description: 3 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6887.9 lumens
Efficiency: N/A
Efficacy: 96.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 71.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924065

CATALOG NUMBER: DFN2DIP-4P3F0-050D030US950-RLLONL

Luminous Intensity Polar Plot

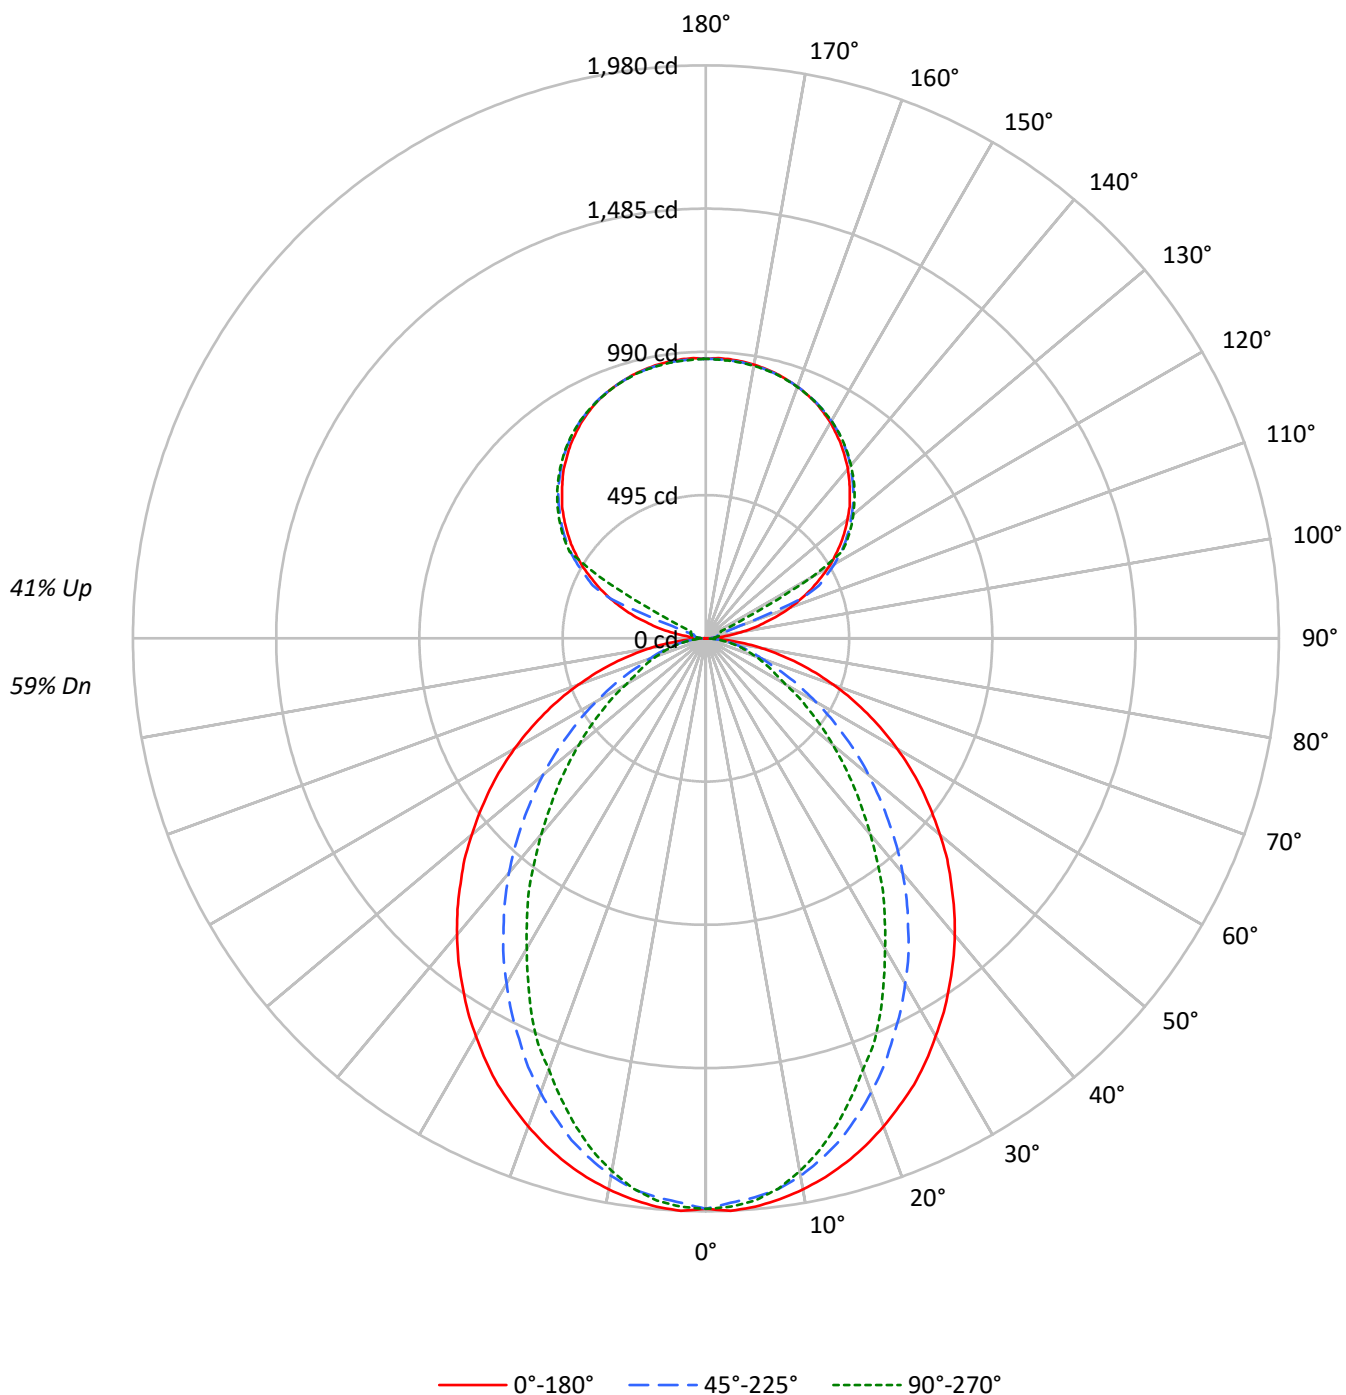

TEST NUMBER: P924065

CATALOG NUMBER: DFN2DIP-4P3F0-050D030US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	55
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	51	49	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	43	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	38	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	23	21
10	50	38	31	26	46	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2247	2247	2247
5°	2249	2210	2224
10°	2225	2165	2151
15°	2193	2092	2039
20°	2151	1992	1901
25°	2108	1880	1768
30°	2051	1765	1599
35°	1995	1642	1451
40°	1938	1515	1281
45°	1871	1374	1128
50°	1803	1232	978
55°	1731	1081	833
60°	1648	922	685
65°	1551	762	616
70°	1435	612	556
75°	1289	536	505
80°	1077	446	435
85°	731	290	323

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1871 cd/sqm

TEST NUMBER: P924065

CATALOG NUMBER: DFN2DIP-4P3F0-050D030US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	2.7
10°-20°	507.2	7.4
20°-30°	712.1	10.3
30°-40°	776.3	11.3
40°-50°	713.5	10.4
50°-60°	560.3	8.1
60°-70°	364.7	5.3
70°-80°	187.7	2.7
80°-90°	49.6	0.7
90°-100°	31.9	0.5
100°-110°	118.7	1.7
110°-120°	314.9	4.6
120°-130°	522.3	7.6
130°-140°	554.8	8.1
140°-150°	515.6	7.5
150°-160°	414.5	6.0
160°-170°	267.1	3.9
170°-180°	91.9	1.3
0°-30°	1404.1	20.4
0°-40°	2180.4	31.7
0°-60°	3454.1	50.1
0°-90°	4056.2	58.9
90°-120°	465.5	6.8
90°-150°	2058.1	29.9
90°-180°	2832.0	41.1
0°-180°	6887.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	8	14	18	19	7
95°	45	22	27	31	30	54
105°	212	233	43	50	53	227
115°	402	414	431	108	57	396
125°	568	577	591	596	598	507
135°	703	714	721	728	726	543
145°	816	815	827	832	828	510
155°	898	892	900	904	899	414
165°	946	942	944	949	944	267
175°	968	963	964	969	962	92
180°	966	966	966	966	966	

TEST NUMBER: P924065

CATALOG NUMBER: DFN2DIP-4P3F0-050D030US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	0.7	8.4	13.9	17.6	18.8
92.5°	17.6	14.7	16.8	18.2	18.8
95°	45.4	22.3	27.2	30.8	30.1
97.5°	81.8	24.5	35.6	37.8	38.4
100°	123.7	28.0	39.9	45.4	46.8
102.5°	169.8	168.5	41.2	48.8	51.0
105°	212.5	233.4	42.6	50.3	53.1
107.5°	262.1	279.5	44.1	51.7	54.6
110°	309.7	324.3	122.3	52.5	55.2



TEST NUMBER: P924065

CATALOG NUMBER: DFN2DIP-4P3F0-050D030US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	354.4	366.9	355.1	53.8	55.9
115°	401.8	413.7	431.2	107.6	57.3
117.5°	443.1	457.1	469.0	369.0	185.9
120°	489.2	499.7	512.3	520.7	426.3
122.5°	528.3	539.6	553.6	557.7	558.5
125°	568.2	577.3	590.6	595.5	597.6
127.5°	604.5	614.3	624.9	631.8	632.5
130°	638.8	650.1	657.7	665.3	664.7
132.5°	673.7	682.9	690.5	696.8	696.1
135°	703.1	714.4	720.6	727.6	726.2
137.5°	733.8	742.2	749.3	756.2	754.1
140°	763.9	769.5	777.1	783.4	780.0
142.5°	789.1	794.0	803.1	808.6	805.2
145°	815.7	814.9	826.8	831.7	828.2
147.5°	838.7	836.6	848.5	851.9	849.2
150°	861.1	856.2	867.4	871.5	868.0
152.5°	879.9	874.3	884.8	889.0	884.2
155°	898.1	891.9	900.2	904.4	898.9
157.5°	912.8	907.3	913.6	918.4	912.8
160°	925.4	921.2	925.4	929.6	924.6
162.5°	936.5	932.3	935.9	940.7	934.4
165°	946.3	942.2	944.3	949.1	944.3
167.5°	954.0	949.8	951.9	956.9	950.6
170°	960.3	956.1	957.5	962.4	956.1
172.5°	964.5	960.3	961.7	966.6	960.3
175°	967.9	963.1	964.5	969.4	962.4
177.5°	969.4	964.5	965.3	970.1	963.8
180°	965.9	965.9	965.9	965.9	965.9

TEST NUMBER: P924065

CATALOG NUMBER: DFN2DIP-4P3F0-050D030US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.72	11.63	11.60	12.53	13.67	6.68	7.59	7.56	8.49	9.63
	3H	12.40	13.21	13.29	14.12	15.29	7.87	8.68	8.76	9.59	10.76
	4H	13.01	13.77	13.92	14.69	15.86	8.32	9.08	9.23	10.00	11.17
	6H	13.43	14.13	14.35	15.06	16.24	8.64	9.34	9.56	10.26	11.45
	8H	13.55	14.23	14.49	15.16	16.35	8.72	9.40	9.66	10.33	11.52
	12H	13.62	14.26	14.55	15.19	16.40	8.77	9.41	9.70	10.34	11.55
4H	2H	10.74	11.51	11.66	12.43	13.60	7.28	8.05	8.20	8.96	10.14
	3H	12.57	13.21	13.50	14.16	15.35	8.63	9.27	9.56	10.21	11.41
	4H	13.27	13.85	14.20	14.79	16.00	9.18	9.76	10.11	10.70	11.91
	6H	13.78	14.28	14.73	15.25	16.46	9.59	10.09	10.54	11.06	12.27
	8H	13.96	14.42	14.91	15.38	16.61	9.72	10.19	10.67	11.14	12.37
	12H	14.05	14.47	15.02	15.45	16.68	9.78	10.20	10.76	11.18	12.42
8H	4H	13.24	13.71	14.19	14.66	15.89	9.46	9.93	10.41	10.88	12.12
	6H	13.80	14.19	14.78	15.19	16.42	9.97	10.36	10.95	11.36	12.59
	8H	14.02	14.36	15.00	15.35	16.59	10.16	10.50	11.15	11.49	12.74
	12H	14.15	14.45	15.14	15.44	16.73	10.28	10.57	11.27	11.56	12.85
12H	4H	13.19	13.61	14.17	14.59	15.83	9.47	9.89	10.44	10.86	12.10
	6H	13.78	14.12	14.76	15.11	16.35	10.02	10.36	11.01	11.35	12.60
	8H	14.00	14.30	14.99	15.28	16.57	10.23	10.53	11.22	11.51	12.81

END OF REPORT