

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924072

Luminaire Tested: DFN2DIP-4P3F0-050D050US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924072
REPORT IS A COMBINATION OF REPORTS P899066 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-050D050US950-RLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8276.0 lumens
Efficiency: N/A
Efficacy: 95.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 87
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924072

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US950-RLLFLL

Luminous Intensity Polar Plot

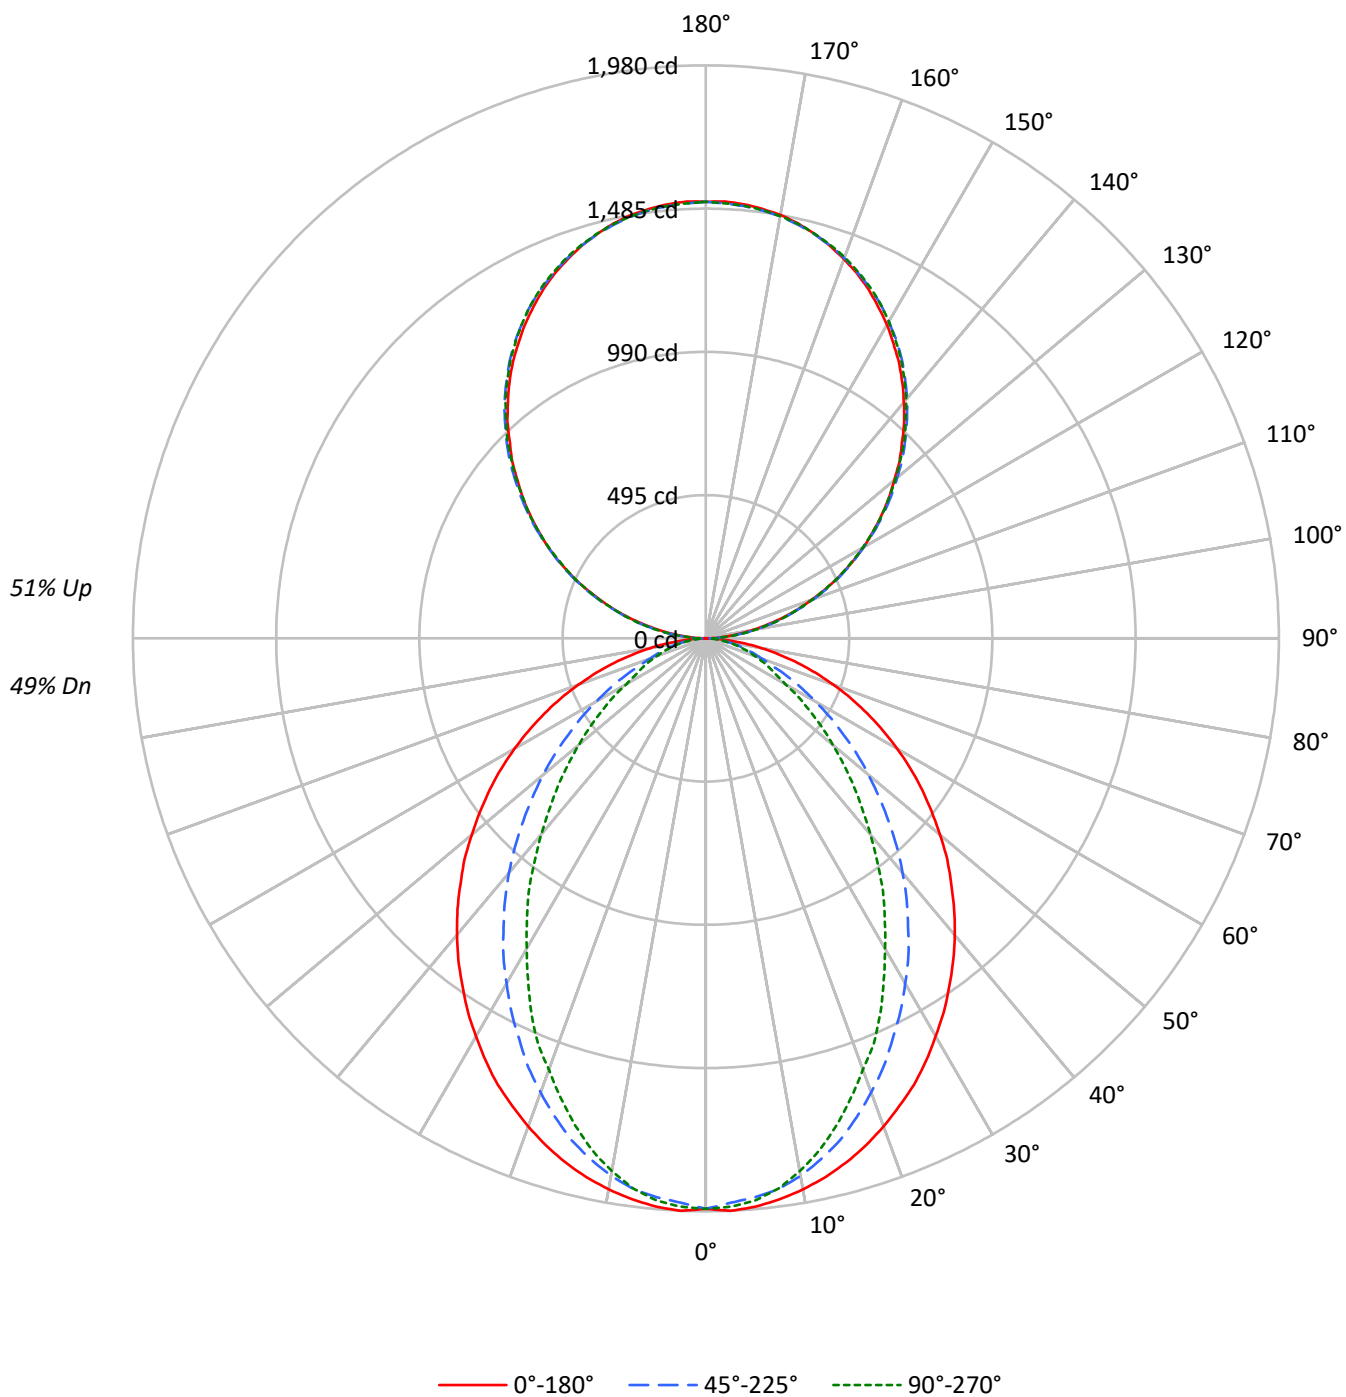

TEST NUMBER: P924072

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2247	2247	2247
5°	2249	2210	2224
10°	2225	2165	2151
15°	2193	2092	2039
20°	2151	1992	1901
25°	2108	1880	1768
30°	2051	1765	1599
35°	1995	1642	1451
40°	1938	1515	1281
45°	1871	1374	1128
50°	1803	1232	978
55°	1731	1081	833
60°	1648	922	685
65°	1551	762	616
70°	1435	612	556
75°	1289	536	505
80°	1077	446	435
85°	731	290	323

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1871 cd/sqm

TEST NUMBER: P924072

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	2.2
10°-20°	507.2	6.1
20°-30°	712.1	8.6
30°-40°	776.3	9.4
40°-50°	713.5	8.6
50°-60°	560.3	6.8
60°-70°	364.7	4.4
70°-80°	187.7	2.3
80°-90°	52.2	0.6
90°-100°	93.4	1.1
100°-110°	296.6	3.6
110°-120°	507.6	6.1
120°-130°	667.5	8.1
130°-140°	749.3	9.1
140°-150°	734.8	8.9
150°-160°	616.4	7.4
160°-170°	408.8	4.9
170°-180°	142.9	1.7
0°-30°	1404.1	17.0
0°-40°	2180.4	26.3
0°-60°	3454.1	41.7
0°-90°	4058.8	49.0
90°-120°	897.5	10.8
90°-150°	3049.2	36.8
90°-180°	4217.0	51.0
0°-180°	8276.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	16	45	42	43	8
95°	66	79	81	81	79	74
105°	274	277	280	282	282	289
115°	509	517	514	513	509	504
125°	741	752	749	744	743	662
135°	958	972	975	974	970	741
145°	1163	1172	1180	1181	1176	727
155°	1330	1334	1338	1344	1340	612
165°	1447	1446	1446	1455	1449	408
175°	1506	1502	1500	1509	1501	143
180°	1509	1509	1509	1509	1509	

TEST NUMBER: P924072

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.3	16.4	44.6	41.9	43.2
92.5°	28.2	38.2	39.6	40.9	40.9
95°	66.4	79.2	81.4	81.4	79.2
97.5°	110.5	122.3	127.4	127.4	127.4
100°	161.4	171.9	175.5	175.5	174.2
102.5°	215.1	222.9	227.8	229.2	227.8
105°	273.8	277.4	280.2	282.4	282.4
107.5°	332.0	337.4	337.4	338.4	332.0
110°	388.4	395.7	395.7	395.7	392.0

TEST NUMBER: P924072

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	449.3	457.1	455.7	452.1	449.3
115°	509.3	516.7	514.4	513.1	509.3
117.5°	569.0	579.0	572.6	569.0	565.3
120°	629.0	639.0	629.0	629.0	624.9
122.5°	683.5	696.3	689.9	686.3	683.5
125°	740.9	752.2	748.6	744.5	743.2
127.5°	796.8	810.9	805.9	800.4	796.8
130°	849.2	865.5	863.2	860.5	855.5
132.5°	907.8	920.5	921.5	915.1	911.5
135°	958.3	972.3	975.1	973.7	970.1
137.5°	1014.7	1026.0	1028.3	1027.4	1021.9
140°	1064.2	1075.6	1081.9	1081.9	1077.0
142.5°	1115.1	1126.6	1130.2	1131.5	1126.6
145°	1163.4	1172.5	1179.7	1181.1	1176.1
147.5°	1206.6	1218.0	1223.4	1225.7	1220.6
150°	1251.2	1258.9	1263.9	1268.0	1263.9
152.5°	1290.8	1298.5	1304.8	1309.8	1304.8
155°	1330.3	1333.9	1338.0	1344.4	1340.3
157.5°	1364.4	1367.1	1369.4	1378.5	1372.1
160°	1394.8	1397.6	1398.9	1406.7	1401.2
162.5°	1423.1	1423.1	1424.4	1433.1	1426.7
165°	1447.2	1445.8	1445.8	1454.9	1448.6
167.5°	1469.0	1464.9	1464.9	1474.0	1467.6
170°	1485.4	1481.8	1480.4	1489.5	1481.8
172.5°	1496.7	1493.1	1491.8	1500.8	1493.1
175°	1505.9	1502.2	1499.5	1508.6	1500.8
177.5°	1510.8	1507.2	1504.5	1512.2	1504.5
180°	1508.6	1508.6	1508.6	1508.6	1508.6

TEST NUMBER: P924072

CATALOG NUMBER: DFN2DIP-4P3F0-050D050US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.83	10.66	10.81	11.64	12.93	5.79	6.62	6.77	7.60	8.89
	3H	11.51	12.24	12.49	13.23	14.54	6.98	7.71	7.96	8.70	10.01
	4H	12.11	12.81	13.11	13.80	15.12	7.42	8.12	8.42	9.11	10.43
	6H	12.53	13.17	13.54	14.17	15.50	7.74	8.38	8.74	9.38	10.71
	8H	12.65	13.26	13.67	14.28	15.60	7.82	8.43	8.84	9.45	10.77
	12H	12.71	13.29	13.73	14.30	15.65	7.86	8.44	8.88	9.45	10.80
4H	2H	9.85	10.54	10.85	11.54	12.86	6.39	7.08	7.39	8.08	9.39
	3H	11.67	12.25	12.68	13.27	14.61	7.73	8.31	8.74	9.33	10.66
	4H	12.36	12.89	13.38	13.91	15.26	8.27	8.80	9.29	9.82	11.17
	6H	12.87	13.32	13.90	14.36	15.72	8.68	9.14	9.71	10.18	11.53
	8H	13.04	13.47	14.07	14.50	15.87	8.81	9.23	9.84	10.26	11.63
	12H	13.14	13.52	14.18	14.57	15.94	8.87	9.25	9.92	10.30	11.67
8H	4H	12.33	12.75	13.36	13.78	15.15	8.55	8.97	9.58	10.00	11.37
	6H	12.89	13.24	13.94	14.31	15.67	9.06	9.41	10.11	10.48	11.84
	8H	13.10	13.41	14.16	14.47	15.85	9.24	9.55	10.30	10.61	11.99
	12H	13.24	13.51	14.30	14.56	15.98	9.36	9.63	10.42	10.68	12.11
12H	4H	12.28	12.66	13.33	13.71	15.08	8.55	8.93	9.60	9.98	11.35
	6H	12.86	13.17	13.92	14.23	15.61	9.11	9.41	10.17	10.47	11.85
	8H	13.08	13.35	14.14	14.40	15.83	9.31	9.58	10.37	10.63	12.06

END OF REPORT