

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924090

Luminaire Tested: DFN2DIP-4P3F0-060D050US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924090
REPORT IS A COMBINATION OF REPORTS P899067 AND P895917
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-060D050US950-FLLFLL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9888.2 lumens
Efficiency: N/A
Efficacy: 98.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 100.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924090

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLFLL

Luminous Intensity Polar Plot

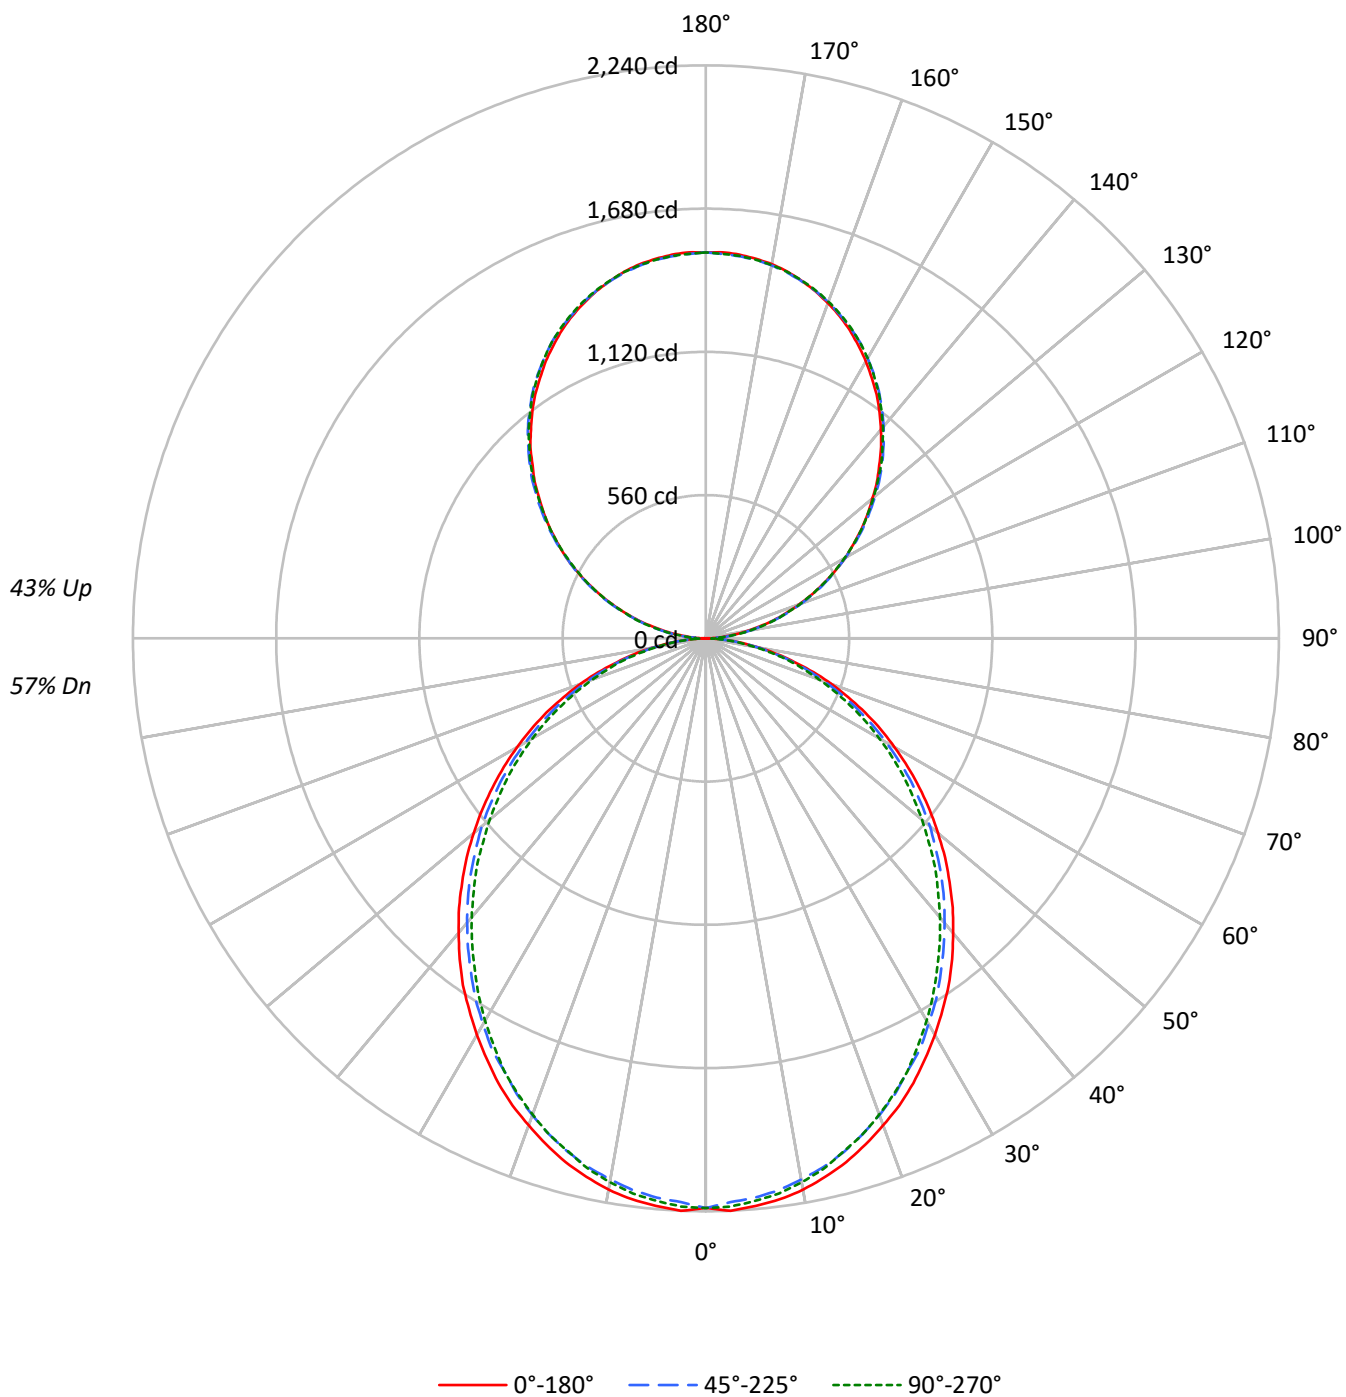

TEST NUMBER: P924090

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	75	75	75	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	56	54	53
2	91	83	77	72	84	78	72	67	67	63	60	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	41	38
4	76	65	57	51	70	61	53	48	53	47	43	46	41	38	39	36	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	23	30	24	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2538	2538	2538
5°	2541	2501	2519
10°	2518	2466	2484
15°	2480	2424	2430
20°	2428	2365	2375
25°	2377	2296	2311
30°	2313	2232	2230
35°	2252	2156	2144
40°	2177	2080	2062
45°	2103	2003	1979
50°	2021	1922	1882
55°	1936	1829	1793
60°	1839	1718	1691
65°	1733	1603	1571
70°	1598	1463	1441
75°	1412	1295	1320
80°	1187	1081	1091
85°	836	716	715

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2103 cd/sqm

TEST NUMBER: P924090

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	2.1
10°-20°	589.8	6.0
20°-30°	866.8	8.8
30°-40°	1006.7	10.2
40°-50°	1005.5	10.2
50°-60°	876.7	8.9
60°-70°	648.1	6.6
70°-80°	366.7	3.7
80°-90°	101.1	1.0
90°-100°	93.4	0.9
100°-110°	296.6	3.0
110°-120°	507.6	5.1
120°-130°	667.5	6.8
130°-140°	749.3	7.6
140°-150°	734.8	7.4
150°-160°	616.4	6.2
160°-170°	408.8	4.1
170°-180°	142.9	1.4
0°-30°	1666.2	16.9
0°-40°	2673.0	27.0
0°-60°	4555.2	46.1
0°-90°	5671.1	57.4
90°-120°	897.5	9.1
90°-150°	3049.2	30.8
90°-180°	4217.0	42.6
0°-180°	9888.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	1	16	45	42	43	10
95°	66	79	81	81	79	74
105°	274	277	280	282	282	289
115°	509	517	514	513	509	504
125°	741	752	749	744	743	662
135°	958	972	975	974	970	741
145°	1163	1172	1180	1181	1176	727
155°	1330	1334	1338	1344	1340	612
165°	1447	1446	1446	1455	1449	408
175°	1506	1502	1500	1509	1501	143
180°	1509	1509	1509	1509	1509	

TEST NUMBER: P924090

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	1.3	16.4	44.6	41.9	43.2
92.5°	28.2	38.2	39.6	40.9	40.9
95°	66.4	79.2	81.4	81.4	79.2
97.5°	110.5	122.3	127.4	127.4	127.4
100°	161.4	171.9	175.5	175.5	174.2
102.5°	215.1	222.9	227.8	229.2	227.8
105°	273.8	277.4	280.2	282.4	282.4
107.5°	332.0	337.4	337.4	338.4	332.0
110°	388.4	395.7	395.7	395.7	392.0

TEST NUMBER: P924090

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	449.3	457.1	455.7	452.1	449.3
115°	509.3	516.7	514.4	513.1	509.3
117.5°	569.0	579.0	572.6	569.0	565.3
120°	629.0	639.0	629.0	629.0	624.9
122.5°	683.5	696.3	689.9	686.3	683.5
125°	740.9	752.2	748.6	744.5	743.2
127.5°	796.8	810.9	805.9	800.4	796.8
130°	849.2	865.5	863.2	860.5	855.5
132.5°	907.8	920.5	921.5	915.1	911.5
135°	958.3	972.3	975.1	973.7	970.1
137.5°	1014.7	1026.0	1028.3	1027.4	1021.9
140°	1064.2	1075.6	1081.9	1081.9	1077.0
142.5°	1115.1	1126.6	1130.2	1131.5	1126.6
145°	1163.4	1172.5	1179.7	1181.1	1176.1
147.5°	1206.6	1218.0	1223.4	1225.7	1220.6
150°	1251.2	1258.9	1263.9	1268.0	1263.9
152.5°	1290.8	1298.5	1304.8	1309.8	1304.8
155°	1330.3	1333.9	1338.0	1344.4	1340.3
157.5°	1364.4	1367.1	1369.4	1378.5	1372.1
160°	1394.8	1397.6	1398.9	1406.7	1401.2
162.5°	1423.1	1423.1	1424.4	1433.1	1426.7
165°	1447.2	1445.8	1445.8	1454.9	1448.6
167.5°	1469.0	1464.9	1464.9	1474.0	1467.6
170°	1485.4	1481.8	1480.4	1489.5	1481.8
172.5°	1496.7	1493.1	1491.8	1500.8	1493.1
175°	1505.9	1502.2	1499.5	1508.6	1500.8
177.5°	1510.8	1507.2	1504.5	1512.2	1504.5
180°	1508.6	1508.6	1508.6	1508.6	1508.6

TEST NUMBER: P924090

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.13	12.06	12.02	12.97	14.13	10.68	11.61	11.57	12.53	13.69
	3H	12.79	13.62	13.69	14.54	15.73	12.30	13.13	13.20	14.05	15.24
	4H	13.38	14.17	14.29	15.09	16.29	12.88	13.67	13.80	14.60	15.79
	6H	13.78	14.50	14.71	15.44	16.65	13.28	14.00	14.21	14.94	16.15
	8H	13.88	14.57	14.82	15.52	16.73	13.38	14.07	14.32	15.02	16.23
	12H	13.93	14.59	14.87	15.53	16.77	13.42	14.08	14.36	15.02	16.26
4H	2H	11.59	12.38	12.52	13.31	14.51	11.24	12.03	12.16	12.95	14.15
	3H	13.46	14.12	14.39	15.08	16.29	13.05	13.71	13.99	14.67	15.88
	4H	14.17	14.77	15.12	15.73	16.96	13.75	14.35	14.69	15.30	16.54
	6H	14.69	15.21	15.64	16.18	17.42	14.25	14.77	15.21	15.75	16.99
	8H	14.84	15.32	15.80	16.29	17.54	14.40	14.88	15.36	15.85	17.10
	12H	14.91	15.35	15.89	16.34	17.59	14.46	14.90	15.44	15.89	17.14
8H	4H	14.37	14.86	15.33	15.83	17.08	13.99	14.48	14.95	15.45	16.70
	6H	15.00	15.40	15.98	16.41	17.66	14.61	15.02	15.60	16.03	17.28
	8H	15.22	15.57	16.21	16.57	17.84	14.82	15.18	15.82	16.18	17.45
	12H	15.35	15.66	16.35	16.65	17.97	14.94	15.25	15.94	16.24	17.56
12H	4H	14.36	14.80	15.34	15.78	17.04	13.99	14.43	14.97	15.41	16.67
	6H	15.03	15.38	16.02	16.38	17.65	14.65	15.01	15.65	16.01	17.28
	8H	15.27	15.58	16.27	16.57	17.89	14.89	15.20	15.89	16.19	17.51

END OF REPORT