

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924091

Luminaire Tested: DFN2DIP-4P3F0-060D050US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924091
REPORT IS A COMBINATION OF REPORTS P900587 AND P897473
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-060D050US950-FLLONL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10389.1 lumens
Efficiency: N/A
Efficacy: 103.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 100.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924091

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLONL

Luminous Intensity Polar Plot

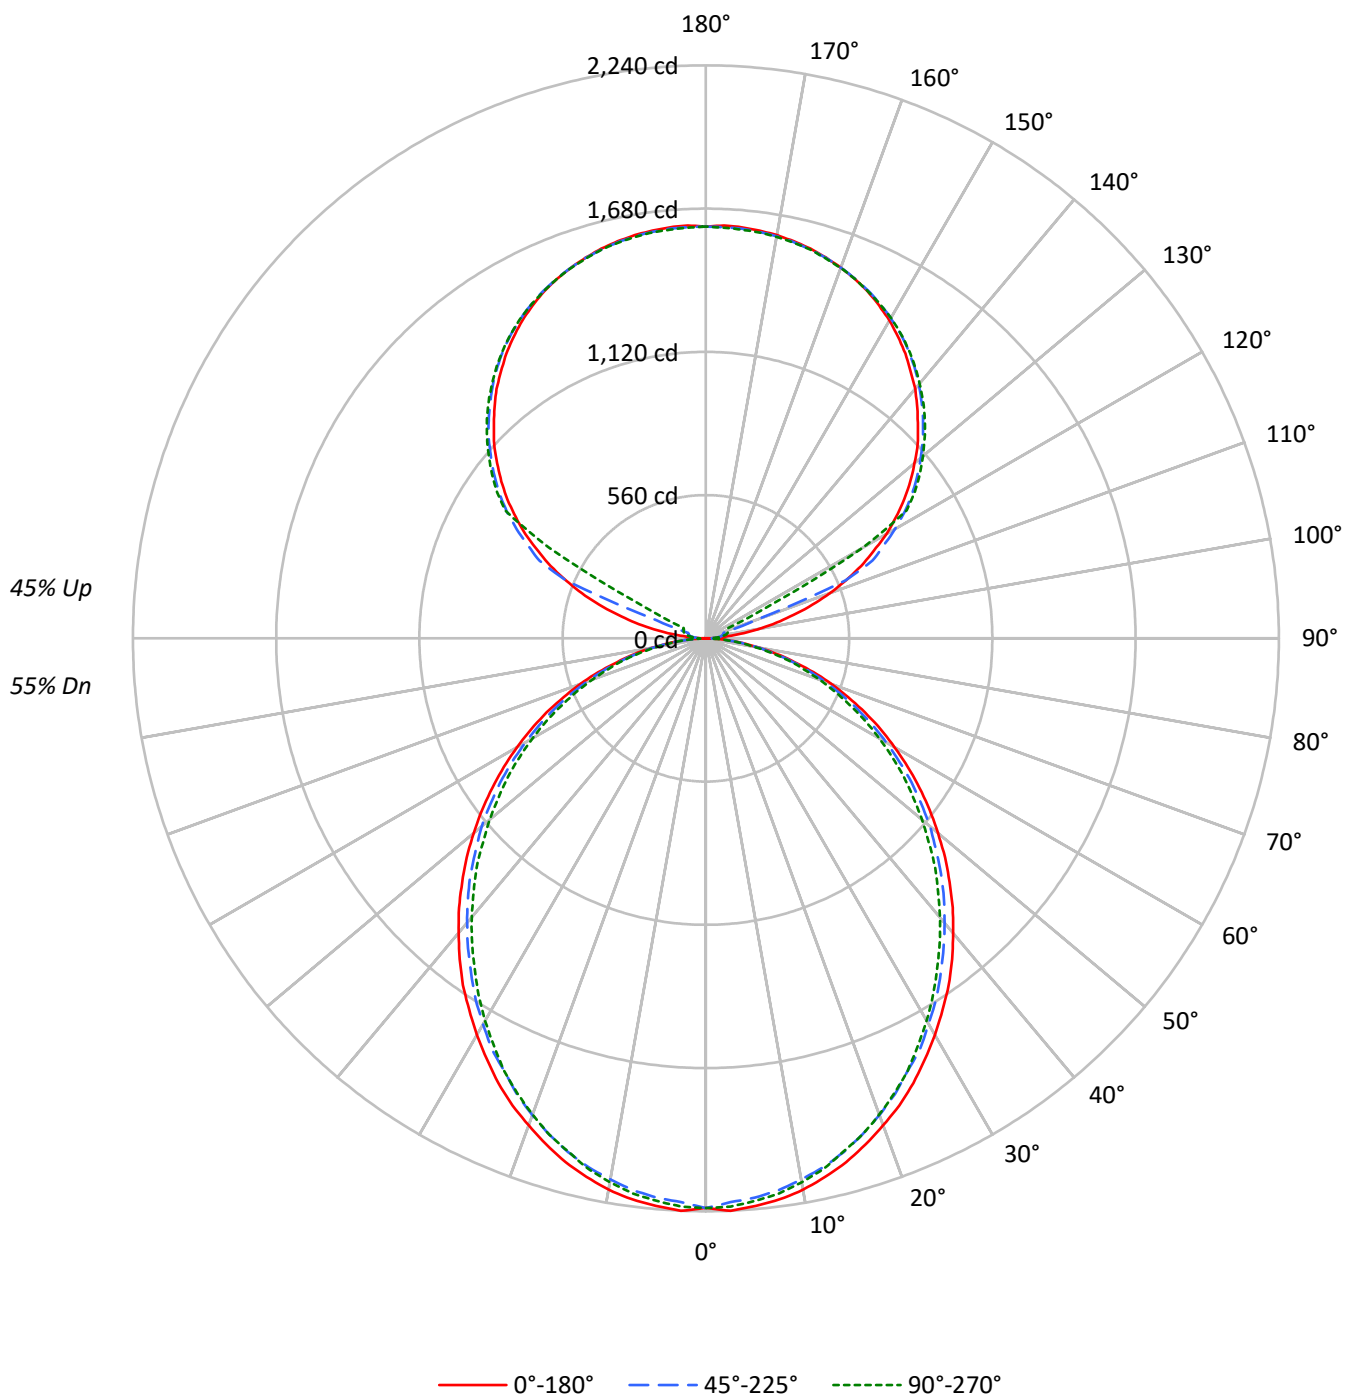

TEST NUMBER: P924091

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2538	2538	2538
5°	2541	2501	2519
10°	2518	2466	2484
15°	2480	2424	2430
20°	2428	2365	2375
25°	2377	2296	2311
30°	2313	2232	2230
35°	2252	2156	2144
40°	2177	2080	2062
45°	2103	2003	1979
50°	2021	1922	1882
55°	1936	1829	1793
60°	1839	1718	1691
65°	1733	1603	1571
70°	1598	1463	1441
75°	1412	1295	1320
80°	1187	1081	1091
85°	836	716	715

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2103 cd/sqm

TEST NUMBER: P924091

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	2.0
10°-20°	589.8	5.7
20°-30°	866.8	8.3
30°-40°	1006.7	9.7
40°-50°	1005.5	9.7
50°-60°	876.7	8.4
60°-70°	648.1	6.2
70°-80°	366.7	3.5
80°-90°	99.6	1.0
90°-100°	53.1	0.5
100°-110°	197.9	1.9
110°-120°	524.8	5.1
120°-130°	870.4	8.4
130°-140°	924.6	8.9
140°-150°	859.3	8.3
150°-160°	690.9	6.7
160°-170°	445.2	4.3
170°-180°	153.2	1.5
0°-30°	1666.2	16.0
0°-40°	2673.0	25.7
0°-60°	4555.2	43.8
0°-90°	5669.6	54.6
90°-120°	775.8	7.5
90°-150°	3430.2	33.0
90°-180°	4719.0	45.4
0°-180°	10389.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	1	14	23	29	31	10
95°	76	37	45	51	50	90
105°	354	389	71	84	88	378
115°	670	690	719	179	96	659
125°	947	962	984	992	996	845
135°	1172	1191	1201	1213	1210	905
145°	1359	1358	1378	1386	1380	850
155°	1497	1486	1500	1507	1498	690
165°	1577	1570	1574	1582	1574	446
175°	1613	1605	1608	1616	1604	154
180°	1610	1610	1610	1610	1610	

TEST NUMBER: P924091

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	1.1	13.9	23.3	29.2	31.4
92.5°	29.2	24.5	28.0	30.3	31.4
95°	75.7	37.2	45.4	51.3	50.1
97.5°	136.2	40.8	59.3	63.0	64.0
100°	206.3	46.7	66.4	75.7	78.0
102.5°	283.1	280.8	68.8	81.5	85.1
105°	354.1	389.1	71.1	83.9	88.5
107.5°	436.8	465.8	73.5	86.1	90.9
110°	516.1	540.4	203.9	87.4	92.0

TEST NUMBER: P924091

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	590.6	611.5	591.8	89.7	93.2
115°	669.8	689.6	718.7	179.4	95.6
117.5°	738.5	761.8	781.7	614.9	309.9
120°	815.4	832.8	853.8	867.9	710.5
122.5°	880.5	899.2	922.6	929.6	930.8
125°	946.9	962.2	984.3	992.4	996.0
127.5°	1007.5	1023.8	1041.5	1053.0	1054.2
130°	1064.7	1083.4	1096.1	1108.9	1107.9
132.5°	1123.0	1138.1	1150.8	1161.4	1160.3
135°	1171.9	1190.6	1200.9	1212.7	1210.3
137.5°	1223.0	1237.1	1248.8	1260.4	1257.0
140°	1273.1	1282.6	1295.2	1305.7	1300.0
142.5°	1315.2	1323.4	1338.5	1347.7	1341.9
145°	1359.4	1358.2	1378.0	1386.2	1380.3
147.5°	1397.8	1394.3	1414.1	1419.9	1415.4
150°	1435.1	1427.0	1445.6	1452.6	1446.7
152.5°	1466.5	1457.2	1474.7	1481.8	1473.5
155°	1496.8	1486.4	1500.4	1507.3	1498.1
157.5°	1521.2	1512.0	1522.5	1530.7	1521.2
160°	1542.3	1535.3	1542.3	1549.2	1541.1
162.5°	1560.8	1554.0	1559.7	1567.9	1557.4
165°	1577.2	1570.3	1573.7	1581.8	1573.7
167.5°	1590.0	1583.0	1586.6	1594.7	1584.2
170°	1600.5	1593.5	1595.9	1604.0	1593.5
172.5°	1607.5	1600.5	1602.9	1611.0	1600.5
175°	1613.3	1605.1	1607.5	1615.6	1604.0
177.5°	1615.6	1607.5	1608.7	1616.8	1606.3
180°	1609.8	1609.8	1609.8	1609.8	1609.8

TEST NUMBER: P924091

CATALOG NUMBER: DFN2DIP-4P3F0-060D050US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.89	11.79	11.80	12.73	13.93	10.44	11.35	11.36	12.28	13.49
	3H	12.55	13.36	13.48	14.30	15.53	12.06	12.87	12.98	13.81	15.04
	4H	13.13	13.90	14.08	14.85	16.09	12.64	13.41	13.58	14.36	15.59
	6H	13.53	14.24	14.49	15.19	16.44	13.03	13.74	13.99	14.69	15.94
	8H	13.64	14.31	14.60	15.28	16.53	13.13	13.81	14.10	14.78	16.03
	12H	13.68	14.33	14.65	15.29	16.56	13.17	13.82	14.14	14.78	16.06
4H	2H	11.35	12.12	12.30	13.07	14.30	11.00	11.76	11.94	12.71	13.95
	3H	13.21	13.85	14.17	14.83	16.09	12.81	13.45	13.77	14.43	15.68
	4H	13.93	14.51	14.90	15.49	16.76	13.50	14.09	14.47	15.06	16.34
	6H	14.44	14.94	15.42	15.94	17.22	14.01	14.51	14.99	15.51	16.78
	8H	14.59	15.06	15.57	16.05	17.34	14.15	14.62	15.13	15.61	16.90
	12H	14.66	15.09	15.66	16.09	17.39	14.21	14.64	15.21	15.64	16.94
8H	4H	14.12	14.59	15.11	15.58	16.87	13.75	14.22	14.73	15.21	16.50
	6H	14.75	15.14	15.76	16.17	17.46	14.37	14.76	15.37	15.79	17.08
	8H	14.97	15.31	15.98	16.33	17.64	14.57	14.92	15.59	15.94	17.24
	12H	15.10	15.40	16.12	16.41	17.77	14.69	14.99	15.71	16.00	17.35
12H	4H	14.11	14.53	15.11	15.54	16.84	13.74	14.17	14.74	15.17	16.47
	6H	14.78	15.12	15.79	16.14	17.45	14.41	14.75	15.42	15.77	17.08
	8H	15.02	15.32	16.04	16.33	17.69	14.64	14.94	15.66	15.95	17.31

END OF REPORT