

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905135

Luminaire Tested: DFN2DIP-4P4F0-080D060US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905135
REPORT IS A COMBINATION OF REPORTS P900645 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-080D060US835-FLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13860.0 lumens
Efficiency: N/A
Efficacy: 101.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 136.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905135

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US835-FLLONL

Luminous Intensity Polar Plot

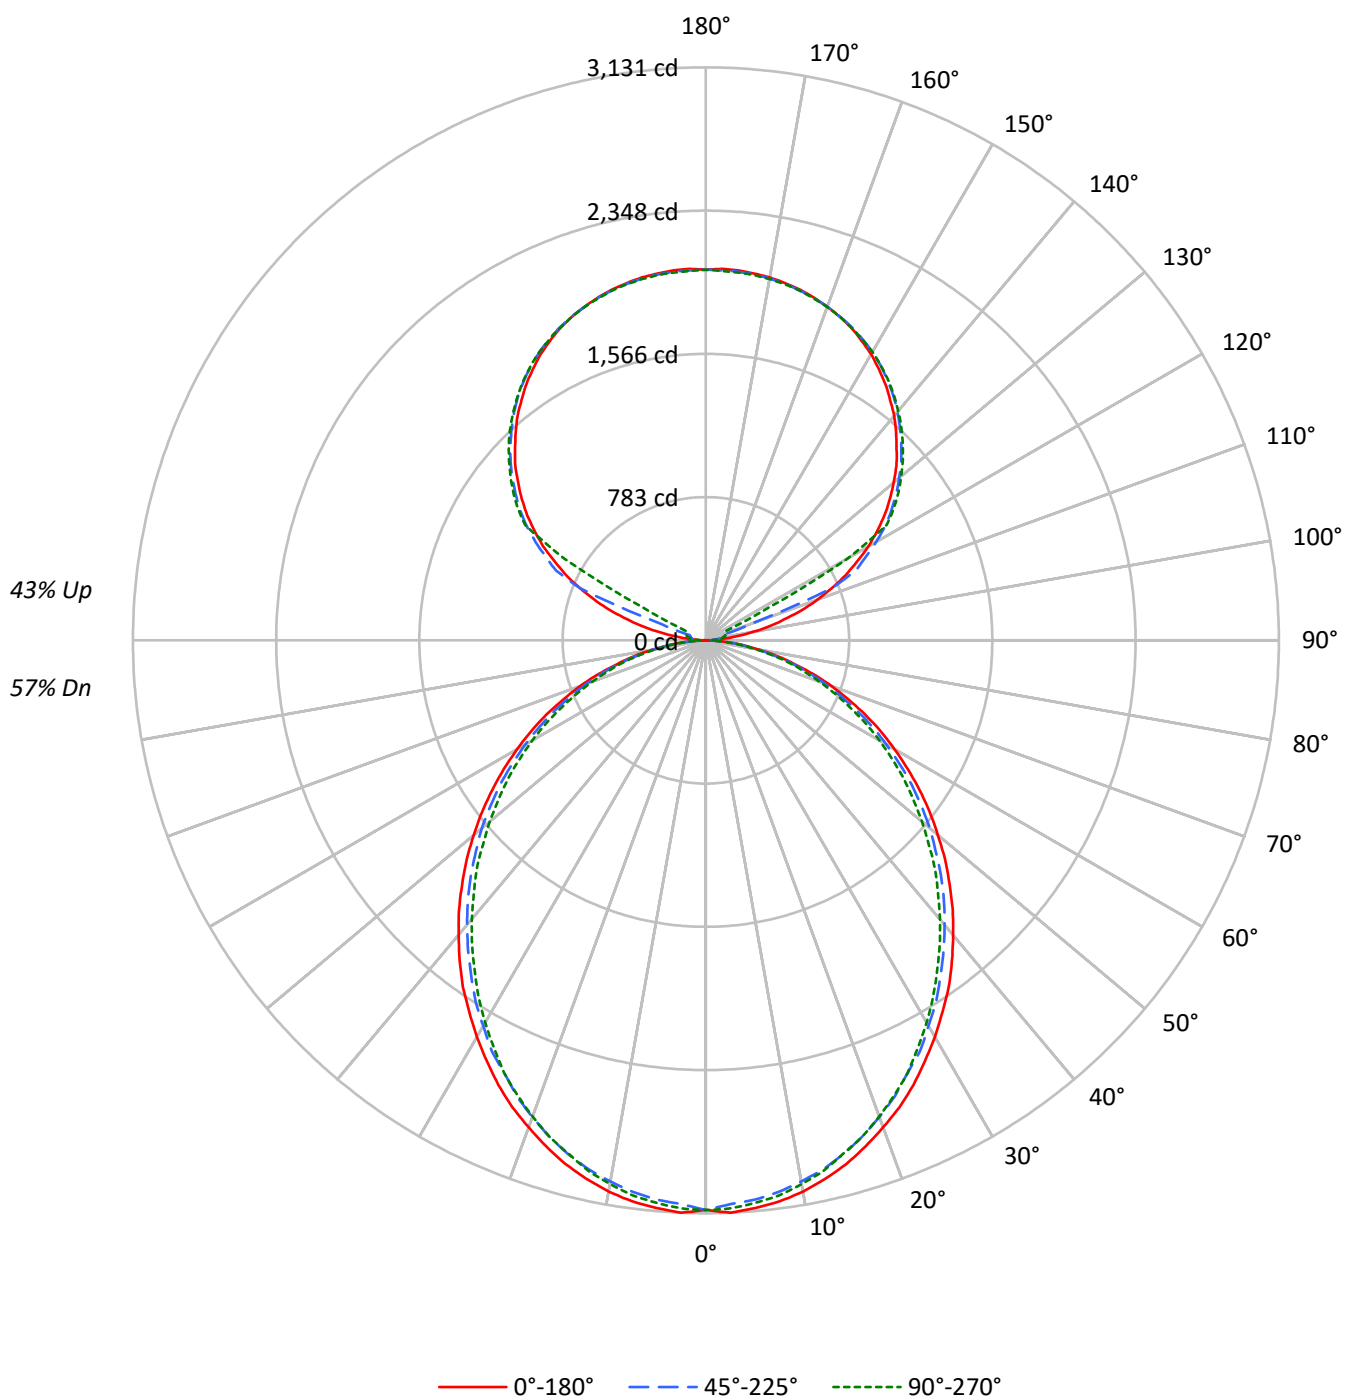

TEST NUMBER: P905135

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	31	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2019	2019	2019
5°	2023	1992	2005
10°	2007	1966	1979
15°	1977	1934	1937
20°	1937	1890	1895
25°	1898	1837	1845
30°	1848	1787	1782
35°	1801	1729	1715
40°	1744	1670	1652
45°	1686	1611	1587
50°	1623	1549	1512
55°	1557	1477	1443
60°	1483	1392	1364
65°	1401	1304	1270
70°	1298	1197	1170
75°	1154	1069	1079
80°	982	906	903
85°	713	623	609

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1686 cd/sqm

TEST NUMBER: P905135

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.0	2.1
10°-20°	824.3	5.9
20°-30°	1211.5	8.7
30°-40°	1407.0	10.2
40°-50°	1405.3	10.1
50°-60°	1225.4	8.8
60°-70°	905.8	6.5
70°-80°	512.5	3.7
80°-90°	138.8	1.0
90°-100°	66.8	0.5
100°-110°	248.9	1.8
110°-120°	660.2	4.8
120°-130°	1094.9	7.9
130°-140°	1163.0	8.4
140°-150°	1080.9	7.8
150°-160°	869.0	6.3
160°-170°	560.0	4.0
170°-180°	192.7	1.4
0°-30°	2328.8	16.8
0°-40°	3735.8	27.0
0°-60°	6366.4	45.9
0°-90°	7923.6	57.2
90°-120°	975.8	7.0
90°-150°	4314.7	31.1
90°-180°	5936.0	42.8
0°-180°	13860.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3113	3113	3113	3113	3113	
5°	3113	3101	3068	3092	3086	295
15°	2963	2946	2906	2918	2904	835
25°	2682	2658	2607	2613	2607	1234
35°	2314	2284	2236	2218	2203	1445
45°	1883	1862	1817	1784	1772	1453
55°	1425	1407	1371	1335	1320	1274
65°	961	943	913	886	871	950
75°	503	497	482	464	470	537
85°	123	120	117	108	105	137
90°	1	18	29	37	40	13
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P905135

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3112.8	3112.8	3112.8	3112.8	3112.8
2.5°	3130.9	3116.0	3083.0	3112.8	3107.1
5°	3112.8	3101.1	3068.1	3091.9	3086.2
7.5°	3091.9	3074.1	3041.1	3065.2	3059.2
10°	3059.2	3038.2	3002.3	3026.1	3017.3
12.5°	3014.1	2996.3	2960.4	2975.3	2969.3
15°	2963.3	2945.5	2906.4	2918.5	2903.6
17.5°	2900.4	2882.6	2843.5	2858.5	2843.5
20°	2831.5	2813.7	2771.8	2780.7	2768.9
22.5°	2762.9	2735.9	2696.8	2696.8	2690.8
25°	2681.9	2658.1	2607.3	2613.0	2607.3
27.5°	2592.0	2571.1	2532.3	2523.4	2508.5
30°	2502.5	2478.3	2433.6	2424.7	2412.6
32.5°	2406.6	2388.8	2340.8	2322.7	2310.7
35°	2313.8	2284.0	2236.0	2217.9	2203.0
37.5°	2209.0	2182.0	2134.1	2113.1	2098.2
40°	2101.4	2077.2	2029.3	2002.6	1990.5
42.5°	1996.6	1972.4	1924.8	1894.6	1876.9
45°	1882.9	1861.9	1816.8	1784.1	1772.1
47.5°	1772.1	1751.1	1703.1	1670.1	1652.3
50°	1655.2	1640.3	1598.3	1556.4	1541.5
52.5°	1541.5	1520.5	1481.8	1448.8	1427.8
55°	1424.9	1406.8	1371.0	1335.1	1320.1
57.5°	1308.1	1293.2	1254.1	1218.2	1206.1
60°	1191.2	1179.5	1137.5	1104.5	1095.6
62.5°	1077.5	1056.6	1026.7	996.9	984.8
65°	961.0	942.9	913.0	886.0	871.1
67.5°	841.2	826.0	799.3	778.4	766.3
70°	730.4	718.3	691.4	670.4	658.6
72.5°	616.7	604.7	589.7	568.8	559.9
75°	502.7	497.0	481.8	464.0	470.0
77.5°	401.1	389.0	383.0	374.1	365.2
80°	299.5	296.3	290.3	281.4	275.3
82.5°	203.6	203.6	200.7	188.6	188.6
85°	122.6	119.7	116.9	107.7	104.8
87.5°	54.0	48.0	41.9	33.0	29.9
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7

TEST NUMBER: P905135

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P905135

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.37	11.30	11.26	12.21	13.38	9.93	10.85	10.82	11.77	12.93
	3H	12.04	12.88	12.95	13.80	14.99	11.55	12.38	12.46	13.31	14.50
	4H	12.64	13.42	13.56	14.35	15.55	12.14	12.93	13.06	13.86	15.06
	6H	13.04	13.77	13.98	14.70	15.92	12.54	13.27	13.47	14.20	15.42
	8H	13.15	13.85	14.09	14.80	16.01	12.65	13.34	13.59	14.29	15.51
	12H	13.21	13.86	14.15	14.81	16.05	12.70	13.35	13.64	14.30	15.54
4H	2H	10.84	11.63	11.77	12.56	13.76	10.49	11.27	11.41	12.20	13.40
	3H	12.72	13.38	13.65	14.34	15.55	12.31	12.97	13.25	13.93	15.14
	4H	13.44	14.04	14.39	14.99	16.23	13.02	13.62	13.96	14.57	15.81
	6H	13.96	14.48	14.92	15.46	16.70	13.53	14.05	14.49	15.03	16.27
	8H	14.12	14.60	15.08	15.57	16.83	13.68	14.17	14.64	15.14	16.39
	12H	14.20	14.64	15.18	15.62	16.88	13.75	14.19	14.73	15.17	16.43
8H	4H	13.64	14.13	14.60	15.10	16.35	13.27	13.75	14.23	14.72	15.97
	6H	14.28	14.68	15.27	15.70	16.95	13.90	14.30	14.89	15.31	16.56
	8H	14.51	14.86	15.51	15.86	17.13	14.12	14.47	15.11	15.47	16.74
	12H	14.65	14.96	15.65	15.95	17.27	14.24	14.55	15.24	15.54	16.86
12H	4H	13.63	14.07	14.61	15.06	16.32	13.26	13.70	14.25	14.69	15.95
	6H	14.31	14.67	15.31	15.67	16.94	13.94	14.30	14.94	15.30	16.57
	8H	14.56	14.88	15.56	15.87	17.19	14.18	14.50	15.18	15.49	16.81

END OF REPORT