

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910491

Luminaire Tested: DFN2DIP-4P4F0-040D050US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910491
REPORT IS A COMBINATION OF REPORTS P900625 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-040D050US850-FLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9881.2 lumens
Efficiency: N/A
Efficacy: 125.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 79
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910491

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US850-FLLONL

Luminous Intensity Polar Plot

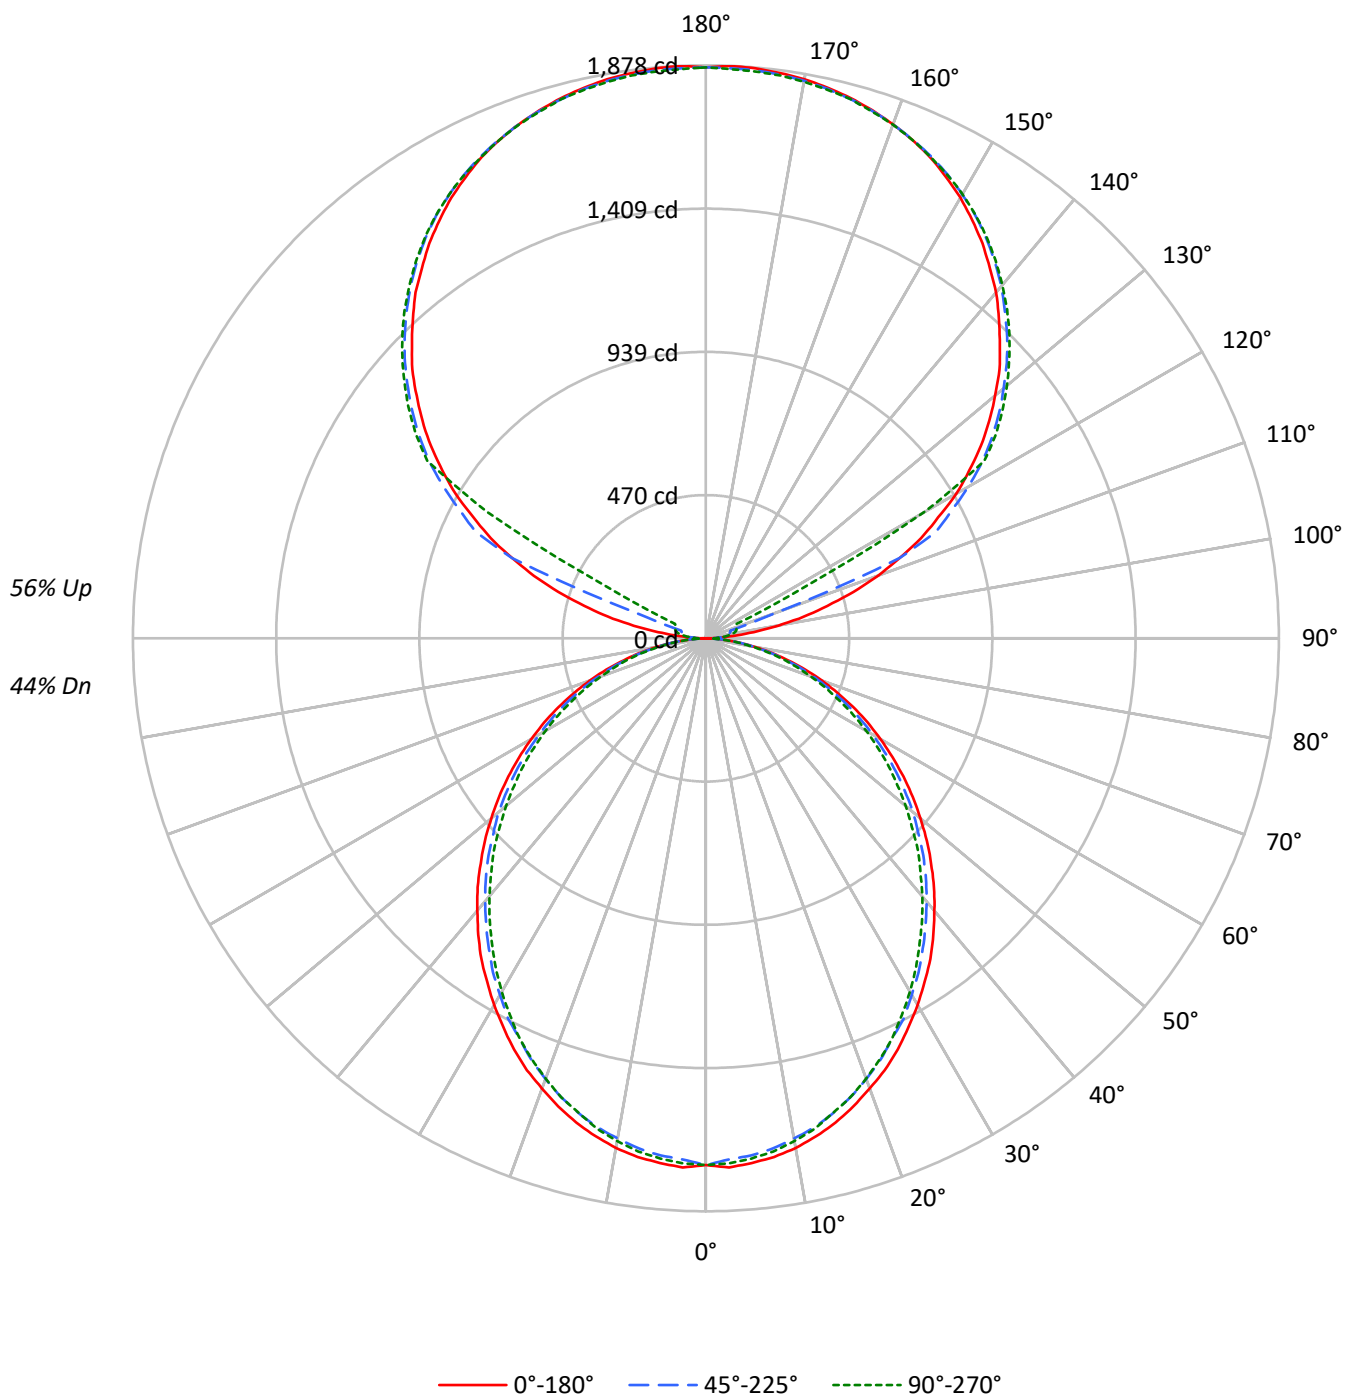

TEST NUMBER: P910491

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US850-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	25	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1120	1120	1120
5°	1122	1104	1112
10°	1113	1090	1097
15°	1096	1072	1074
20°	1074	1048	1051
25°	1052	1018	1023
30°	1025	991	988
35°	999	959	951
40°	967	926	916
45°	935	893	880
50°	900	859	838
55°	863	819	800
60°	822	772	756
65°	777	723	704
70°	720	664	649
75°	640	593	598
80°	544	502	501
85°	395	345	338

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 965 cd/sqm

TEST NUMBER: P910491

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	162.5	1.6
10°-20°	457.1	4.6
20°-30°	671.7	6.8
30°-40°	780.2	7.9
40°-50°	779.2	7.9
50°-60°	679.5	6.9
60°-70°	502.3	5.1
70°-80°	284.2	2.9
80°-90°	78.3	0.8
90°-100°	61.7	0.6
100°-110°	230.0	2.3
110°-120°	610.1	6.2
120°-130°	1011.9	10.2
130°-140°	1074.8	10.9
140°-150°	999.0	10.1
150°-160°	803.1	8.1
160°-170°	517.5	5.2
170°-180°	178.1	1.8
0°-30°	1291.3	13.1
0°-40°	2071.5	21.0
0°-60°	3530.2	35.7
0°-90°	4394.9	44.5
90°-120°	901.9	9.1
90°-150°	3987.5	40.4
90°-180°	5486.0	55.5
0°-180°	9881.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1726	1726	1726	1726	1726	
5°	1726	1720	1701	1714	1711	164
15°	1643	1633	1612	1618	1610	463
25°	1487	1474	1446	1449	1446	684
35°	1283	1266	1240	1230	1222	801
45°	1044	1032	1007	989	983	806
55°	790	780	760	740	732	706
65°	533	523	506	491	483	527
75°	279	276	267	257	261	298
85°	68	66	65	60	58	76
90°	1	16	27	34	36	9
95°	88	43	53	60	58	104
105°	412	452	83	98	103	440
115°	779	802	836	209	111	767
125°	1101	1118	1144	1154	1158	982
135°	1362	1384	1396	1410	1407	1052
145°	1580	1579	1602	1611	1605	988
155°	1740	1728	1744	1752	1742	802
165°	1833	1825	1829	1839	1829	518
175°	1875	1866	1869	1878	1865	178
180°	1871	1871	1871	1871	1871	

TEST NUMBER: P910491

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1726.0	1726.0	1726.0	1726.0	1726.0
2.5°	1736.1	1727.8	1709.5	1726.0	1722.9
5°	1726.0	1719.5	1701.2	1714.4	1711.3
7.5°	1714.4	1704.5	1686.2	1699.7	1696.3
10°	1696.3	1684.7	1664.8	1678.0	1673.0
12.5°	1671.3	1661.4	1641.5	1649.9	1646.4
15°	1643.1	1633.2	1611.6	1618.3	1610.0
17.5°	1608.3	1598.4	1576.8	1585.0	1576.8
20°	1570.0	1560.1	1537.0	1541.8	1535.4
22.5°	1532.0	1517.0	1495.4	1495.4	1492.0
25°	1487.1	1473.9	1445.7	1448.9	1445.7
27.5°	1437.3	1425.6	1404.2	1399.2	1391.0
30°	1387.6	1374.3	1349.4	1344.4	1337.8
32.5°	1334.5	1324.6	1298.0	1288.0	1281.2
35°	1283.0	1266.5	1239.9	1229.9	1221.6
37.5°	1224.9	1209.9	1183.3	1171.8	1163.5
40°	1165.2	1151.8	1125.2	1110.4	1103.8
42.5°	1107.1	1093.7	1067.3	1050.6	1040.7
45°	1044.0	1032.5	1007.4	989.3	982.6
47.5°	982.6	970.9	944.4	926.1	916.3
50°	917.8	909.5	886.3	863.0	854.7
52.5°	854.7	843.2	821.7	803.4	791.7
55°	790.2	780.1	760.2	740.3	732.1
57.5°	725.3	717.1	695.3	675.5	668.8
60°	660.5	654.0	630.8	612.5	607.5
62.5°	597.5	585.9	569.4	552.7	546.1
65°	532.9	522.8	506.3	491.3	483.1
67.5°	466.4	458.0	443.3	431.6	425.0
70°	405.0	398.4	383.4	371.7	365.2
72.5°	342.0	335.3	327.0	315.4	310.4
75°	278.8	275.6	267.2	257.3	260.6
77.5°	222.4	215.7	212.4	207.4	202.5
80°	166.0	164.2	160.9	156.0	152.7
82.5°	112.9	112.9	111.3	104.6	104.6
85°	68.0	66.4	64.8	59.7	58.1
87.5°	29.9	26.6	23.3	18.3	16.5
90°	1.3	16.2	27.1	33.9	36.5
92.5°	33.9	28.5	32.5	35.3	36.5
95°	87.9	43.3	52.8	59.7	58.2
97.5°	158.4	47.5	69.0	73.2	74.4
100°	239.8	54.2	77.2	87.9	90.7
102.5°	329.0	326.4	80.0	94.7	98.9
105°	411.7	452.4	82.6	97.5	102.9
107.5°	507.8	541.5	85.4	100.1	105.7
110°	600.0	628.2	237.0	101.6	106.9

TEST NUMBER: P910491

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	686.6	710.9	687.9	104.2	108.3
115°	778.6	801.6	835.5	208.6	111.1
117.5°	858.5	885.5	908.7	714.9	360.2
120°	947.9	968.2	992.6	1008.9	826.0
122.5°	1023.6	1045.3	1072.5	1080.6	1082.1
125°	1100.8	1118.5	1144.3	1153.7	1157.8
127.5°	1171.2	1190.2	1210.7	1224.1	1225.4
130°	1237.6	1259.4	1274.1	1289.1	1287.9
132.5°	1305.4	1323.0	1337.8	1350.1	1348.8
135°	1362.3	1384.0	1396.0	1409.8	1407.0
137.5°	1421.7	1438.0	1451.7	1465.2	1461.2
140°	1480.0	1490.9	1505.7	1517.9	1511.2
142.5°	1528.9	1538.4	1555.9	1566.7	1559.9
145°	1580.3	1578.9	1601.8	1611.4	1604.6
147.5°	1624.9	1620.8	1643.9	1650.6	1645.3
150°	1668.3	1658.8	1680.5	1688.6	1681.8
152.5°	1704.8	1694.0	1714.3	1722.5	1713.0
155°	1740.0	1727.9	1744.1	1752.2	1741.5
157.5°	1768.4	1757.7	1769.9	1779.4	1768.4
160°	1792.9	1784.7	1792.9	1800.9	1791.5
162.5°	1814.4	1806.5	1813.1	1822.6	1810.4
165°	1833.4	1825.4	1829.4	1838.8	1829.4
167.5°	1848.4	1840.2	1844.4	1853.8	1841.6
170°	1860.6	1852.4	1855.1	1864.6	1852.4
172.5°	1868.7	1860.6	1863.3	1872.8	1860.6
175°	1875.4	1865.9	1868.7	1878.1	1864.6
177.5°	1878.1	1868.7	1870.1	1879.5	1867.3
180°	1871.3	1871.3	1871.3	1871.3	1871.3

TEST NUMBER: P910491

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US850-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.15	7.96	8.15	8.98	10.33	6.71	7.52	7.71	8.53	9.88
	3H	8.81	9.54	9.83	10.57	11.93	8.32	9.05	9.34	10.08	11.44
	4H	9.40	10.09	10.43	11.12	12.50	8.91	9.60	9.93	10.63	12.00
	6H	9.80	10.44	10.84	11.47	12.86	9.30	9.94	10.34	10.97	12.36
	8H	9.91	10.52	10.95	11.56	12.95	9.41	10.01	10.45	11.06	12.44
	12H	9.96	10.54	11.01	11.58	12.98	9.45	10.03	10.50	11.07	12.47
4H	2H	7.61	8.30	8.64	9.32	10.70	7.25	7.94	8.29	8.97	10.35
	3H	9.48	10.05	10.52	11.11	12.50	9.07	9.64	10.11	10.70	12.09
	4H	10.19	10.72	11.24	11.77	13.18	9.77	10.30	10.82	11.34	12.75
	6H	10.71	11.16	11.77	12.23	13.64	10.28	10.73	11.34	11.80	13.21
	8H	10.86	11.29	11.92	12.35	13.77	10.42	10.85	11.48	11.91	13.33
	12H	10.94	11.32	12.01	12.39	13.82	10.49	10.87	11.56	11.94	13.37
8H	4H	10.39	10.81	11.44	11.87	13.29	10.01	10.43	11.07	11.49	12.92
	6H	11.02	11.37	12.10	12.48	13.89	10.64	10.99	11.72	12.09	13.51
	8H	11.25	11.55	12.33	12.64	14.08	10.85	11.16	11.94	12.25	13.69
	12H	11.38	11.65	12.47	12.73	14.21	10.97	11.24	12.06	12.32	13.80
12H	4H	10.37	10.75	11.45	11.83	13.26	10.00	10.39	11.08	11.46	12.89
	6H	11.05	11.36	12.14	12.45	13.89	10.68	10.99	11.77	12.07	13.51
	8H	11.30	11.57	12.39	12.65	14.13	10.92	11.19	12.01	12.27	13.75

END OF REPORT