

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910596

Luminaire Tested: DFN2DIP-4P4F0-080D070US850-RLLFLL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P910596  
REPORT IS A COMBINATION OF REPORTS P899138 AND P895967  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-4P4F0-080D070US850-RLLFLL  
Description: 4 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 14411.5 lumens  
Efficiency: N/A  
Efficacy: 98.1 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16  
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')  
CIE Type: General Diffuse

Input Watts (W): 146.9  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.9971  
Total Harmonic Distortion (THDi): 0.049  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P910596

CATALOG NUMBER: DFN2DIP-4P4F0-080D070US850-RLLFLL

### Luminous Intensity Polar Plot

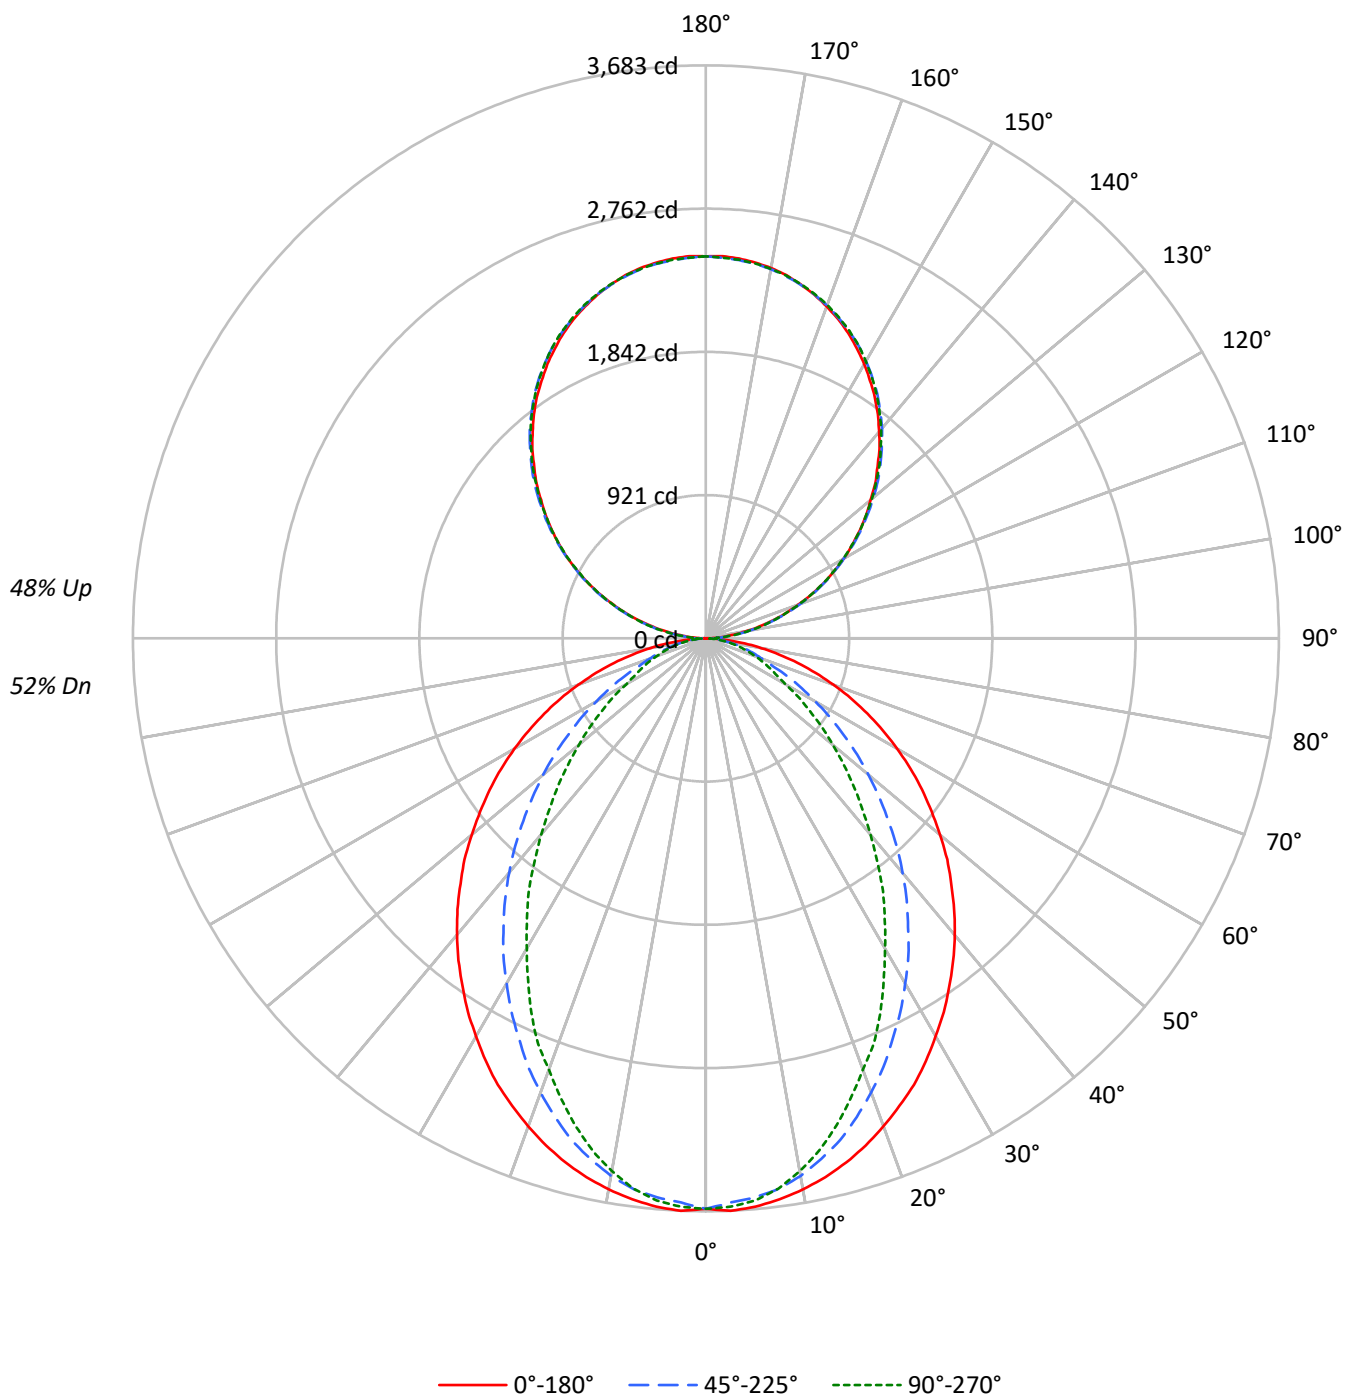

TEST NUMBER: P910596

CATALOG NUMBER: DFN2DIP-4P4F0-080D070US850-RLLFLL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
| 0   | 108 | 108 | 108 | 108 | 100 | 100 | 100 | 100 | 85 | 85 | 85 | 71 | 71 | 71 | 58 | 58 | 58 |
| 1   | 99  | 95  | 91  | 88  | 91  | 88  | 85  | 82  | 75 | 73 | 71 | 63 | 62 | 60 | 52 | 51 | 50 |
| 2   | 90  | 83  | 77  | 72  | 83  | 77  | 72  | 68  | 66 | 63 | 59 | 56 | 53 | 51 | 47 | 45 | 43 |
| 3   | 83  | 74  | 67  | 61  | 76  | 69  | 62  | 57  | 59 | 54 | 50 | 50 | 47 | 44 | 42 | 39 | 37 |
| 4   | 76  | 66  | 58  | 52  | 70  | 61  | 54  | 49  | 53 | 48 | 43 | 45 | 41 | 38 | 38 | 35 | 33 |
| 5   | 70  | 59  | 51  | 45  | 65  | 55  | 48  | 43  | 47 | 42 | 38 | 41 | 36 | 33 | 34 | 31 | 29 |
| 6   | 65  | 53  | 45  | 39  | 60  | 49  | 42  | 37  | 43 | 37 | 33 | 37 | 33 | 29 | 31 | 28 | 25 |
| 7   | 60  | 48  | 40  | 35  | 55  | 45  | 38  | 33  | 39 | 34 | 30 | 34 | 29 | 26 | 29 | 25 | 23 |
| 8   | 56  | 44  | 36  | 31  | 52  | 41  | 34  | 29  | 36 | 30 | 26 | 31 | 27 | 23 | 26 | 23 | 21 |
| 9   | 52  | 40  | 33  | 28  | 48  | 38  | 31  | 26  | 33 | 28 | 24 | 29 | 24 | 21 | 24 | 21 | 19 |
| 10  | 49  | 37  | 30  | 25  | 45  | 35  | 28  | 24  | 30 | 25 | 22 | 26 | 22 | 19 | 23 | 20 | 17 |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 2379 | 2379 | 2379 |
| 5°  | 2383 | 2342 | 2357 |
| 10° | 2359 | 2297 | 2281 |
| 15° | 2327 | 2221 | 2163 |
| 20° | 2284 | 2118 | 2018 |
| 25° | 2240 | 2001 | 1879 |
| 30° | 2182 | 1881 | 1701 |
| 35° | 2124 | 1752 | 1545 |
| 40° | 2065 | 1619 | 1366 |
| 45° | 1997 | 1471 | 1203 |
| 50° | 1926 | 1322 | 1045 |
| 55° | 1853 | 1162 | 892  |
| 60° | 1768 | 995  | 735  |
| 65° | 1670 | 825  | 663  |
| 70° | 1551 | 666  | 601  |
| 75° | 1402 | 589  | 549  |
| 80° | 1185 | 497  | 479  |
| 85° | 829  | 336  | 366  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1997 cd/sqm

TEST NUMBER: P910596

CATALOG NUMBER: DFN2DIP-4P4F0-080D070US850-RLLFLL

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 343.7   | 2.4       |
| 10°-20°   | 943.4   | 6.5       |
| 20°-30°   | 1324.5  | 9.2       |
| 30°-40°   | 1443.8  | 10.0      |
| 40°-50°   | 1327.0  | 9.2       |
| 50°-60°   | 1042.1  | 7.2       |
| 60°-70°   | 678.3   | 4.7       |
| 70°-80°   | 349.2   | 2.4       |
| 80°-90°   | 96.1    | 0.7       |
| 90°-100°  | 151.9   | 1.1       |
| 100°-110° | 482.7   | 3.3       |
| 110°-120° | 826.1   | 5.7       |
| 120°-130° | 1086.4  | 7.5       |
| 130°-140° | 1219.5  | 8.5       |
| 140°-150° | 1195.8  | 8.3       |
| 150°-160° | 1003.1  | 7.0       |
| 160°-170° | 665.3   | 4.6       |
| 170°-180° | 232.5   | 1.6       |
| 0°-30°    | 2611.6  | 18.1      |
| 0°-40°    | 4055.4  | 28.1      |
| 0°-60°    | 6424.5  | 44.6      |
| 0°-90°    | 7548.2  | 52.4      |
| 90°-120°  | 1460.7  | 10.1      |
| 90°-150°  | 4962.4  | 34.4      |
| 90°-180°  | 6863.0  | 47.6      |
| 0°-180°   | 14411.5 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 3667 | 3667  | 3667 | 3667  | 3667 |      |
| 5°   | 3667 | 3650  | 3607 | 3637  | 3627 | 348  |
| 15°  | 3488 | 3451  | 3338 | 3275  | 3242 | 983  |
| 25°  | 3166 | 3060  | 2840 | 2705  | 2655 | 1456 |
| 35°  | 2728 | 2558  | 2267 | 2058  | 1984 | 1707 |
| 45°  | 2230 | 2008  | 1659 | 1423  | 1344 | 1722 |
| 55°  | 1696 | 1437  | 1078 | 879   | 816  | 1515 |
| 65°  | 1145 | 876   | 577  | 465   | 454  | 1135 |
| 75°  | 610  | 378   | 266  | 242   | 239  | 646  |
| 85°  | 143  | 73    | 63   | 63    | 63   | 164  |
| 90°  | 2    | 27    | 72   | 68    | 70   | 14   |
| 95°  | 108  | 129   | 132  | 132   | 129  | 120  |
| 105° | 446  | 452   | 456  | 460   | 460  | 470  |
| 115° | 829  | 841   | 837  | 835   | 829  | 820  |
| 125° | 1206 | 1224  | 1218 | 1212  | 1210 | 1077 |
| 135° | 1560 | 1582  | 1587 | 1585  | 1579 | 1205 |
| 145° | 1893 | 1908  | 1920 | 1922  | 1914 | 1183 |
| 155° | 2165 | 2171  | 2178 | 2188  | 2181 | 997  |
| 165° | 2355 | 2353  | 2353 | 2368  | 2357 | 664  |
| 175° | 2451 | 2445  | 2440 | 2455  | 2443 | 233  |
| 180° | 2455 | 2455  | 2455 | 2455  | 2455 |      |

TEST NUMBER: P910596

CATALOG NUMBER: DFN2DIP-4P4F0-080D070US850-RLLFLL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 3666.8 | 3666.8 | 3666.8 | 3666.8 | 3666.8 |
| 2.5°   | 3683.3 | 3666.8 | 3630.2 | 3663.6 | 3656.9 |
| 5°     | 3666.8 | 3650.3 | 3606.9 | 3636.9 | 3627.0 |
| 7.5°   | 3636.9 | 3617.1 | 3570.6 | 3583.7 | 3567.1 |
| 10°    | 3597.0 | 3573.9 | 3507.7 | 3497.5 | 3477.7 |
| 12.5°  | 3547.5 | 3517.5 | 3427.7 | 3408.0 | 3371.4 |
| 15°    | 3487.6 | 3451.0 | 3338.3 | 3275.3 | 3242.2 |
| 17.5°  | 3417.8 | 3364.7 | 3225.3 | 3152.4 | 3099.2 |
| 20°    | 3338.3 | 3271.8 | 3106.0 | 3023.2 | 2949.9 |
| 22.5°  | 3252.0 | 3175.6 | 2983.1 | 2870.4 | 2820.7 |
| 25°    | 3165.8 | 3059.5 | 2840.5 | 2704.6 | 2654.6 |
| 27.5°  | 3062.9 | 2949.9 | 2707.7 | 2551.8 | 2475.4 |
| 30°    | 2953.5 | 2827.1 | 2561.7 | 2392.7 | 2302.8 |
| 32.5°  | 2847.1 | 2694.4 | 2422.6 | 2223.3 | 2140.3 |
| 35°    | 2727.8 | 2558.5 | 2266.6 | 2057.5 | 1984.2 |
| 37.5°  | 2611.6 | 2428.9 | 2120.5 | 1891.3 | 1808.6 |
| 40°    | 2488.8 | 2289.9 | 1967.7 | 1732.1 | 1645.9 |
| 42.5°  | 2362.7 | 2150.5 | 1815.2 | 1569.6 | 1486.7 |
| 45°    | 2230.0 | 2007.5 | 1659.3 | 1423.4 | 1343.9 |
| 47.5°  | 2104.0 | 1868.4 | 1510.0 | 1274.1 | 1201.3 |
| 50°    | 1964.5 | 1729.0 | 1364.0 | 1134.7 | 1065.3 |
| 52.5°  | 1828.3 | 1579.3 | 1224.4 | 1005.5 | 942.5  |
| 55°    | 1695.6 | 1436.8 | 1078.4 | 879.4  | 816.4  |
| 57.5°  | 1559.7 | 1294.2 | 949.2  | 763.3  | 710.1  |
| 60°    | 1420.2 | 1154.8 | 812.9  | 643.9  | 590.8  |
| 62.5°  | 1284.3 | 1018.8 | 696.8  | 537.6  | 511.2  |
| 65°    | 1144.9 | 875.9  | 577.3  | 464.8  | 454.5  |
| 67.5°  | 1012.2 | 743.3  | 464.8  | 408.0  | 398.2  |
| 70°    | 872.8  | 614.1  | 384.8  | 351.7  | 338.4  |
| 72.5°  | 740.0  | 494.3  | 321.8  | 295.4  | 288.7  |
| 75°    | 610.5  | 378.2  | 265.5  | 242.2  | 239.1  |
| 77.5°  | 481.3  | 268.6  | 209.2  | 195.7  | 189.1  |
| 80°    | 361.5  | 192.6  | 159.1  | 146.1  | 146.1  |
| 82.5°  | 252.1  | 129.5  | 109.5  | 102.8  | 102.8  |
| 85°    | 142.6  | 72.9   | 63.0   | 63.0   | 63.0   |
| 87.5°  | 53.1   | 26.4   | 26.4   | 23.3   | 23.3   |
| 90°    | 2.2    | 26.6   | 72.5   | 68.1   | 70.3   |
| 92.5°  | 45.9   | 62.2   | 64.4   | 66.7   | 66.7   |
| 95°    | 108.0  | 128.8  | 132.5  | 132.5  | 128.8  |
| 97.5°  | 179.9  | 199.1  | 207.3  | 207.3  | 207.3  |
| 100°   | 262.7  | 279.8  | 285.7  | 285.7  | 283.5  |
| 102.5° | 350.1  | 362.6  | 370.8  | 373.1  | 370.8  |
| 105°   | 445.6  | 451.5  | 455.9  | 459.7  | 459.7  |
| 107.5° | 540.3  | 549.2  | 549.2  | 550.7  | 540.3  |
| 110°   | 632.1  | 644.0  | 644.0  | 644.0  | 638.0  |

TEST NUMBER: P910596

CATALOG NUMBER: DFN2DIP-4P4F0-080D070US850-RLLFLL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 731.3  | 743.9  | 741.7  | 735.7  | 731.3  |
| 115°   | 829.0  | 840.8  | 837.2  | 835.0  | 829.0  |
| 117.5° | 925.9  | 942.2  | 931.9  | 925.9  | 920.0  |
| 120°   | 1023.6 | 1039.9 | 1023.6 | 1023.6 | 1017.0 |
| 122.5° | 1112.4 | 1133.2 | 1122.9 | 1116.9 | 1112.4 |
| 125°   | 1205.7 | 1224.2 | 1218.3 | 1211.7 | 1209.5 |
| 127.5° | 1296.8 | 1319.7 | 1311.6 | 1302.7 | 1296.8 |
| 130°   | 1381.9 | 1408.5 | 1404.9 | 1400.4 | 1392.2 |
| 132.5° | 1477.4 | 1498.1 | 1499.6 | 1489.3 | 1483.3 |
| 135°   | 1559.6 | 1582.4 | 1587.0 | 1584.7 | 1578.8 |
| 137.5° | 1651.3 | 1669.8 | 1673.5 | 1672.0 | 1663.2 |
| 140°   | 1732.0 | 1750.6 | 1760.9 | 1760.9 | 1752.8 |
| 142.5° | 1814.9 | 1833.4 | 1839.3 | 1841.5 | 1833.4 |
| 145°   | 1893.4 | 1908.1 | 1920.0 | 1922.2 | 1914.1 |
| 147.5° | 1963.7 | 1982.2 | 1991.1 | 1994.8 | 1986.7 |
| 150°   | 2036.2 | 2048.8 | 2057.0 | 2063.6 | 2057.0 |
| 152.5° | 2100.6 | 2113.2 | 2123.5 | 2131.7 | 2123.5 |
| 155°   | 2165.0 | 2170.9 | 2177.6 | 2187.9 | 2181.3 |
| 157.5° | 2220.6 | 2225.0 | 2228.6 | 2243.5 | 2233.1 |
| 160°   | 2270.1 | 2274.6 | 2276.8 | 2289.3 | 2280.4 |
| 162.5° | 2316.0 | 2316.0 | 2318.3 | 2332.2 | 2321.9 |
| 165°   | 2355.2 | 2353.0 | 2353.0 | 2367.8 | 2357.4 |
| 167.5° | 2390.8 | 2384.1 | 2384.1 | 2398.9 | 2388.6 |
| 170°   | 2417.4 | 2411.5 | 2409.3 | 2424.1 | 2411.5 |
| 172.5° | 2435.9 | 2429.9 | 2427.7 | 2442.6 | 2429.9 |
| 175°   | 2450.7 | 2444.8 | 2440.4 | 2455.1 | 2442.6 |
| 177.5° | 2458.9 | 2452.9 | 2448.5 | 2461.1 | 2448.5 |
| 180°   | 2455.1 | 2455.1 | 2455.1 | 2455.1 | 2455.1 |

TEST NUMBER: P910596

CATALOG NUMBER: DFN2DIP-4P4F0-080D070US850-RLLFLL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |       |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|-------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7   | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3   | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2   | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |       |       |       |       |
| X=2H            | Y=2H | 10.40            | 11.25 | 11.34 | 12.20 | 13.44 | 6.36           | 7.21  | 7.30  | 8.16  | 9.40  |
|                 | 3H   | 12.08            | 12.84 | 13.04 | 13.80 | 15.07 | 7.55           | 8.31  | 8.50  | 9.27  | 10.54 |
|                 | 4H   | 12.69            | 13.41 | 13.66 | 14.38 | 15.65 | 8.00           | 8.72  | 8.97  | 9.69  | 10.96 |
|                 | 6H   | 13.12            | 13.78 | 14.10 | 14.76 | 16.04 | 8.32           | 8.98  | 9.30  | 9.96  | 11.24 |
|                 | 8H   | 13.25            | 13.88 | 14.24 | 14.87 | 16.15 | 8.42           | 9.04  | 9.40  | 10.04 | 11.32 |
|                 | 12H  | 13.32            | 13.91 | 14.31 | 14.90 | 16.20 | 8.46           | 9.06  | 9.45  | 10.04 | 11.35 |
| 4H              | 2H   | 10.42            | 11.13 | 11.39 | 12.10 | 13.37 | 6.96           | 7.67  | 7.93  | 8.64  | 9.92  |
|                 | 3H   | 12.25            | 12.85 | 13.24 | 13.85 | 15.13 | 8.31           | 8.91  | 9.29  | 9.91  | 11.19 |
|                 | 4H   | 12.95            | 13.50 | 13.94 | 14.49 | 15.80 | 8.86           | 9.41  | 9.85  | 10.40 | 11.71 |
|                 | 6H   | 13.47            | 13.94 | 14.48 | 14.96 | 16.26 | 9.28           | 9.75  | 10.29 | 10.77 | 12.07 |
|                 | 8H   | 13.65            | 14.09 | 14.66 | 15.10 | 16.42 | 9.41           | 9.85  | 10.42 | 10.86 | 12.18 |
|                 | 12H  | 13.75            | 14.14 | 14.77 | 15.17 | 16.50 | 9.48           | 9.88  | 10.50 | 10.90 | 12.23 |
| 8H              | 4H   | 12.92            | 13.36 | 13.93 | 14.37 | 15.69 | 9.15           | 9.58  | 10.15 | 10.59 | 11.91 |
|                 | 6H   | 13.49            | 13.85 | 14.52 | 14.90 | 16.22 | 9.67           | 10.03 | 10.70 | 11.08 | 12.40 |
|                 | 8H   | 13.71            | 14.03 | 14.75 | 15.07 | 16.41 | 9.86           | 10.18 | 10.90 | 11.22 | 12.55 |
|                 | 12H  | 13.86            | 14.14 | 14.90 | 15.17 | 16.55 | 9.98           | 10.26 | 11.02 | 11.29 | 12.68 |
| 12H             | 4H   | 12.87            | 13.27 | 13.90 | 14.29 | 15.62 | 9.15           | 9.55  | 10.18 | 10.57 | 11.90 |
|                 | 6H   | 13.47            | 13.79 | 14.51 | 14.82 | 16.16 | 9.72           | 10.04 | 10.76 | 11.07 | 12.41 |
|                 | 8H   | 13.69            | 13.97 | 14.74 | 15.00 | 16.39 | 9.93           | 10.21 | 10.97 | 11.24 | 12.63 |

END OF REPORT