

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913261

Luminaire Tested: DFN2DIP-4P4F0-060D030US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913261
REPORT IS A COMBINATION OF REPORTS P900606 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-060D030US927-RLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6392.9 lumens
Efficiency: N/A
Efficacy: 75.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 84.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913261

CATALOG NUMBER: DFN2DIP-4P4F0-060D030US927-RLLONL

Luminous Intensity Polar Plot

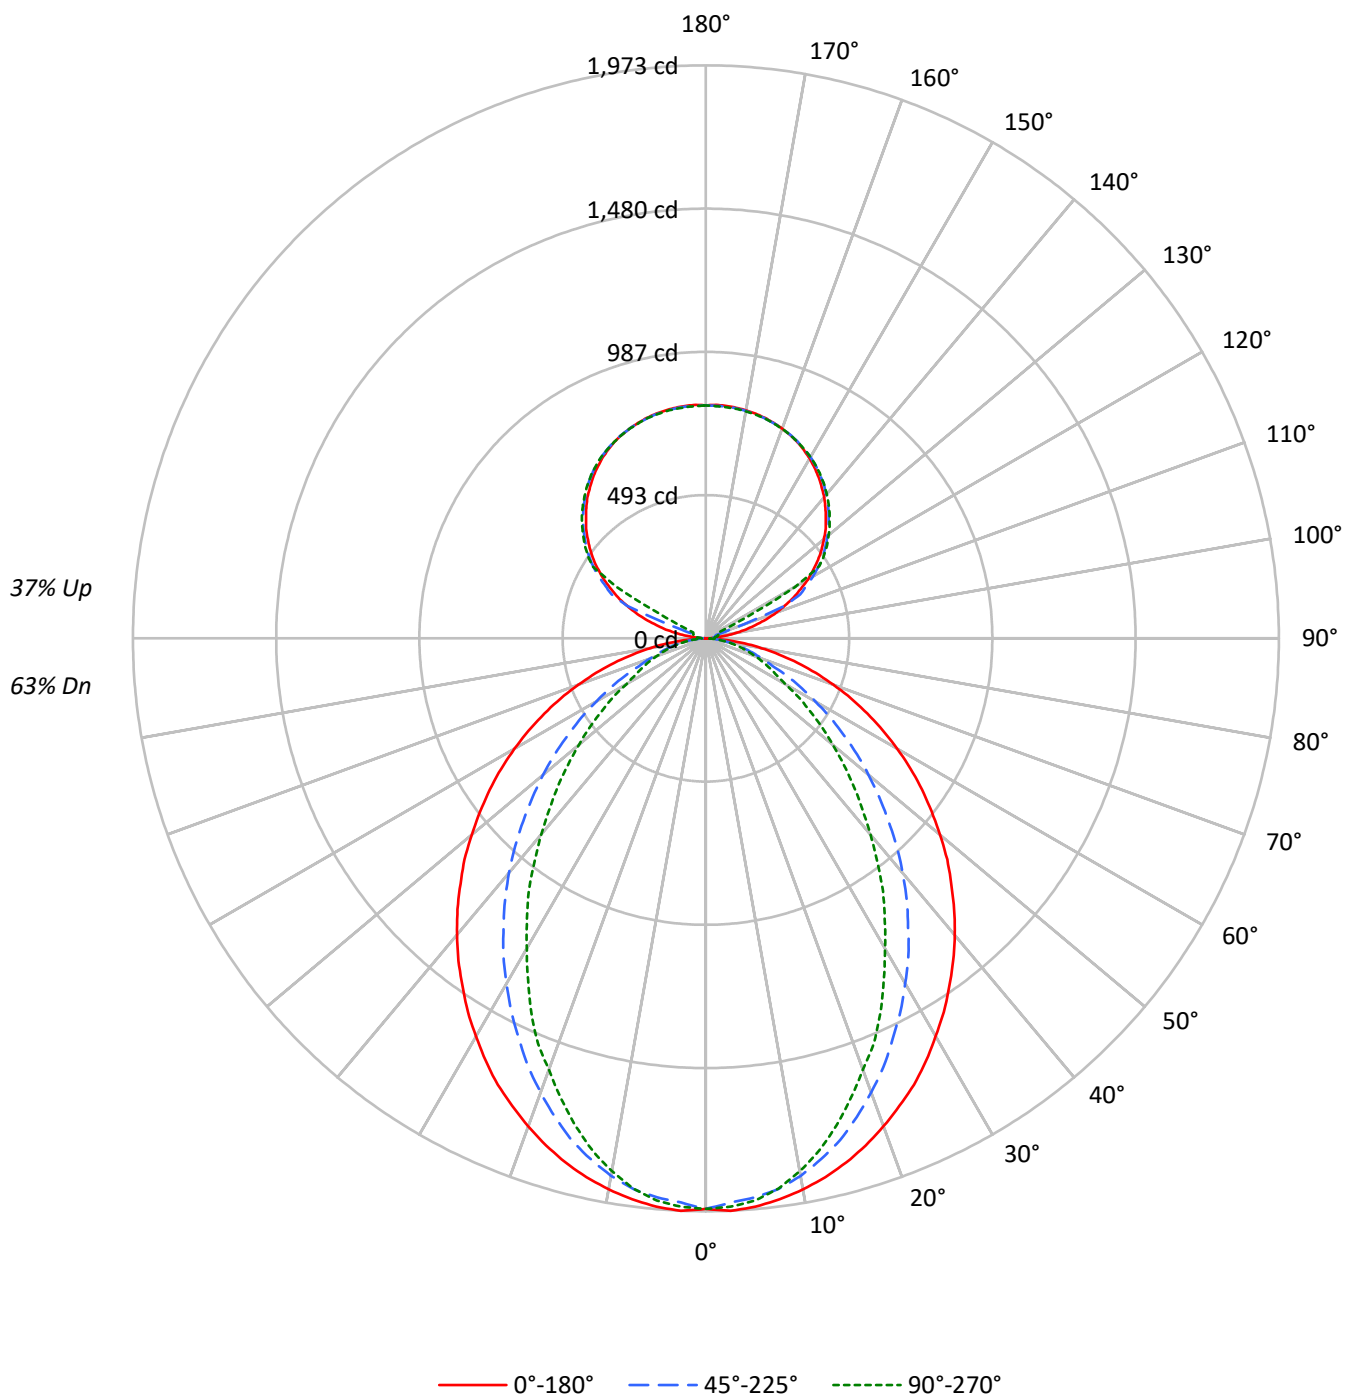

TEST NUMBER: P913261

CATALOG NUMBER: DFN2DIP-4P4F0-060D030US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1274	1274	1274
5°	1277	1255	1263
10°	1264	1230	1222
15°	1247	1190	1159
20°	1224	1134	1081
25°	1200	1072	1006
30°	1169	1008	911
35°	1138	939	828
40°	1106	867	732
45°	1070	788	645
50°	1032	708	560
55°	993	623	478
60°	947	533	394
65°	895	442	355
70°	831	357	322
75°	751	316	294
80°	635	266	257
85°	444	180	196

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1070 cd/sqm

TEST NUMBER: P913261

CATALOG NUMBER: DFN2DIP-4P4F0-060D030US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	2.9
10°-20°	505.4	7.9
20°-30°	709.6	11.1
30°-40°	773.5	12.1
40°-50°	710.9	11.1
50°-60°	558.3	8.7
60°-70°	363.4	5.7
70°-80°	187.1	2.9
80°-90°	49.2	0.8
90°-100°	26.5	0.4
100°-110°	98.6	1.5
110°-120°	261.5	4.1
120°-130°	433.7	6.8
130°-140°	460.7	7.2
140°-150°	428.1	6.7
150°-160°	344.2	5.4
160°-170°	221.8	3.5
170°-180°	76.3	1.2
0°-30°	1399.1	21.9
0°-40°	2172.6	34.0
0°-60°	3441.9	53.8
0°-90°	4041.5	63.2
90°-120°	386.5	6.0
90°-150°	1709.0	26.7
90°-180°	2351.0	36.8
0°-180°	6392.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	1	7	12	15	16	6
95°	38	18	23	26	25	45
105°	176	194	35	42	44	188
115°	334	344	358	89	48	329
125°	472	479	490	494	496	421
135°	584	593	598	604	603	451
145°	677	677	687	691	688	424
155°	746	741	748	751	746	344
165°	786	782	784	788	784	222
175°	804	800	801	805	799	76
180°	802	802	802	802	802	

TEST NUMBER: P913261

CATALOG NUMBER: DFN2DIP-4P4F0-060D030US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	0.6	7.0	11.6	14.6	15.6
92.5°	14.6	12.2	13.9	15.1	15.6
95°	37.7	18.5	22.6	25.6	25.0
97.5°	67.9	20.4	29.5	31.4	31.9
100°	102.7	23.2	33.1	37.7	38.9
102.5°	141.0	139.9	34.2	40.6	42.4
105°	176.4	193.8	35.4	41.7	44.1
107.5°	217.6	232.1	36.6	42.9	45.3
110°	257.1	269.3	101.6	43.6	45.9



TEST NUMBER: P913261

CATALOG NUMBER: DFN2DIP-4P4F0-060D030US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	294.3	304.7	294.8	44.7	46.4
115°	333.7	343.6	358.1	89.4	47.6
117.5°	368.0	379.5	389.4	306.4	154.4
120°	406.2	414.9	425.4	432.4	354.0
122.5°	438.7	448.1	459.7	463.1	463.7
125°	471.8	479.3	490.4	494.5	496.2
127.5°	502.0	510.1	518.9	524.7	525.2
130°	530.4	539.8	546.1	552.5	552.0
132.5°	559.4	567.0	573.4	578.6	578.1
135°	583.8	593.2	598.3	604.2	603.0
137.5°	609.3	616.3	622.2	628.0	626.2
140°	634.3	639.0	645.3	650.5	647.7
142.5°	655.3	659.3	666.9	671.5	668.6
145°	677.3	676.7	686.6	690.6	687.7
147.5°	696.4	694.7	704.6	707.4	705.1
150°	715.0	711.0	720.3	723.7	720.8
152.5°	730.6	726.0	734.7	738.2	734.2
155°	745.8	740.6	747.5	751.0	746.4
157.5°	758.0	753.4	758.6	762.6	758.0
160°	768.4	764.9	768.4	771.9	767.8
162.5°	777.7	774.2	777.1	781.2	775.9
165°	785.8	782.4	784.1	788.1	784.1
167.5°	792.2	788.7	790.4	794.6	789.3
170°	797.4	793.9	795.1	799.2	793.9
172.5°	800.9	797.4	798.6	802.6	797.4
175°	803.7	799.7	800.9	804.9	799.2
177.5°	804.9	800.9	801.5	805.6	800.3
180°	802.1	802.1	802.1	802.1	802.1

TEST NUMBER: P913261

CATALOG NUMBER: DFN2DIP-4P4F0-060D030US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.16	10.11	10.00	10.97	12.04	5.12	6.07	5.96	6.93	8.00
	3H	10.85	11.70	11.71	12.57	13.67	6.32	7.17	7.18	8.04	9.14
	4H	11.47	12.27	12.34	13.15	14.26	6.78	7.58	7.65	8.46	9.57
	6H	11.90	12.64	12.79	13.53	14.65	7.11	7.85	7.99	8.73	9.85
	8H	12.04	12.74	12.93	13.64	14.76	7.20	7.90	8.09	8.80	9.93
	12H	12.10	12.77	13.00	13.67	14.81	7.25	7.92	8.15	8.81	9.96
4H	2H	9.19	10.00	10.07	10.87	11.98	5.73	6.54	6.61	7.41	8.52
	3H	11.04	11.71	11.93	12.61	13.74	7.10	7.76	7.99	8.67	9.80
	4H	11.74	12.35	12.64	13.25	14.40	7.65	8.26	8.55	9.16	10.31
	6H	12.27	12.79	13.18	13.72	14.87	8.08	8.60	8.99	9.53	10.68
	8H	12.45	12.94	13.37	13.86	15.03	8.21	8.70	9.13	9.62	10.79
	12H	12.55	12.99	13.49	13.93	15.10	8.28	8.72	9.22	9.66	10.84
8H	4H	11.72	12.21	12.63	13.13	14.29	7.94	8.43	8.86	9.35	10.52
	6H	12.30	12.70	13.24	13.66	14.83	8.47	8.87	9.41	9.84	11.00
	8H	12.52	12.87	13.47	13.83	15.01	8.66	9.02	9.62	9.98	11.16
	12H	12.66	12.98	13.62	13.93	15.16	8.79	9.10	9.74	10.05	11.28
12H	4H	11.68	12.12	12.61	13.06	14.23	7.96	8.39	8.89	9.34	10.51
	6H	12.27	12.63	13.22	13.58	14.77	8.52	8.88	9.47	9.83	11.02
	8H	12.50	12.82	13.46	13.76	15.00	8.74	9.05	9.69	10.00	11.23

END OF REPORT