

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913283

Luminaire Tested: DFN2DIP-4P4F0-070D030US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913283
REPORT IS A COMBINATION OF REPORTS P900607 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-070D030US927-FLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7842.6 lumens
Efficiency: N/A
Efficacy: 80.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 97.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913283

CATALOG NUMBER: DFN2DIP-4P4F0-070D030US927-FLLONL

Luminous Intensity Polar Plot

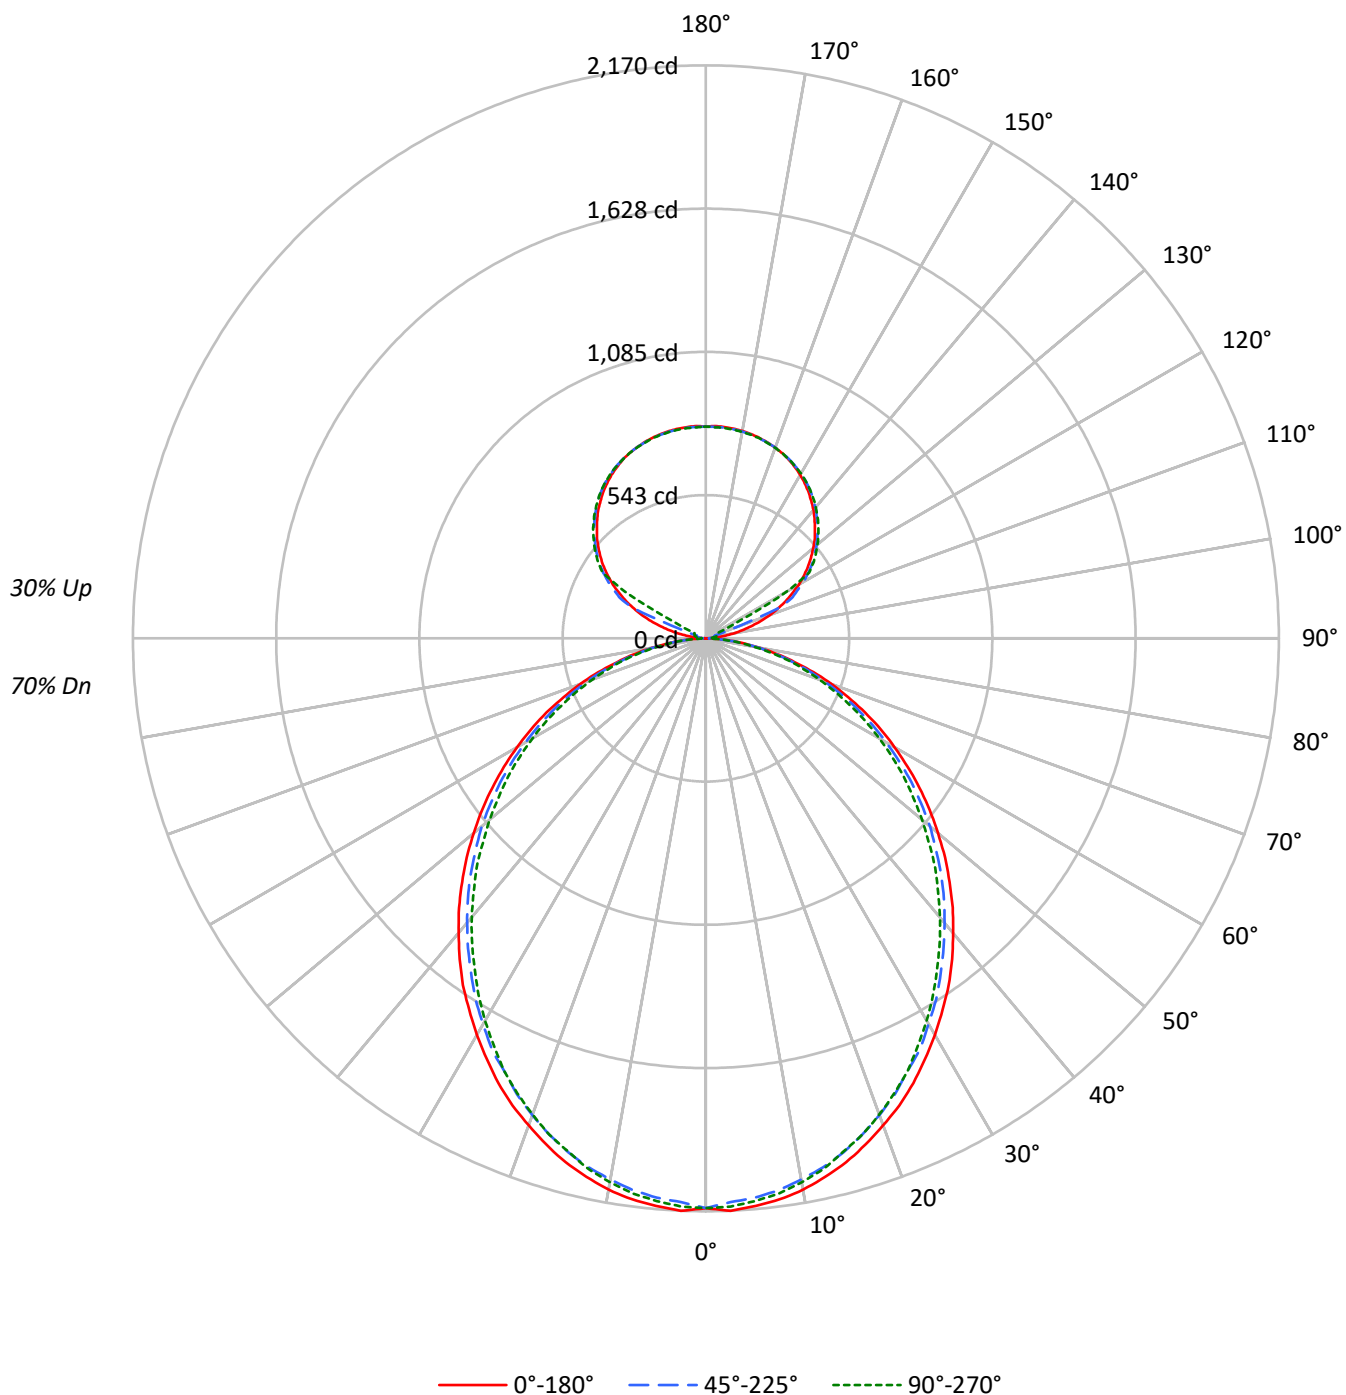

TEST NUMBER: P913283

CATALOG NUMBER: DFN2DIP-4P4F0-070D030US927-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	75	75	75
1	102	98	94	90	97	93	89	86	83	80	78	74	72	70	66	64	63
2	93	85	79	74	88	81	75	71	73	68	64	65	62	59	58	55	53
3	85	75	68	62	80	71	65	59	64	59	54	58	53	50	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	47	43	46	42	39
5	72	60	51	45	67	57	49	43	51	45	40	46	41	37	41	37	34
6	66	54	45	39	62	51	43	38	46	40	35	42	37	33	38	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	27
8	57	44	36	31	54	42	35	30	38	32	28	35	30	26	32	27	24
9	53	40	33	27	50	39	32	27	35	29	25	32	27	23	29	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1400	1400	1400
5°	1402	1381	1390
10°	1391	1363	1372
15°	1371	1341	1343
20°	1343	1310	1313
25°	1316	1273	1279
30°	1281	1239	1235
35°	1249	1198	1189
40°	1209	1157	1145
45°	1169	1117	1100
50°	1125	1074	1048
55°	1079	1024	1000
60°	1028	965	945
65°	971	904	881
70°	900	830	811
75°	800	741	748
80°	681	628	626
85°	494	432	422

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1169 cd/sqm

TEST NUMBER: P913283

CATALOG NUMBER: DFN2DIP-4P4F0-070D030US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.6
10°-20°	571.4	7.3
20°-30°	839.7	10.7
30°-40°	975.3	12.4
40°-50°	974.1	12.4
50°-60°	849.4	10.8
60°-70°	627.9	8.0
70°-80°	355.2	4.5
80°-90°	95.2	1.2
90°-100°	26.5	0.3
100°-110°	98.6	1.3
110°-120°	261.5	3.3
120°-130°	433.7	5.5
130°-140°	460.7	5.9
140°-150°	428.1	5.5
150°-160°	344.2	4.4
160°-170°	221.8	2.8
170°-180°	76.3	1.0
0°-30°	1614.2	20.6
0°-40°	2589.5	33.0
0°-60°	4412.9	56.3
0°-90°	5491.3	70.0
90°-120°	386.5	4.9
90°-150°	1709.0	21.8
90°-180°	2351.0	30.0
0°-180°	7842.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2127	2143	2139	205
15°	2054	2042	2015	2023	2013	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1002
45°	1305	1291	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	7	12	15	16	7
95°	38	18	23	26	25	45
105°	176	194	35	42	44	188
115°	334	344	358	89	48	329
125°	472	479	490	494	496	421
135°	584	593	598	604	603	451
145°	677	677	687	691	688	424
155°	746	741	748	751	746	344
165°	786	782	784	788	784	222
175°	804	800	801	805	799	76
180°	802	802	802	802	802	

TEST NUMBER: P913283

CATALOG NUMBER: DFN2DIP-4P4F0-070D030US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.7	2157.7	2157.7	2157.7	2157.7
2.5°	2170.3	2159.9	2137.0	2157.7	2153.7
5°	2157.7	2149.6	2126.7	2143.2	2139.2
7.5°	2143.2	2130.8	2107.9	2124.7	2120.5
10°	2120.5	2105.9	2081.1	2097.6	2091.4
12.5°	2089.2	2076.9	2052.1	2062.4	2058.2
15°	2054.0	2041.7	2014.6	2023.0	2012.6
17.5°	2010.4	1998.1	1971.0	1981.4	1971.0
20°	1962.6	1950.4	1921.3	1927.5	1919.3
22.5°	1915.1	1896.4	1869.3	1869.3	1865.1
25°	1859.0	1842.5	1807.3	1811.2	1807.3
27.5°	1796.7	1782.2	1755.3	1749.1	1738.8
30°	1734.6	1717.8	1686.9	1680.7	1672.3
32.5°	1668.1	1655.8	1622.5	1610.0	1601.6
35°	1603.8	1583.2	1549.9	1537.4	1527.0
37.5°	1531.2	1512.5	1479.2	1464.7	1454.4
40°	1456.6	1439.9	1406.6	1388.1	1379.7
42.5°	1383.9	1367.2	1334.2	1313.3	1300.9
45°	1305.1	1290.6	1259.3	1236.7	1228.3
47.5°	1228.3	1213.8	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.9	1068.5
52.5°	1068.5	1054.0	1027.1	1004.2	989.7
55°	987.7	975.2	950.3	925.4	915.0
57.5°	906.7	896.4	869.3	844.4	836.1
60°	825.7	817.5	788.5	765.6	759.5
62.5°	746.9	732.4	711.7	691.0	682.6
65°	666.1	653.5	632.9	614.2	603.8
67.5°	583.1	572.6	554.1	539.6	531.2
70°	506.3	498.0	479.2	464.7	456.5
72.5°	427.5	419.1	408.8	394.3	388.1
75°	348.5	344.5	333.9	321.6	325.8
77.5°	278.1	269.7	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	0.6	7.0	11.6	14.6	15.6
92.5°	14.6	12.2	13.9	15.1	15.6
95°	37.7	18.5	22.6	25.6	25.0
97.5°	67.9	20.4	29.5	31.4	31.9
100°	102.7	23.2	33.1	37.7	38.9
102.5°	141.0	139.9	34.2	40.6	42.4
105°	176.4	193.8	35.4	41.7	44.1
107.5°	217.6	232.1	36.6	42.9	45.3
110°	257.1	269.3	101.6	43.6	45.9

TEST NUMBER: P913283

CATALOG NUMBER: DFN2DIP-4P4F0-070D030US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	294.3	304.7	294.8	44.7	46.4
115°	333.7	343.6	358.1	89.4	47.6
117.5°	368.0	379.5	389.4	306.4	154.4
120°	406.2	414.9	425.4	432.4	354.0
122.5°	438.7	448.1	459.7	463.1	463.7
125°	471.8	479.3	490.4	494.5	496.2
127.5°	502.0	510.1	518.9	524.7	525.2
130°	530.4	539.8	546.1	552.5	552.0
132.5°	559.4	567.0	573.4	578.6	578.1
135°	583.8	593.2	598.3	604.2	603.0
137.5°	609.3	616.3	622.2	628.0	626.2
140°	634.3	639.0	645.3	650.5	647.7
142.5°	655.3	659.3	666.9	671.5	668.6
145°	677.3	676.7	686.6	690.6	687.7
147.5°	696.4	694.7	704.6	707.4	705.1
150°	715.0	711.0	720.3	723.7	720.8
152.5°	730.6	726.0	734.7	738.2	734.2
155°	745.8	740.6	747.5	751.0	746.4
157.5°	758.0	753.4	758.6	762.6	758.0
160°	768.4	764.9	768.4	771.9	767.8
162.5°	777.7	774.2	777.1	781.2	775.9
165°	785.8	782.4	784.1	788.1	784.1
167.5°	792.2	788.7	790.4	794.6	789.3
170°	797.4	793.9	795.1	799.2	793.9
172.5°	800.9	797.4	798.6	802.6	797.4
175°	803.7	799.7	800.9	804.9	799.2
177.5°	804.9	800.9	801.5	805.6	800.3
180°	802.1	802.1	802.1	802.1	802.1

TEST NUMBER: P913283

CATALOG NUMBER: DFN2DIP-4P4F0-070D030US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.13	11.21	10.89	11.99	12.95	9.69	10.76	10.45	11.55	12.50
	3H	11.81	12.78	12.59	13.57	14.56	11.32	12.29	12.10	13.08	14.07
	4H	12.41	13.33	13.21	14.13	15.12	11.92	12.83	12.71	13.64	14.63
	6H	12.83	13.67	13.64	14.48	15.49	12.33	13.17	13.14	13.98	14.99
	8H	12.94	13.74	13.76	14.58	15.59	12.44	13.24	13.26	14.07	15.08
	12H	13.00	13.76	13.82	14.59	15.63	12.49	13.25	13.31	14.08	15.12
4H	2H	10.62	11.53	11.42	12.33	13.33	10.26	11.18	11.06	11.98	12.97
	3H	12.51	13.27	13.32	14.11	15.12	12.10	12.86	12.91	13.70	14.71
	4H	13.24	13.93	14.06	14.77	15.81	12.81	13.51	13.64	14.34	15.38
	6H	13.77	14.37	14.61	15.23	16.28	13.34	13.94	14.18	14.80	15.84
	8H	13.93	14.49	14.77	15.34	16.40	13.49	14.05	14.33	14.91	15.96
	12H	14.01	14.52	14.88	15.40	16.46	13.56	14.07	14.43	14.95	16.01
8H	4H	13.45	14.01	14.30	14.87	15.93	13.07	13.64	13.92	14.49	15.55
	6H	14.10	14.56	14.97	15.46	16.52	13.71	14.18	14.59	15.08	16.13
	8H	14.32	14.74	15.21	15.63	16.70	13.93	14.34	14.82	15.24	16.31
	12H	14.47	14.83	15.36	15.72	16.85	14.06	14.42	14.95	15.31	16.44
12H	4H	13.45	13.95	14.31	14.83	15.89	13.08	13.58	13.94	14.46	15.52
	6H	14.13	14.54	15.01	15.44	16.51	13.76	14.17	14.64	15.07	16.14
	8H	14.39	14.75	15.27	15.64	16.76	14.01	14.37	14.89	15.26	16.38

END OF REPORT