

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915947

Luminaire Tested: DFN2DIP-4P4F0-040D050US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915947
REPORT IS A COMBINATION OF REPORTS P900625 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-040D050US930-FLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7264.3 lumens
Efficiency: N/A
Efficacy: 92.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 79
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915947

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US930-FLLONL

Luminous Intensity Polar Plot

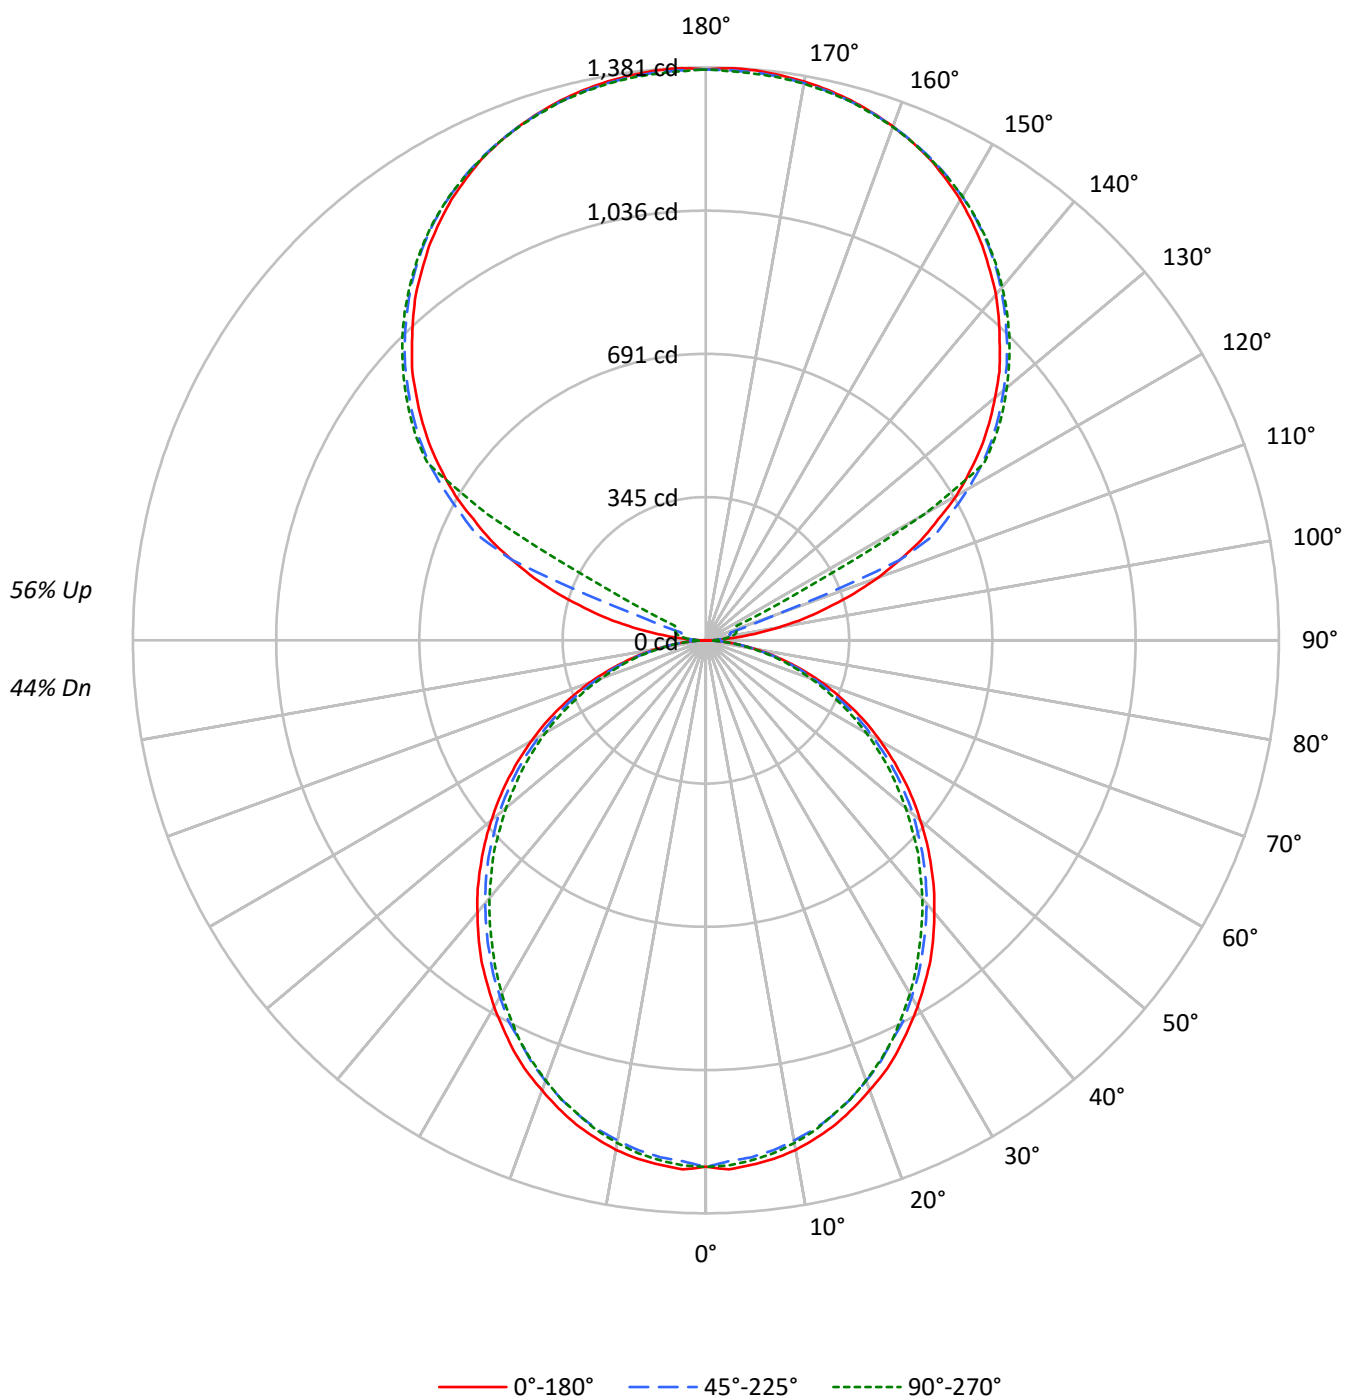

TEST NUMBER: P915947

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	25	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	823	823	823
5°	825	812	818
10°	818	801	807
15°	806	788	790
20°	790	770	772
25°	774	749	752
30°	753	729	726
35°	734	705	699
40°	711	681	673
45°	687	657	647
50°	662	632	616
55°	635	602	588
60°	604	568	556
65°	571	532	518
70°	529	488	477
75°	471	436	440
80°	400	369	368
85°	291	254	248

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 708 cd/sqm

TEST NUMBER: P915947

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.4	1.6
10°-20°	336.0	4.6
20°-30°	493.8	6.8
30°-40°	573.6	7.9
40°-50°	572.9	7.9
50°-60°	499.5	6.9
60°-70°	369.3	5.1
70°-80°	208.9	2.9
80°-90°	57.6	0.8
90°-100°	45.4	0.6
100°-110°	169.1	2.3
110°-120°	448.5	6.2
120°-130°	743.9	10.2
130°-140°	790.2	10.9
140°-150°	734.4	10.1
150°-160°	590.4	8.1
160°-170°	380.5	5.2
170°-180°	130.9	1.8
0°-30°	949.3	13.1
0°-40°	1522.9	21.0
0°-60°	2595.3	35.7
0°-90°	3231.0	44.5
90°-120°	663.0	9.1
90°-150°	2931.5	40.4
90°-180°	4033.0	55.5
0°-180°	7264.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1269	1269	1269	1269	1269	
5°	1269	1264	1251	1260	1258	120
15°	1208	1201	1185	1190	1184	340
25°	1093	1084	1063	1065	1063	503
35°	943	931	912	904	898	589
45°	768	759	741	727	722	592
55°	581	574	559	544	538	519
65°	392	384	372	361	355	387
75°	205	203	196	189	192	219
85°	50	49	48	44	43	56
90°	1	12	20	25	27	7
95°	65	32	39	44	43	77
105°	303	333	61	72	76	323
115°	572	589	614	153	82	564
125°	809	822	841	848	851	722
135°	1002	1018	1026	1036	1034	774
145°	1162	1161	1178	1185	1180	727
155°	1279	1270	1282	1288	1280	589
165°	1348	1342	1345	1352	1345	381
175°	1379	1372	1374	1381	1371	131
180°	1376	1376	1376	1376	1376	

TEST NUMBER: P915947

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1268.9	1268.9	1268.9	1268.9	1268.9
2.5°	1276.3	1270.2	1256.8	1268.9	1266.6
5°	1268.9	1264.1	1250.7	1260.4	1258.1
7.5°	1260.4	1253.1	1239.7	1249.5	1247.1
10°	1247.1	1238.5	1223.9	1233.6	1230.0
12.5°	1228.7	1221.4	1206.8	1212.9	1210.4
15°	1207.9	1200.7	1184.8	1189.7	1183.6
17.5°	1182.3	1175.1	1159.2	1165.2	1159.2
20°	1154.2	1147.0	1129.9	1133.5	1128.8
22.5°	1126.3	1115.2	1099.3	1099.3	1096.9
25°	1093.2	1083.5	1062.8	1065.2	1062.8
27.5°	1056.6	1048.1	1032.3	1028.7	1022.6
30°	1020.1	1010.3	992.1	988.4	983.5
32.5°	981.0	973.8	954.2	946.9	941.9
35°	943.2	931.1	911.5	904.2	898.1
37.5°	900.5	889.5	869.9	861.4	855.3
40°	856.6	846.8	827.2	816.4	811.5
42.5°	813.9	804.0	784.6	772.3	765.1
45°	767.5	759.0	740.6	727.3	722.4
47.5°	722.4	713.8	694.3	680.9	673.6
50°	674.7	668.6	651.6	634.5	628.4
52.5°	628.4	619.9	604.1	590.6	582.0
55°	580.9	573.5	558.9	544.2	538.2
57.5°	533.2	527.2	511.2	496.6	491.7
60°	485.6	480.8	463.7	450.3	446.6
62.5°	439.3	430.7	418.6	406.3	401.5
65°	391.8	384.3	372.2	361.2	355.1
67.5°	342.9	336.7	325.9	317.3	312.4
70°	297.7	292.9	281.8	273.3	268.5
72.5°	251.4	246.5	240.4	231.9	228.2
75°	205.0	202.6	196.4	189.1	191.6
77.5°	163.5	158.6	156.1	152.5	148.9
80°	122.1	120.7	118.3	114.7	112.3
82.5°	83.0	83.0	81.9	76.9	76.9
85°	50.0	48.8	47.6	43.9	42.7
87.5°	22.0	19.6	17.1	13.5	12.1
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	21.0	23.9	25.9	26.8
95°	64.7	31.8	38.8	43.9	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.3	39.9	56.7	64.7	66.7
102.5°	241.9	239.9	58.8	69.6	72.7
105°	302.6	332.6	60.7	71.7	75.7
107.5°	373.3	398.1	62.8	73.6	77.7
110°	441.1	461.9	174.2	74.7	78.6

TEST NUMBER: P915947

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.8	522.6	505.7	76.6	79.7
115°	572.4	589.3	614.2	153.4	81.7
117.5°	631.1	651.0	668.1	525.5	264.8
120°	696.8	711.8	729.7	741.7	607.2
122.5°	752.5	768.5	788.5	794.4	795.5
125°	809.3	822.3	841.2	848.2	851.2
127.5°	861.0	875.0	890.1	899.9	900.9
130°	909.9	925.9	936.7	947.7	946.8
132.5°	959.7	972.7	983.5	992.5	991.6
135°	1001.5	1017.5	1026.3	1036.4	1034.4
137.5°	1045.2	1057.2	1067.2	1077.2	1074.2
140°	1088.0	1096.1	1106.9	1115.9	1111.0
142.5°	1124.0	1131.0	1143.9	1151.8	1146.8
145°	1161.8	1160.7	1177.6	1184.6	1179.7
147.5°	1194.6	1191.6	1208.5	1213.5	1209.6
150°	1226.5	1219.5	1235.4	1241.4	1236.4
152.5°	1253.3	1245.4	1260.3	1266.3	1259.3
155°	1279.2	1270.3	1282.2	1288.2	1280.3
157.5°	1300.1	1292.2	1301.1	1308.1	1300.1
160°	1318.1	1312.1	1318.1	1324.0	1317.0
162.5°	1333.9	1328.0	1332.9	1339.9	1331.0
165°	1347.9	1342.0	1344.9	1351.8	1344.9
167.5°	1358.9	1352.8	1355.9	1362.9	1353.9
170°	1367.8	1361.8	1363.8	1370.8	1361.8
172.5°	1373.8	1367.8	1369.9	1376.8	1367.8
175°	1378.8	1371.7	1373.8	1380.7	1370.8
177.5°	1380.7	1373.8	1374.8	1381.8	1372.8
180°	1375.7	1375.7	1375.7	1375.7	1375.7

TEST NUMBER: P915947

CATALOG NUMBER: DFN2DIP-4P4F0-040D050US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.08	6.90	7.09	7.91	9.26	5.64	6.45	6.64	7.47	8.81
	3H	7.74	8.47	8.76	9.50	10.87	7.25	7.98	8.27	9.01	10.37
	4H	8.33	9.02	9.36	10.05	11.43	7.84	8.53	8.87	9.56	10.93
	6H	8.74	9.37	9.77	10.40	11.79	8.24	8.87	9.27	9.90	11.29
	8H	8.84	9.45	9.88	10.49	11.88	8.34	8.95	9.38	9.99	11.38
	12H	8.89	9.47	9.94	10.51	11.92	8.38	8.96	9.43	10.00	11.41
4H	2H	6.54	7.23	7.57	8.26	9.63	6.18	6.88	7.22	7.90	9.28
	3H	8.41	8.98	9.45	10.04	11.43	8.00	8.58	9.04	9.63	11.02
	4H	9.12	9.65	10.17	10.70	12.11	8.70	9.23	9.75	10.27	11.68
	6H	9.64	10.10	10.70	11.16	12.57	9.21	9.66	10.27	10.73	12.14
	8H	9.79	10.22	10.85	11.28	12.70	9.36	9.78	10.41	10.84	12.26
	12H	9.87	10.25	10.94	11.33	12.75	9.42	9.80	10.49	10.88	12.30
8H	4H	9.32	9.74	10.38	10.80	12.22	8.94	9.36	10.00	10.43	11.85
	6H	9.95	10.30	11.03	11.41	12.83	9.57	9.92	10.65	11.02	12.44
	8H	10.18	10.48	11.27	11.57	13.01	9.78	10.09	10.87	11.18	12.62
	12H	10.31	10.58	11.40	11.66	13.14	9.90	10.17	10.99	11.25	12.73
12H	4H	9.30	9.68	10.38	10.76	12.19	8.93	9.32	10.01	10.39	11.82
	6H	9.98	10.29	11.07	11.38	12.82	9.61	9.92	10.70	11.01	12.44
	8H	10.23	10.50	11.32	11.58	13.06	9.85	10.12	10.94	11.20	12.68

END OF REPORT