

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918733

Luminaire Tested: DFN2DIP-4P4F0-060D070US935-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918733
REPORT IS A COMBINATION OF REPORTS P900654 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-060D070US935-RLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10357.8 lumens
Efficiency: N/A
Efficacy: 84.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 122.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918733

CATALOG NUMBER: DFN2DIP-4P4F0-060D070US935-RLLONL

Luminous Intensity Polar Plot

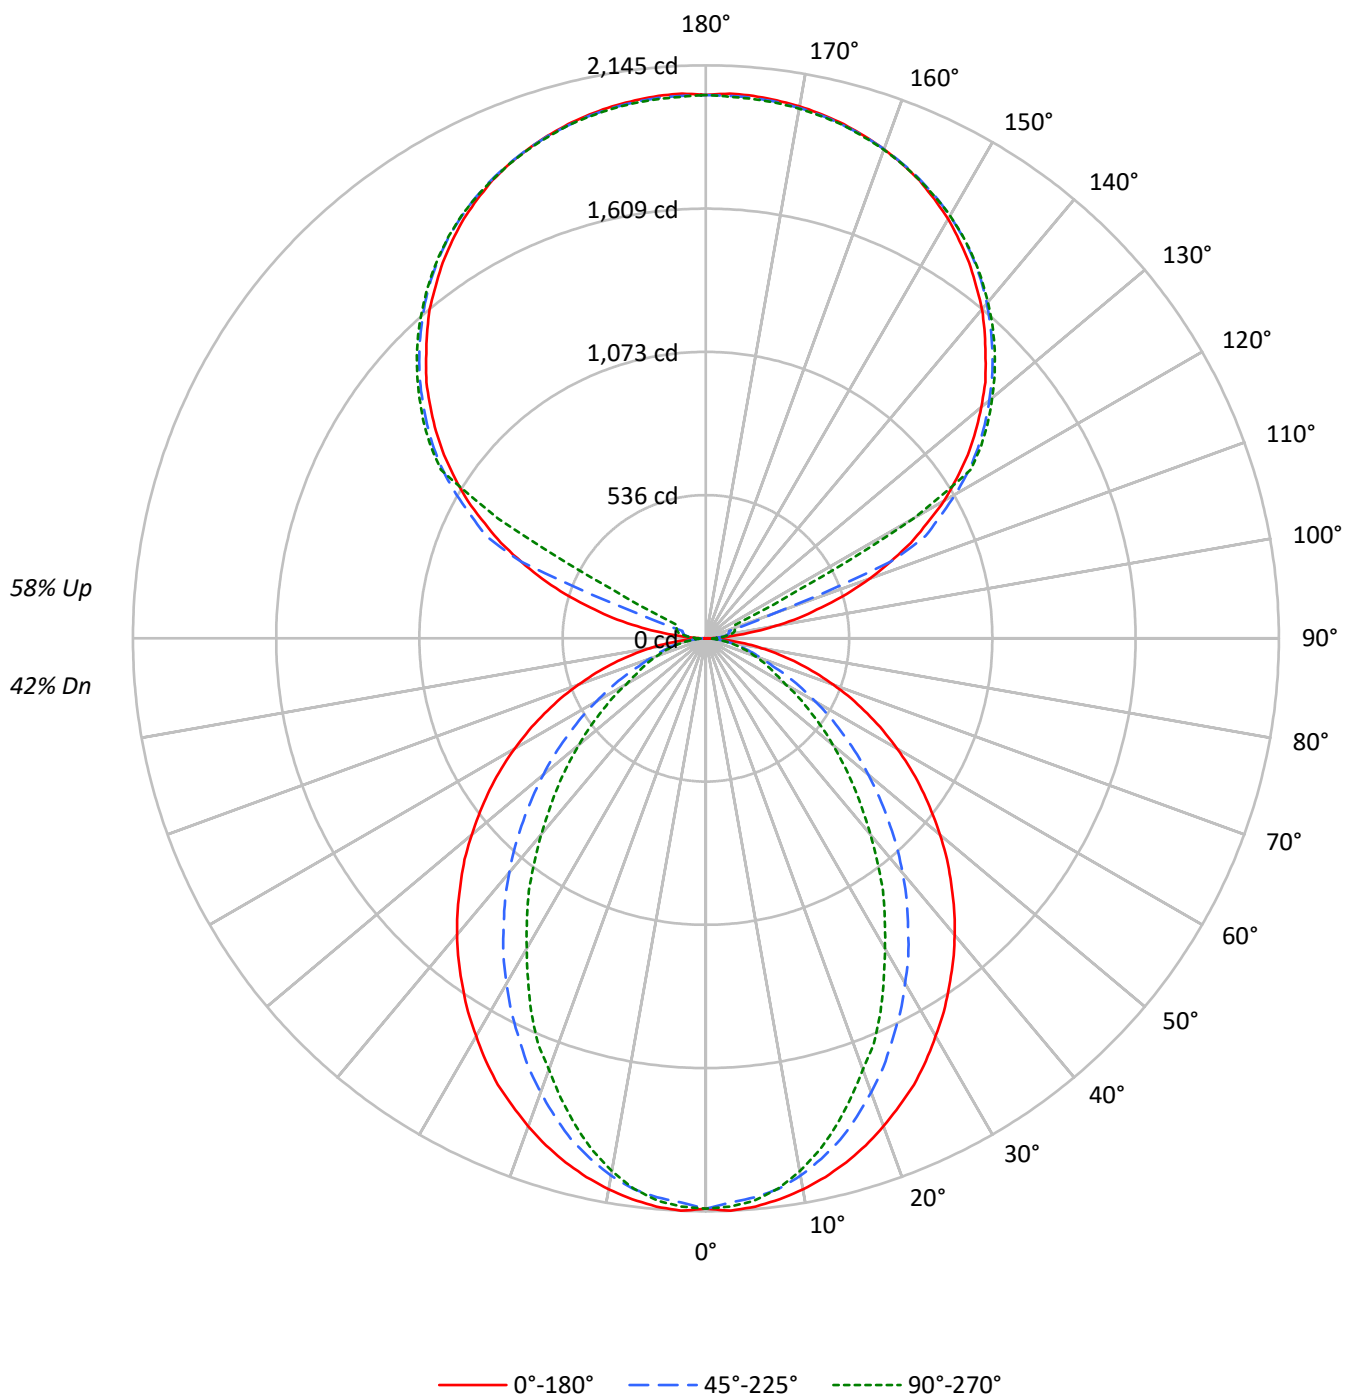

TEST NUMBER: P918733

CATALOG NUMBER: DFN2DIP-4P4F0-060D070US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	89	85	88	85	81	79	70	68	66	56	55	54	44	43	42
2	88	81	75	70	80	74	69	65	62	58	55	50	48	45	39	38	36
3	81	72	65	59	74	66	60	55	55	50	47	45	42	39	35	33	31
4	74	64	56	50	67	59	52	47	49	44	40	40	36	34	32	29	27
5	68	57	49	43	62	52	46	40	44	39	35	36	32	29	29	26	24
6	63	51	43	38	57	47	40	35	40	34	31	33	29	26	26	23	21
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	27	24	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	21	18	16
10	47	35	28	24	43	33	26	22	28	23	20	23	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1385	1385	1385
5°	1387	1364	1372
10°	1374	1337	1328
15°	1355	1293	1260
20°	1330	1233	1175
25°	1305	1165	1094
30°	1270	1095	990
35°	1237	1020	900
40°	1202	943	795
45°	1163	857	701
50°	1122	770	608
55°	1079	677	519
60°	1029	579	428
65°	972	480	386
70°	903	388	350
75°	816	343	320
80°	690	289	279
85°	482	196	213

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1163 cd/sqm

TEST NUMBER: P918733

CATALOG NUMBER: DFN2DIP-4P4F0-060D070US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	1.9
10°-20°	549.3	5.3
20°-30°	771.2	7.4
30°-40°	840.7	8.1
40°-50°	772.7	7.5
50°-60°	606.8	5.9
60°-70°	395.0	3.8
70°-80°	203.3	2.0
80°-90°	55.5	0.5
90°-100°	67.1	0.6
100°-110°	250.0	2.4
110°-120°	663.1	6.4
120°-130°	1099.8	10.6
130°-140°	1168.3	11.3
140°-150°	1085.8	10.5
150°-160°	872.9	8.4
160°-170°	562.5	5.4
170°-180°	193.6	1.9
0°-30°	1520.7	14.7
0°-40°	2361.4	22.8
0°-60°	3740.9	36.1
0°-90°	4394.7	42.4
90°-120°	980.2	9.5
90°-150°	4334.1	41.8
90°-180°	5963.0	57.6
0°-180°	10357.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	1	18	29	37	40	10
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P918733

CATALOG NUMBER: DFN2DIP-4P4F0-060D070US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2

TEST NUMBER: P918733

CATALOG NUMBER: DFN2DIP-4P4F0-060D070US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.1	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.8
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.3
127.5°	1273.1	1293.6	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.2	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.1
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P918733

CATALOG NUMBER: DFN2DIP-4P4F0-060D070US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.55	8.32	8.57	9.35	10.73	3.51	4.28	4.53	5.31	6.69
	3H	9.23	9.92	10.26	10.95	12.35	4.69	5.38	5.73	6.42	7.82
	4H	9.84	10.49	10.88	11.53	12.94	5.14	5.80	6.19	6.84	8.24
	6H	10.26	10.86	11.32	11.91	13.32	5.46	6.06	6.52	7.11	8.53
	8H	10.39	10.96	11.45	12.02	13.43	5.55	6.12	6.61	7.18	8.60
	12H	10.45	10.99	11.52	12.05	13.48	5.59	6.14	6.66	7.19	8.63
4H	2H	7.56	8.21	8.61	9.25	10.66	4.10	4.75	5.15	5.79	7.20
	3H	9.39	9.93	10.45	11.00	12.42	5.45	5.99	6.51	7.06	8.48
	4H	10.08	10.58	11.15	11.64	13.08	5.99	6.49	7.06	7.55	8.99
	6H	10.60	11.03	11.68	12.11	13.55	6.41	6.84	7.49	7.92	9.36
	8H	10.78	11.18	11.86	12.25	13.70	6.54	6.94	7.62	8.01	9.46
	12H	10.87	11.23	11.97	12.32	13.78	6.60	6.96	7.70	8.05	9.51
8H	4H	10.05	10.45	11.12	11.52	12.97	6.27	6.67	7.35	7.75	9.20
	6H	10.62	10.95	11.72	12.06	13.51	6.79	7.12	7.89	8.24	9.68
	8H	10.84	11.13	11.94	12.23	13.69	6.98	7.27	8.09	8.37	9.84
	12H	10.98	11.23	12.09	12.33	13.83	7.10	7.36	8.21	8.45	9.96
12H	4H	10.00	10.36	11.09	11.45	12.90	6.28	6.64	7.37	7.72	9.18
	6H	10.59	10.88	11.70	11.98	13.45	6.84	7.13	7.95	8.23	9.70
	8H	10.81	11.07	11.92	12.16	13.67	7.05	7.31	8.16	8.40	9.91

END OF REPORT