

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918784

Luminaire Tested: DFN2DIP-4P4F0-080D080US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918784
REPORT IS A COMBINATION OF REPORTS P899150 AND P895967
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-080D080US935-RLLFLL
Description: 4 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11950.7 lumens
Efficiency: N/A
Efficacy: 75.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 159.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918784

CATALOG NUMBER: DFN2DIP-4P4F0-080D080US935-RLLFLL

Luminous Intensity Polar Plot

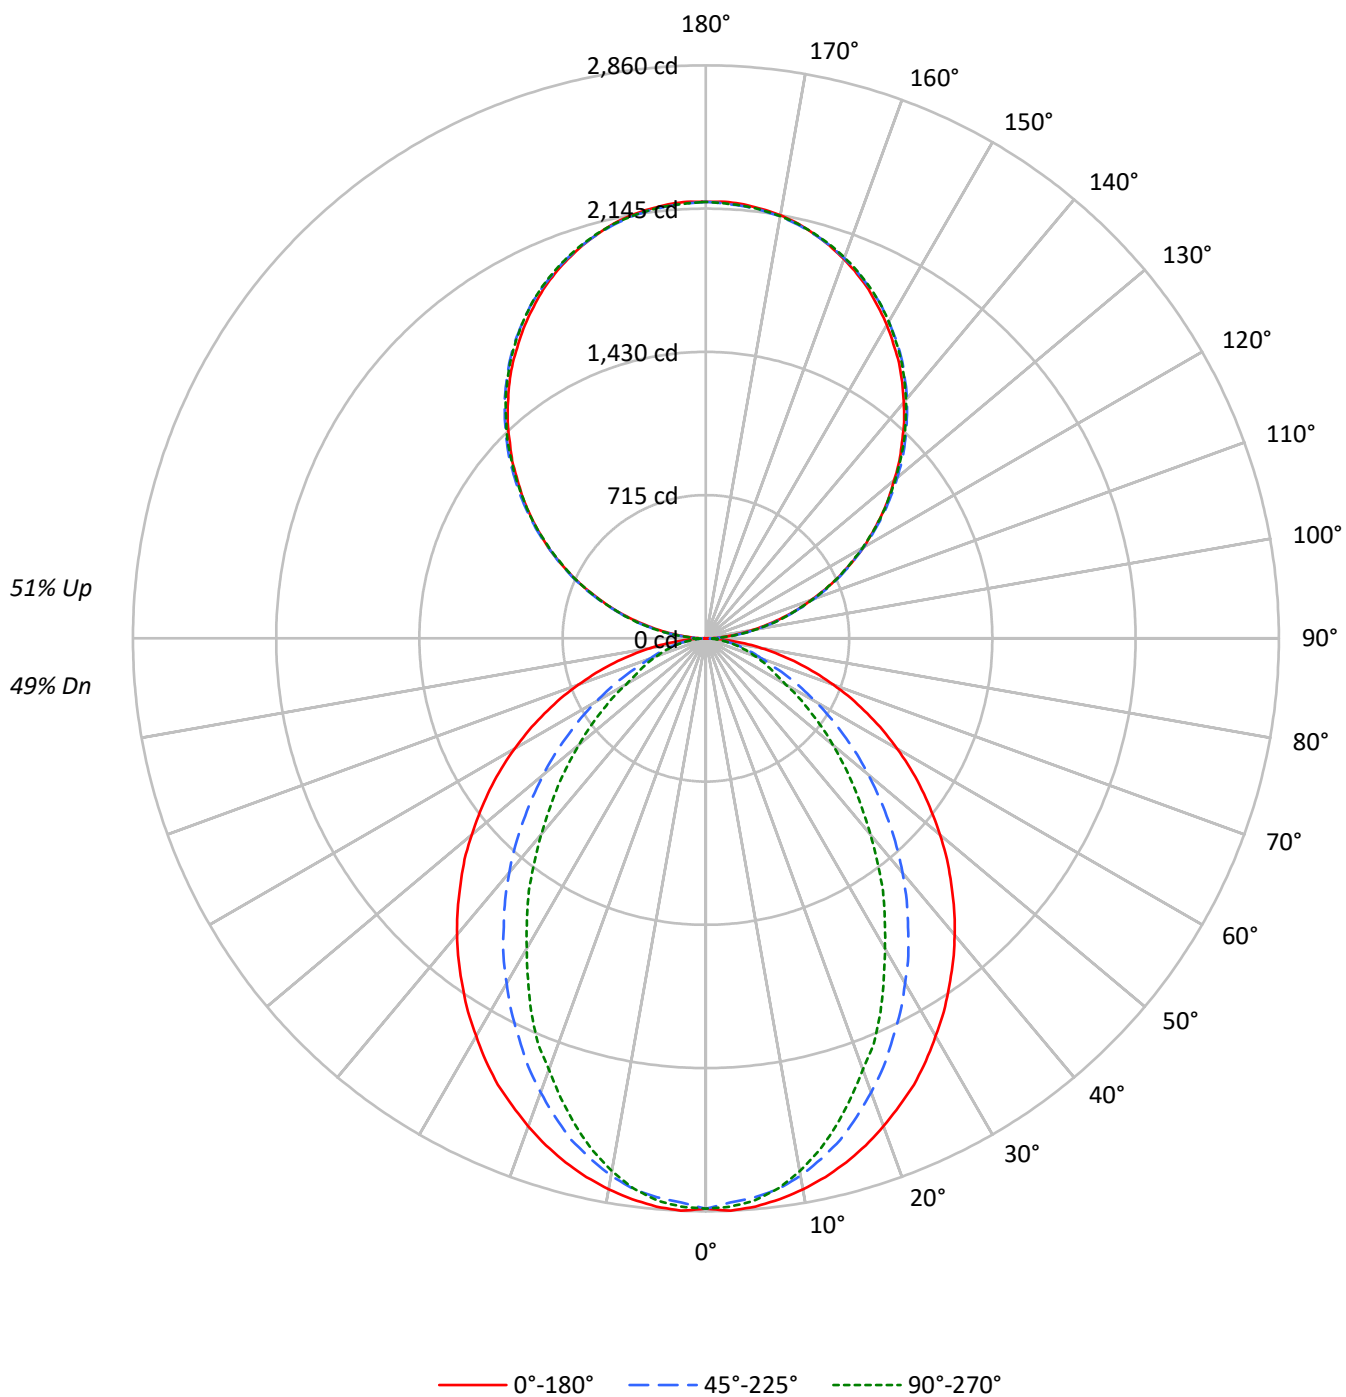

TEST NUMBER: P918784

CATALOG NUMBER: DFN2DIP-4P4F0-080D080US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1847	1847	1847
5°	1850	1818	1830
10°	1832	1783	1771
15°	1807	1725	1679
20°	1773	1644	1567
25°	1739	1553	1459
30°	1694	1461	1321
35°	1649	1361	1199
40°	1603	1257	1060
45°	1550	1142	934
50°	1496	1026	811
55°	1438	902	693
60°	1372	772	571
65°	1296	640	514
70°	1204	517	467
75°	1088	457	426
80°	921	386	372
85°	643	261	284

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1649 cd/sqm

TEST NUMBER: P918784

CATALOG NUMBER: DFN2DIP-4P4F0-080D080US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	266.8	2.2
10°-20°	732.4	6.1
20°-30°	1028.3	8.6
30°-40°	1120.9	9.4
40°-50°	1030.3	8.6
50°-60°	809.1	6.8
60°-70°	526.6	4.4
70°-80°	271.1	2.3
80°-90°	75.4	0.6
90°-100°	134.8	1.1
100°-110°	428.3	3.6
110°-120°	733.0	6.1
120°-130°	964.0	8.1
130°-140°	1082.0	9.1
140°-150°	1061.0	8.9
150°-160°	890.1	7.4
160°-170°	590.3	4.9
170°-180°	206.3	1.7
0°-30°	2027.6	17.0
0°-40°	3148.5	26.3
0°-60°	4987.8	41.7
0°-90°	5861.0	49.0
90°-120°	1296.1	10.8
90°-150°	4403.1	36.8
90°-180°	6090.0	51.0
0°-180°	11950.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2847	2847	2847	2847	2847	
5°	2847	2834	2800	2824	2816	270
15°	2708	2679	2592	2543	2517	763
25°	2458	2375	2205	2100	2061	1130
35°	2118	1986	1760	1597	1540	1326
45°	1731	1559	1288	1105	1043	1337
55°	1316	1116	837	683	634	1176
65°	889	680	448	361	353	881
75°	474	294	206	188	186	501
85°	111	57	49	49	49	127
90°	2	24	64	60	62	12
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P918784

CATALOG NUMBER: DFN2DIP-4P4F0-080D080US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2846.8	2846.8	2846.8	2846.8	2846.8
2.5°	2859.6	2846.8	2818.4	2844.3	2839.1
5°	2846.8	2834.0	2800.3	2823.6	2815.9
7.5°	2823.6	2808.2	2772.2	2782.3	2769.4
10°	2792.6	2774.7	2723.3	2715.3	2700.0
12.5°	2754.2	2730.9	2661.2	2645.8	2617.4
15°	2707.7	2679.3	2591.8	2542.9	2517.1
17.5°	2653.5	2612.3	2504.0	2447.5	2406.1
20°	2591.8	2540.1	2411.4	2347.2	2290.3
22.5°	2524.8	2465.5	2316.0	2228.5	2189.9
25°	2457.8	2375.3	2205.3	2099.8	2061.0
27.5°	2378.0	2290.3	2102.2	1981.2	1921.8
30°	2293.0	2194.9	1988.8	1857.6	1787.9
32.5°	2210.4	2091.9	1880.8	1726.1	1661.6
35°	2117.8	1986.3	1759.7	1597.4	1540.5
37.5°	2027.6	1885.8	1646.3	1468.3	1404.1
40°	1932.3	1777.8	1527.7	1344.8	1277.8
42.5°	1834.4	1669.6	1409.3	1218.6	1154.3
45°	1731.3	1558.6	1288.2	1105.1	1043.4
47.5°	1633.5	1450.6	1172.3	989.2	932.6
50°	1525.2	1342.4	1058.9	881.0	827.1
52.5°	1419.4	1226.1	950.6	780.7	731.8
55°	1316.4	1115.5	837.2	682.8	633.9
57.5°	1210.9	1004.8	736.9	592.6	551.3
60°	1102.6	896.6	631.1	499.9	458.7
62.5°	997.1	791.0	541.0	417.4	396.9
65°	888.9	680.0	448.2	360.8	352.8
67.5°	785.8	577.0	360.8	316.8	309.2
70°	677.6	476.7	298.8	273.0	262.7
72.5°	574.5	383.7	249.9	229.4	224.1
75°	474.0	293.6	206.1	188.0	185.6
77.5°	373.7	208.5	162.4	152.0	146.8
80°	280.7	149.6	123.6	113.4	113.4
82.5°	195.7	100.6	85.0	79.8	79.8
85°	110.7	56.6	48.9	48.9	48.9
87.5°	41.2	20.5	20.5	18.1	18.1
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P918784

CATALOG NUMBER: DFN2DIP-4P4F0-080D080US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P918784

CATALOG NUMBER: DFN2DIP-4P4F0-080D080US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.21	10.03	10.18	11.01	12.30	5.17	5.99	6.14	6.97	8.26
	3H	10.89	11.62	11.87	12.61	13.92	6.36	7.09	7.34	8.08	9.39
	4H	11.50	12.20	12.50	13.19	14.51	6.81	7.50	7.80	8.50	9.81
	6H	11.93	12.57	12.93	13.57	14.90	7.13	7.77	8.14	8.77	10.10
	8H	12.06	12.66	13.07	13.68	15.01	7.22	7.83	8.23	8.84	10.17
	12H	12.12	12.70	13.14	13.71	15.06	7.26	7.84	8.28	8.85	10.20
4H	2H	9.22	9.92	10.23	10.91	12.23	5.76	6.46	6.77	7.45	8.77
	3H	11.06	11.64	12.07	12.66	13.99	7.12	7.69	8.13	8.72	10.05
	4H	11.75	12.28	12.77	13.30	14.65	7.66	8.19	8.68	9.21	10.56
	6H	12.27	12.73	13.30	13.77	15.12	8.09	8.54	9.11	9.58	10.93
	8H	12.45	12.88	13.48	13.91	15.27	8.22	8.64	9.25	9.67	11.04
	12H	12.55	12.93	13.60	13.98	15.35	8.28	8.66	9.33	9.71	11.08
8H	4H	11.72	12.15	12.75	13.18	14.54	7.95	8.37	8.98	9.40	10.77
	6H	12.29	12.64	13.35	13.72	15.08	8.47	8.82	9.52	9.89	11.26
	8H	12.51	12.82	13.58	13.88	15.26	8.66	8.97	9.72	10.03	11.41
	12H	12.66	12.93	13.72	13.98	15.41	8.78	9.05	9.85	10.11	11.53
12H	4H	11.67	12.06	12.72	13.10	14.47	7.95	8.34	9.00	9.38	10.75
	6H	12.27	12.58	13.33	13.64	15.02	8.52	8.83	9.58	9.89	11.27
	8H	12.49	12.76	13.56	13.82	15.24	8.73	9.00	9.80	10.06	11.48

END OF REPORT