

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921375

Luminaire Tested: DFN2DIP-4P4F0-030D040US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921375
REPORT IS A COMBINATION OF REPORTS P900611 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-030D040US940-FLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6179.5 lumens
Efficiency: N/A
Efficacy: 105.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 58.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921375

CATALOG NUMBER: DFN2DIP-4P4F0-030D040US940-FLLONL

Luminous Intensity Polar Plot

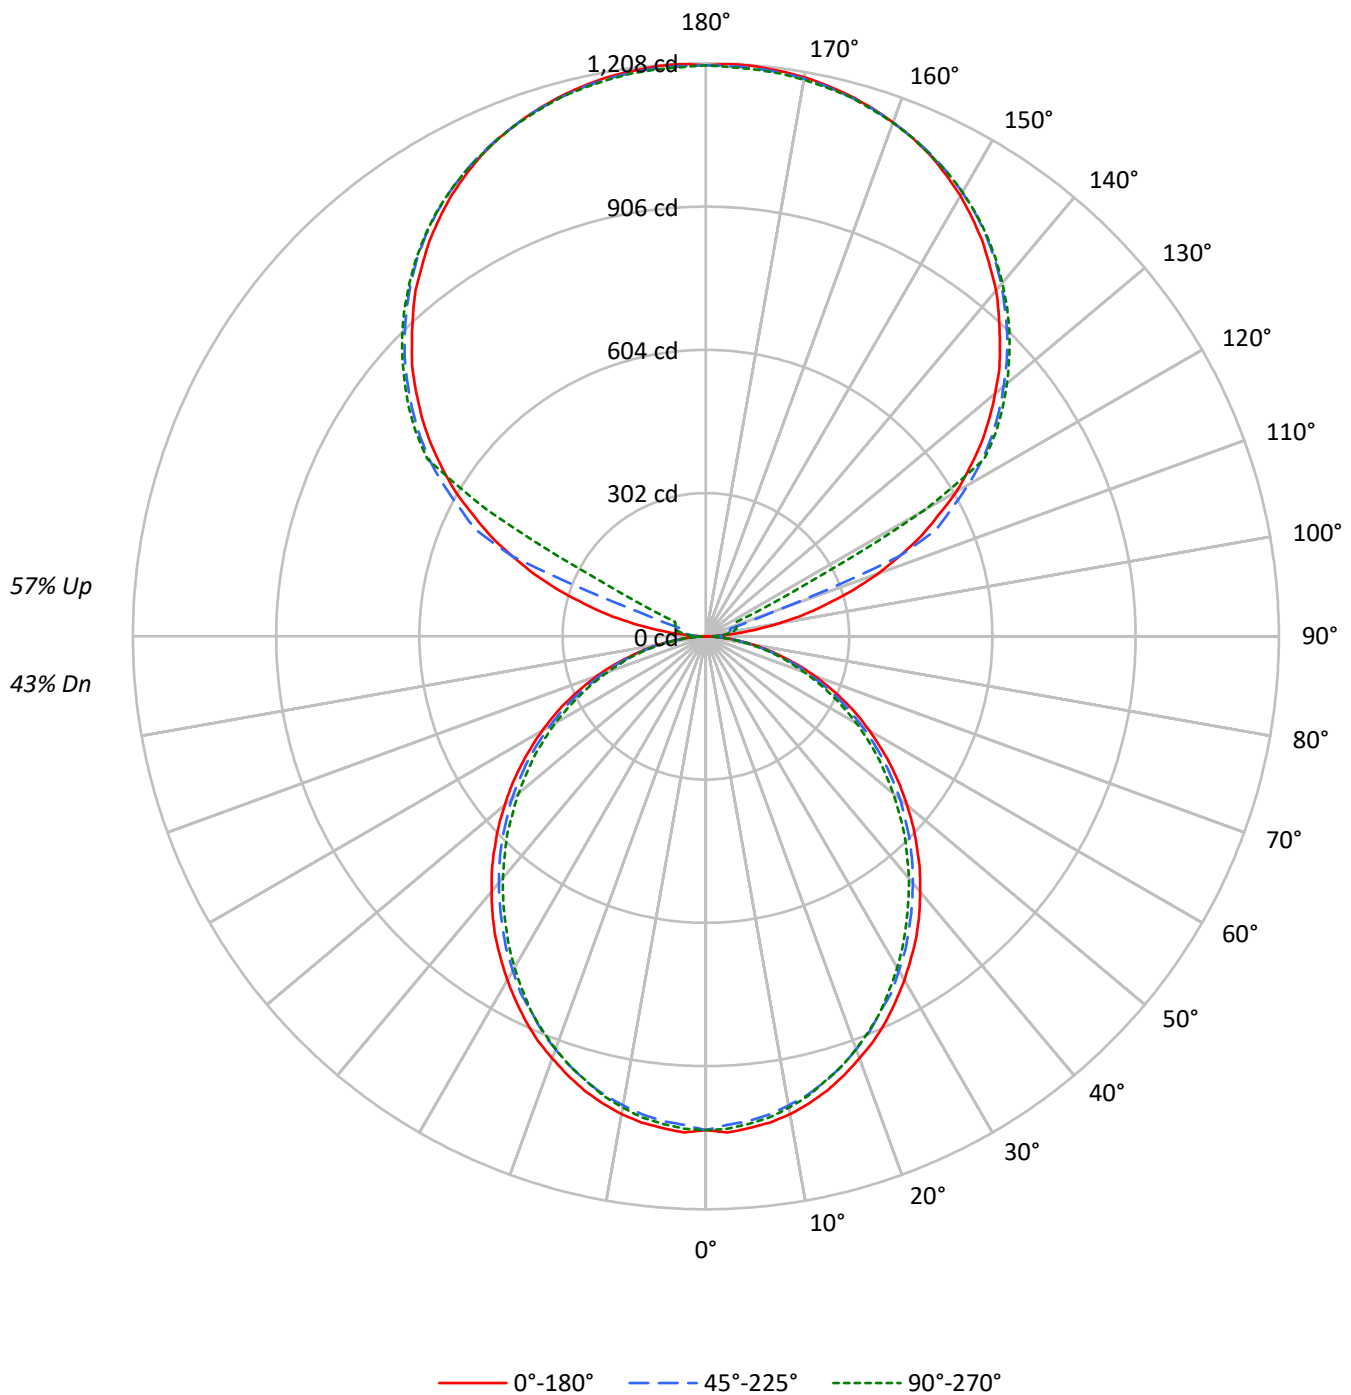

TEST NUMBER: P921375

CATALOG NUMBER: DFN2DIP-4P4F0-030D040US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	71	63	58	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	32	52	41	34	29	35	29	25	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	675	675	675
5°	676	666	671
10°	671	657	662
15°	661	647	648
20°	648	632	634
25°	635	614	617
30°	618	598	596
35°	602	578	574
40°	583	558	552
45°	564	539	531
50°	543	518	505
55°	521	494	482
60°	496	466	456
65°	469	436	425
70°	434	400	391
75°	386	357	361
80°	328	303	302
85°	238	208	203

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 621 cd/sqm

TEST NUMBER: P921375

CATALOG NUMBER: DFN2DIP-4P4F0-030D040US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	98.0	1.6
10°-20°	275.6	4.5
20°-30°	405.1	6.6
30°-40°	470.5	7.6
40°-50°	469.9	7.6
50°-60°	409.8	6.6
60°-70°	302.9	4.9
70°-80°	171.4	2.8
80°-90°	47.3	0.8
90°-100°	39.7	0.6
100°-110°	148.0	2.4
110°-120°	392.4	6.4
120°-130°	650.9	10.5
130°-140°	691.4	11.2
140°-150°	642.6	10.4
150°-160°	516.6	8.4
160°-170°	332.9	5.4
170°-180°	114.6	1.9
0°-30°	778.7	12.6
0°-40°	1249.2	20.2
0°-60°	2128.9	34.5
0°-90°	2650.5	42.9
90°-120°	580.1	9.4
90°-150°	2565.0	41.5
90°-180°	3529.0	57.1
0°-180°	6179.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1041	1041	1041	1041	1041	
5°	1041	1037	1026	1034	1032	99
15°	991	985	972	976	971	279
25°	897	889	872	874	872	413
35°	774	764	748	742	737	483
45°	630	623	608	597	592	486
55°	476	470	458	446	442	426
65°	321	315	305	296	291	318
75°	168	166	161	155	157	179
85°	41	40	39	36	35	46
90°	1	10	17	22	24	6
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P921375

CATALOG NUMBER: DFN2DIP-4P4F0-030D040US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1040.9	1040.9	1040.9	1040.9	1040.9
2.5°	1047.0	1042.0	1030.9	1040.9	1039.0
5°	1040.9	1037.0	1025.9	1033.9	1032.0
7.5°	1033.9	1028.0	1016.9	1025.0	1023.0
10°	1023.0	1015.9	1004.0	1011.9	1009.0
12.5°	1007.9	1001.9	990.0	994.9	992.9
15°	990.9	985.0	971.9	975.9	970.9
17.5°	969.8	963.9	950.8	955.8	950.8
20°	946.8	940.8	926.8	929.8	925.9
22.5°	923.9	914.9	901.8	901.8	899.7
25°	896.8	888.9	871.8	873.8	871.8
27.5°	866.7	859.7	846.8	843.8	838.8
30°	836.8	828.8	813.8	810.7	806.7
32.5°	804.8	798.8	782.7	776.7	772.7
35°	773.7	763.7	747.7	741.6	736.6
37.5°	738.7	729.7	713.6	706.6	701.6
40°	702.7	694.6	678.6	669.7	665.7
42.5°	667.6	659.6	643.6	633.6	627.6
45°	629.6	622.6	607.5	596.6	592.5
47.5°	592.5	585.6	569.5	558.5	552.5
50°	553.5	548.5	534.5	520.5	515.5
52.5°	515.5	508.5	495.5	484.5	477.4
55°	476.5	470.5	458.4	446.5	441.5
57.5°	437.4	432.4	419.4	407.3	403.3
60°	398.3	394.4	380.4	369.3	366.4
62.5°	360.3	353.3	343.3	333.3	329.3
65°	321.4	315.3	305.3	296.3	291.3
67.5°	281.3	276.3	267.2	260.3	256.3
70°	244.2	240.2	231.2	224.2	220.3
72.5°	206.3	202.2	197.2	190.2	187.3
75°	168.1	166.2	161.1	155.2	157.2
77.5°	134.1	130.1	128.0	125.1	122.2
80°	100.1	99.1	97.0	94.1	92.1
82.5°	68.0	68.0	67.1	63.0	63.0
85°	41.0	40.0	39.1	36.0	35.0
87.5°	18.0	16.1	14.0	11.1	10.0
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P921375

CATALOG NUMBER: DFN2DIP-4P4F0-030D040US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8

TEST NUMBER: P921375

CATALOG NUMBER: DFN2DIP-4P4F0-030D040US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.23	6.03	6.25	7.06	8.43	4.79	5.59	5.80	6.61	7.98
	3H	6.89	7.61	7.92	8.65	10.03	6.40	7.12	7.43	8.15	9.54
	4H	7.48	8.16	8.52	9.20	10.60	6.99	7.67	8.03	8.70	10.10
	6H	7.88	8.51	8.93	9.55	10.96	7.38	8.01	8.43	9.05	10.46
	8H	7.99	8.58	9.04	9.64	11.05	7.49	8.08	8.54	9.14	10.54
	12H	8.04	8.60	9.10	9.65	11.08	7.53	8.09	8.59	9.14	10.57
4H	2H	5.69	6.37	6.73	7.40	8.80	5.33	6.01	6.38	7.05	8.44
	3H	7.55	8.12	8.61	9.19	10.60	7.15	7.71	8.20	8.78	10.19
	4H	8.27	8.79	9.33	9.85	11.28	7.85	8.37	8.91	9.42	10.85
	6H	8.79	9.23	9.86	10.31	11.74	8.36	8.80	9.42	9.88	11.31
	8H	8.94	9.36	10.01	10.43	11.87	8.50	8.92	9.57	9.99	11.43
	12H	9.01	9.39	10.10	10.47	11.92	8.56	8.94	9.65	10.02	11.47
8H	4H	8.46	8.88	9.53	9.95	11.39	8.09	8.50	9.16	9.58	11.02
	6H	9.10	9.44	10.19	10.56	12.00	8.71	9.06	9.81	10.17	11.61
	8H	9.32	9.62	10.42	10.72	12.18	8.93	9.23	10.03	10.33	11.79
	12H	9.45	9.72	10.56	10.81	12.31	9.04	9.31	10.15	10.40	11.90
12H	4H	8.45	8.82	9.53	9.91	11.36	8.08	8.46	9.17	9.54	10.99
	6H	9.13	9.43	10.23	10.53	11.99	8.76	9.06	9.86	10.16	11.61
	8H	9.37	9.64	10.47	10.73	12.23	8.99	9.26	10.09	10.35	11.85

END OF REPORT