

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921502

Luminaire Tested: DFN2DIP-4P4F0-080D060US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921502
REPORT IS A COMBINATION OF REPORTS P899125 AND P895967
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-080D060US940-FLLFLL
Description: 4 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11797.4 lumens
Efficiency: N/A
Efficacy: 86.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 136.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921502

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US940-FLLFLL

Luminous Intensity Polar Plot

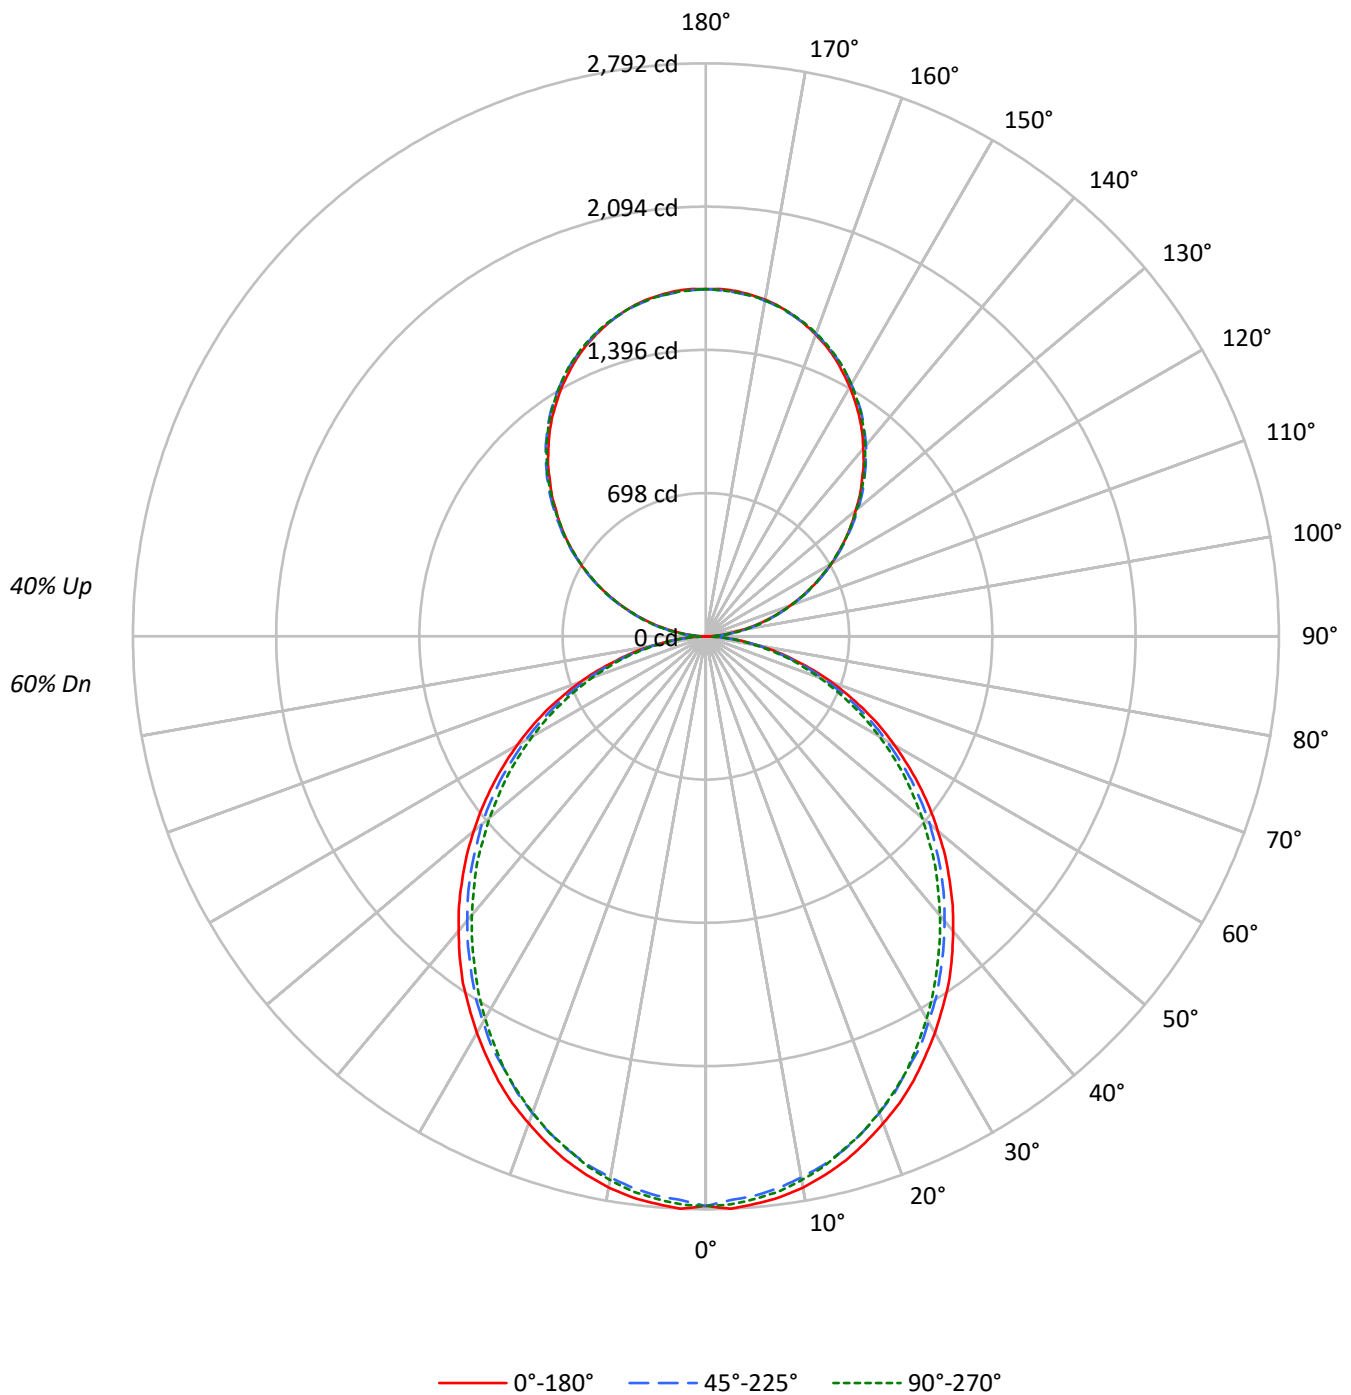

TEST NUMBER: P921502

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	89	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	43	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	29	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1801	1801	1801
5°	1804	1776	1788
10°	1789	1753	1765
15°	1763	1725	1728
20°	1728	1685	1690
25°	1692	1638	1645
30°	1648	1594	1589
35°	1606	1542	1529
40°	1555	1489	1473
45°	1503	1436	1415
50°	1447	1381	1348
55°	1388	1317	1286
60°	1322	1241	1216
65°	1250	1163	1133
70°	1157	1068	1044
75°	1029	953	962
80°	876	808	805
85°	635	555	543

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1503 cd/sqm

TEST NUMBER: P921502

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	261.3	2.2
10°-20°	735.1	6.2
20°-30°	1080.3	9.2
30°-40°	1254.7	10.6
40°-50°	1253.1	10.6
50°-60°	1092.7	9.3
60°-70°	807.7	6.8
70°-80°	457.0	3.9
80°-90°	125.4	1.1
90°-100°	104.7	0.9
100°-110°	332.7	2.8
110°-120°	569.3	4.8
120°-130°	748.8	6.3
130°-140°	840.5	7.1
140°-150°	824.2	7.0
150°-160°	691.4	5.9
160°-170°	458.5	3.9
170°-180°	160.3	1.4
0°-30°	2076.6	17.6
0°-40°	3331.3	28.2
0°-60°	5677.0	48.1
0°-90°	7067.2	59.9
90°-120°	1006.7	8.5
90°-150°	3420.1	29.0
90°-180°	4730.0	40.1
0°-180°	11797.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2776	2776	2776	2776	2776	
5°	2776	2765	2736	2757	2752	263
15°	2642	2626	2592	2602	2589	744
25°	2392	2370	2325	2330	2325	1100
35°	2063	2037	1994	1978	1964	1288
45°	1679	1660	1620	1591	1580	1296
55°	1271	1254	1222	1190	1177	1136
65°	857	841	814	790	777	847
75°	448	443	430	414	419	479
85°	109	107	104	96	94	122
90°	2	18	50	47	48	11
95°	74	89	91	91	89	83
105°	307	311	314	317	317	324
115°	571	580	577	575	571	565
125°	831	844	840	835	834	743
135°	1075	1091	1094	1092	1088	831
145°	1305	1315	1323	1325	1319	815
155°	1492	1496	1501	1508	1503	687
165°	1623	1622	1622	1632	1625	458
175°	1689	1685	1682	1692	1683	160
180°	1692	1692	1692	1692	1692	

TEST NUMBER: P921502

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2775.7	2775.7	2775.7	2775.7	2775.7
2.5°	2791.9	2778.6	2749.1	2775.7	2770.6
5°	2775.7	2765.3	2735.9	2757.1	2752.0
7.5°	2757.1	2741.2	2711.8	2733.3	2727.9
10°	2727.9	2709.2	2677.2	2698.4	2690.6
12.5°	2687.7	2671.8	2639.8	2653.1	2647.8
15°	2642.4	2626.5	2591.7	2602.5	2589.2
17.5°	2586.3	2570.4	2535.6	2549.0	2535.6
20°	2524.9	2509.0	2471.6	2479.6	2469.1
22.5°	2463.7	2439.6	2404.8	2404.8	2399.4
25°	2391.5	2370.3	2325.0	2330.0	2325.0
27.5°	2311.3	2292.7	2258.1	2250.1	2236.9
30°	2231.5	2209.9	2170.1	2162.1	2151.3
32.5°	2146.0	2130.1	2087.3	2071.2	2060.5
35°	2063.2	2036.7	1993.9	1977.7	1964.4
37.5°	1969.8	1945.7	1903.0	1884.3	1871.0
40°	1873.8	1852.3	1809.5	1785.7	1774.9
42.5°	1780.4	1758.8	1716.4	1689.4	1673.7
45°	1679.0	1660.3	1620.1	1590.9	1580.2
47.5°	1580.2	1561.5	1518.7	1489.2	1473.4
50°	1476.0	1462.7	1425.2	1387.9	1374.6
52.5°	1374.6	1355.8	1321.3	1291.9	1273.2
55°	1270.6	1254.5	1222.5	1190.5	1177.1
57.5°	1166.4	1153.2	1118.3	1086.3	1075.5
60°	1062.2	1051.8	1014.3	984.9	977.0
62.5°	960.8	942.2	915.5	888.9	878.2
65°	856.9	840.8	814.1	790.1	776.8
67.5°	750.1	736.6	712.7	694.1	683.3
70°	651.3	640.5	616.5	597.8	587.3
72.5°	549.9	539.2	525.8	507.2	499.3
75°	448.3	443.2	429.6	413.8	419.1
77.5°	357.7	346.9	341.5	333.6	325.7
80°	267.1	264.2	258.9	250.9	245.5
82.5°	181.6	181.6	179.0	168.2	168.2
85°	109.3	106.7	104.2	96.0	93.5
87.5°	48.2	42.8	37.4	29.4	26.7
90°	1.5	18.4	50.0	46.9	48.4
92.5°	31.7	42.9	44.4	45.9	45.9
95°	74.5	88.7	91.3	91.3	88.7
97.5°	123.9	137.2	142.9	142.9	142.9
100°	181.1	192.8	196.9	196.9	195.4
102.5°	241.3	249.9	255.6	257.1	255.6
105°	307.1	311.2	314.2	316.8	316.8
107.5°	372.4	378.5	378.5	379.5	372.4
110°	435.7	443.8	443.8	443.8	439.7

TEST NUMBER: P921502

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.0	512.6	511.1	507.0	504.0
115°	571.3	579.5	576.9	575.4	571.3
117.5°	638.2	649.4	642.2	638.2	634.1
120°	705.5	716.8	705.5	705.5	700.9
122.5°	766.7	781.0	773.8	769.8	766.7
125°	831.0	843.7	839.6	835.1	833.6
127.5°	893.8	909.5	903.9	897.9	893.8
130°	952.4	970.8	968.2	965.2	959.6
132.5°	1018.2	1032.5	1033.5	1026.4	1022.3
135°	1074.9	1090.7	1093.7	1092.2	1088.1
137.5°	1138.1	1150.8	1153.4	1152.4	1146.3
140°	1193.7	1206.5	1213.6	1213.6	1208.0
142.5°	1250.8	1263.6	1267.7	1269.2	1263.6
145°	1304.9	1315.1	1323.3	1324.8	1319.2
147.5°	1353.3	1366.1	1372.3	1374.7	1369.1
150°	1403.4	1412.0	1417.6	1422.2	1417.6
152.5°	1447.7	1456.4	1463.6	1469.2	1463.6
155°	1492.1	1496.2	1500.7	1508.0	1503.3
157.5°	1530.4	1533.5	1536.0	1546.2	1539.1
160°	1564.6	1567.6	1569.1	1577.8	1571.7
162.5°	1596.2	1596.2	1597.7	1607.4	1600.3
165°	1623.2	1621.7	1621.7	1631.9	1624.8
167.5°	1647.7	1643.2	1643.2	1653.3	1646.2
170°	1666.1	1662.0	1660.5	1670.6	1662.0
172.5°	1678.8	1674.7	1673.2	1683.4	1674.7
175°	1689.0	1685.0	1681.9	1692.1	1683.4
177.5°	1694.6	1690.6	1687.5	1696.1	1687.5
180°	1692.1	1692.1	1692.1	1692.1	1692.1

TEST NUMBER: P921502

CATALOG NUMBER: DFN2DIP-4P4F0-080D060US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.20	11.16	11.07	12.05	13.17	9.76	10.71	10.62	11.60	12.73
	3H	11.87	12.73	12.75	13.63	14.78	11.38	12.24	12.26	13.14	14.29
	4H	12.47	13.28	13.36	14.19	15.34	11.98	12.79	12.87	13.69	14.85
	6H	12.88	13.63	13.79	14.54	15.71	12.38	13.13	13.29	14.04	15.21
	8H	12.99	13.70	13.90	14.63	15.80	12.49	13.20	13.40	14.13	15.30
	12H	13.04	13.72	13.96	14.64	15.84	12.53	13.21	13.45	14.13	15.33
4H	2H	10.67	11.49	11.57	12.39	13.55	10.32	11.13	11.22	12.04	13.19
	3H	12.55	13.23	13.47	14.17	15.34	12.15	12.83	13.06	13.76	14.93
	4H	13.28	13.90	14.20	14.83	16.03	12.85	13.47	13.78	14.40	15.60
	6H	13.80	14.34	14.74	15.29	16.49	13.37	13.91	14.31	14.86	16.06
	8H	13.96	14.46	14.90	15.41	16.62	13.52	14.02	14.46	14.97	16.18
	12H	14.04	14.49	15.00	15.46	16.68	13.59	14.04	14.55	15.01	16.23
8H	4H	13.48	13.98	14.42	14.93	16.14	13.11	13.61	14.04	14.55	15.77
	6H	14.12	14.54	15.09	15.53	16.74	13.74	14.16	14.71	15.15	16.36
	8H	14.35	14.72	15.32	15.70	16.93	13.96	14.32	14.93	15.30	16.53
	12H	14.49	14.81	15.47	15.79	17.06	14.08	14.40	15.06	15.37	16.65
12H	4H	13.47	13.92	14.43	14.89	16.11	13.11	13.56	14.06	14.52	15.74
	6H	14.16	14.52	15.13	15.50	16.73	13.78	14.15	14.76	15.13	16.36
	8H	14.41	14.73	15.38	15.70	16.98	14.03	14.35	15.00	15.32	16.60

END OF REPORT