

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924181

Luminaire Tested: DFN2DIP-4P4F0-060D050US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924181
REPORT IS A COMBINATION OF REPORTS P900630 AND P897523
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P4F0-060D050US950-RLLONL
Description: 4 foot, 90deg - 4way Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9587.7 lumens
Efficiency: N/A
Efficacy: 94.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 4.07' x L: 4.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 101.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924181

CATALOG NUMBER: DFN2DIP-4P4F0-060D050US950-RLLONL

Luminous Intensity Polar Plot

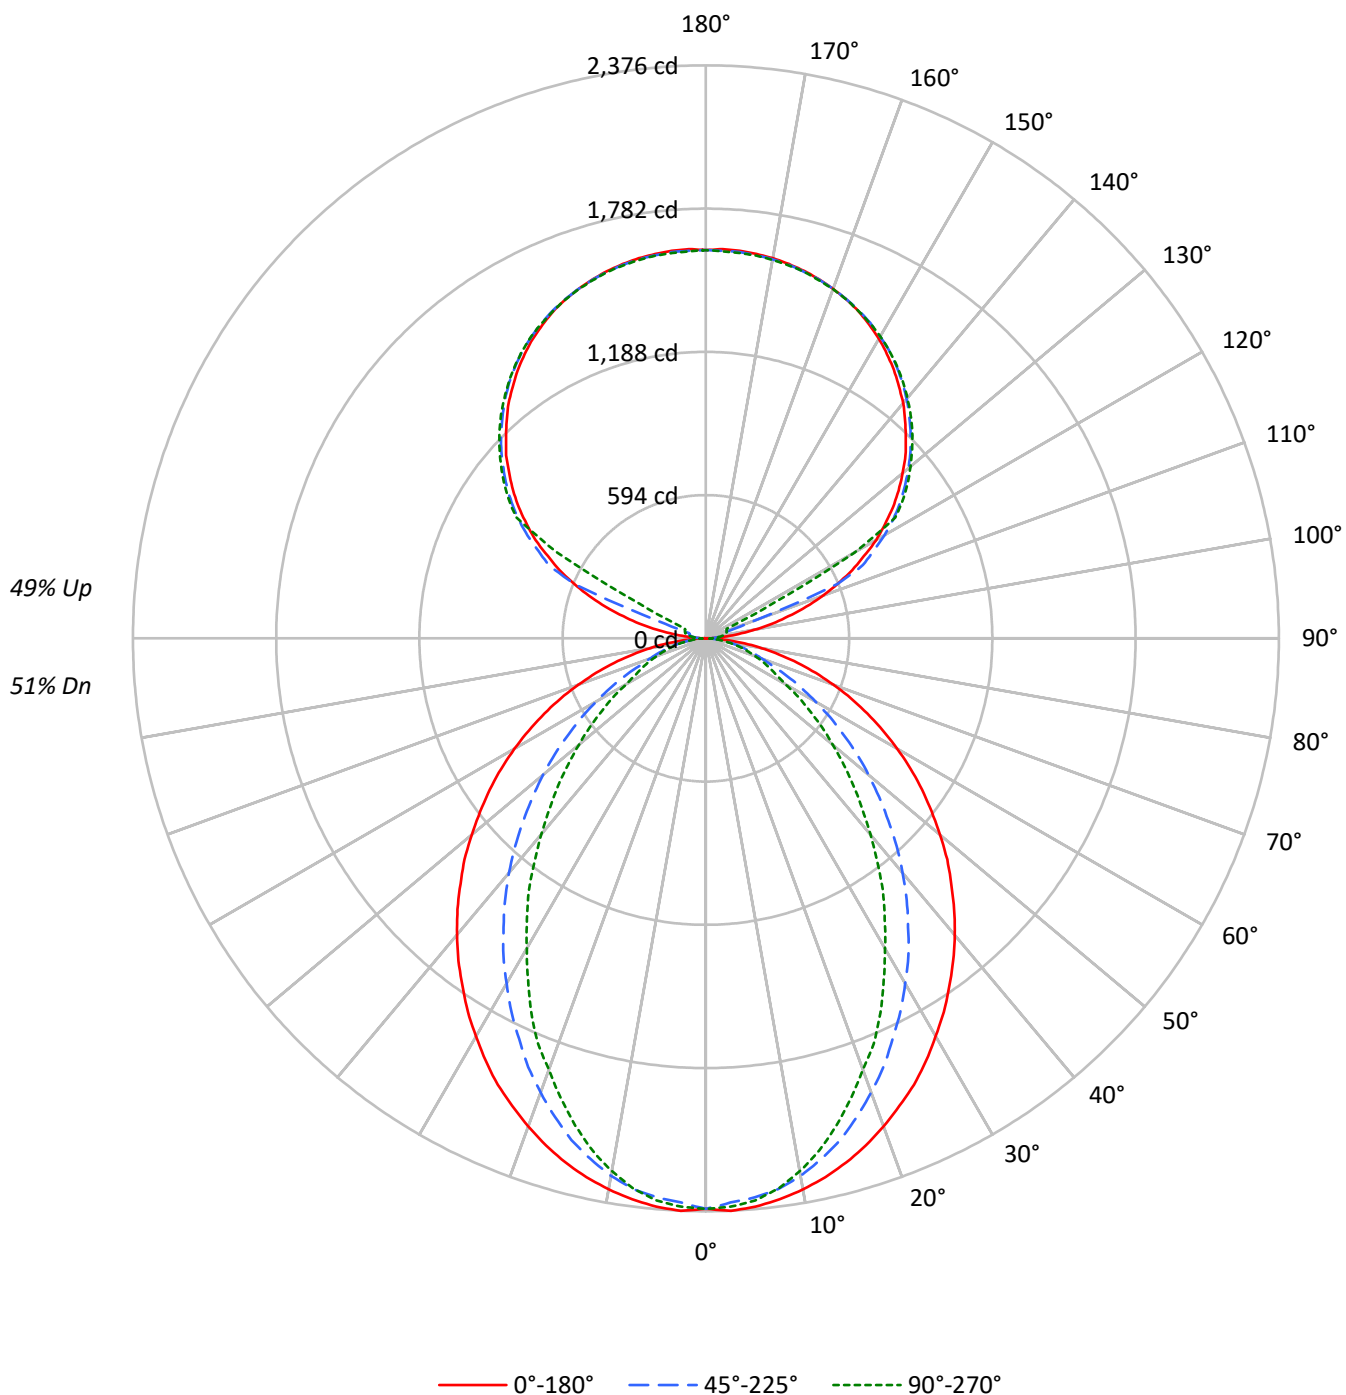

TEST NUMBER: P924181

CATALOG NUMBER: DFN2DIP-4P4F0-060D050US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	67	66	62	59	55	52	50	45	44	42
3	82	73	66	61	76	68	62	57	58	54	50	49	46	43	41	38	36
4	76	65	58	52	70	61	54	49	52	47	43	44	40	37	37	34	32
5	70	58	50	45	64	54	47	42	47	41	37	40	36	33	33	30	28
6	64	53	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	30	26	23	26	23	20
9	52	40	32	27	48	37	31	26	32	27	23	28	24	21	24	21	18
10	48	36	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1535	1535	1535
5°	1537	1511	1521
10°	1522	1482	1472
15°	1501	1433	1396
20°	1474	1366	1302
25°	1445	1291	1212
30°	1407	1214	1097
35°	1370	1131	997
40°	1332	1045	881
45°	1288	949	776
50°	1243	853	674
55°	1195	750	576
60°	1140	642	474
65°	1077	532	428
70°	1001	430	388
75°	904	380	354
80°	765	321	309
85°	535	216	236

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1288 cd/sqm

TEST NUMBER: P924181

CATALOG NUMBER: DFN2DIP-4P4F0-060D050US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	2.3
10°-20°	608.7	6.3
20°-30°	854.5	8.9
30°-40°	931.5	9.7
40°-50°	856.2	8.9
50°-60°	672.4	7.0
60°-70°	437.7	4.6
70°-80°	225.3	2.3
80°-90°	60.3	0.6
90°-100°	53.1	0.6
100°-110°	197.9	2.1
110°-120°	524.8	5.5
120°-130°	870.4	9.1
130°-140°	924.6	9.6
140°-150°	859.3	9.0
150°-160°	690.9	7.2
160°-170°	445.2	4.6
170°-180°	153.2	1.6
0°-30°	1684.9	17.6
0°-40°	2616.4	27.3
0°-60°	4144.9	43.2
0°-90°	4868.2	50.8
90°-120°	775.8	8.1
90°-150°	3430.2	35.8
90°-180°	4719.0	49.2
0°-180°	9587.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2366	2366	2366	2366	2366	
5°	2366	2355	2327	2346	2340	224
15°	2250	2226	2154	2113	2092	634
25°	2042	1974	1833	1745	1713	939
35°	1760	1651	1462	1327	1280	1102
45°	1439	1295	1071	918	867	1111
55°	1094	927	696	567	527	978
65°	739	565	372	300	293	732
75°	394	244	171	156	154	417
85°	92	47	41	41	41	106
90°	1	14	23	29	31	9
95°	76	37	45	51	50	90
105°	354	389	71	84	88	378
115°	670	690	719	179	96	659
125°	947	962	984	992	996	845
135°	1172	1191	1201	1213	1210	905
145°	1359	1358	1378	1386	1380	850
155°	1497	1486	1500	1507	1498	690
165°	1577	1570	1574	1582	1574	446
175°	1613	1605	1608	1616	1604	154
180°	1610	1610	1610	1610	1610	

TEST NUMBER: P924181

CATALOG NUMBER: DFN2DIP-4P4F0-060D050US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2365.7	2365.7	2365.7	2365.7	2365.7
2.5°	2376.4	2365.7	2342.1	2363.6	2359.3
5°	2365.7	2355.0	2327.1	2346.5	2340.1
7.5°	2346.5	2333.7	2303.7	2312.1	2301.4
10°	2320.7	2305.7	2263.1	2256.5	2243.7
12.5°	2288.7	2269.4	2211.5	2198.8	2175.1
15°	2250.1	2226.4	2153.8	2113.1	2091.7
17.5°	2205.2	2170.8	2080.9	2033.8	1999.6
20°	2153.8	2110.8	2003.9	1950.5	1903.2
22.5°	2098.1	2048.8	1924.6	1851.9	1819.9
25°	2042.5	1973.9	1832.6	1745.0	1712.7
27.5°	1976.2	1903.2	1747.0	1646.3	1597.1
30°	1905.5	1824.0	1652.7	1543.7	1485.8
32.5°	1836.9	1738.4	1563.0	1434.4	1380.8
35°	1759.9	1650.7	1462.4	1327.4	1280.2
37.5°	1685.0	1567.0	1368.1	1220.3	1166.8
40°	1605.7	1477.4	1269.5	1117.5	1061.9
42.5°	1524.4	1387.4	1171.1	1012.6	959.2
45°	1438.7	1295.2	1070.6	918.3	867.0
47.5°	1357.4	1205.5	974.2	822.1	775.0
50°	1267.5	1115.5	880.0	732.1	687.4
52.5°	1179.5	1019.0	790.0	648.7	608.1
55°	1094.0	927.0	695.8	567.4	526.7
57.5°	1006.3	834.9	612.4	492.5	458.1
60°	916.3	745.1	524.5	415.5	381.1
62.5°	828.6	657.4	449.5	346.9	329.8
65°	738.7	565.1	372.5	299.8	293.3
67.5°	653.0	479.5	299.8	263.3	256.9
70°	563.1	396.1	248.2	227.0	218.3
72.5°	477.5	318.9	207.6	190.6	186.2
75°	393.9	243.9	171.2	156.3	154.3
77.5°	310.5	173.3	134.9	126.3	122.0
80°	233.3	124.2	102.7	94.3	94.3
82.5°	162.7	83.6	70.6	66.3	66.3
85°	92.0	47.0	40.6	40.6	40.6
87.5°	34.3	17.1	17.1	15.0	15.0
90°	1.1	13.9	23.3	29.2	31.4
92.5°	29.2	24.5	28.0	30.3	31.4
95°	75.7	37.2	45.4	51.3	50.1
97.5°	136.2	40.8	59.3	63.0	64.0
100°	206.3	46.7	66.4	75.7	78.0
102.5°	283.1	280.8	68.8	81.5	85.1
105°	354.1	389.1	71.1	83.9	88.5
107.5°	436.8	465.8	73.5	86.1	90.9
110°	516.1	540.4	203.9	87.4	92.0

TEST NUMBER: P924181

CATALOG NUMBER: DFN2DIP-4P4F0-060D050US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	590.6	611.5	591.8	89.7	93.2
115°	669.8	689.6	718.7	179.4	95.6
117.5°	738.5	761.8	781.7	614.9	309.9
120°	815.4	832.8	853.8	867.9	710.5
122.5°	880.5	899.2	922.6	929.6	930.8
125°	946.9	962.2	984.3	992.4	996.0
127.5°	1007.5	1023.8	1041.5	1053.0	1054.2
130°	1064.7	1083.4	1096.1	1108.9	1107.9
132.5°	1123.0	1138.1	1150.8	1161.4	1160.3
135°	1171.9	1190.6	1200.9	1212.7	1210.3
137.5°	1223.0	1237.1	1248.8	1260.4	1257.0
140°	1273.1	1282.6	1295.2	1305.7	1300.0
142.5°	1315.2	1323.4	1338.5	1347.7	1341.9
145°	1359.4	1358.2	1378.0	1386.2	1380.3
147.5°	1397.8	1394.3	1414.1	1419.9	1415.4
150°	1435.1	1427.0	1445.6	1452.6	1446.7
152.5°	1466.5	1457.2	1474.7	1481.8	1473.5
155°	1496.8	1486.4	1500.4	1507.3	1498.1
157.5°	1521.2	1512.0	1522.5	1530.7	1521.2
160°	1542.3	1535.3	1542.3	1549.2	1541.1
162.5°	1560.8	1554.0	1559.7	1567.9	1557.4
165°	1577.2	1570.3	1573.7	1581.8	1573.7
167.5°	1590.0	1583.0	1586.6	1594.7	1584.2
170°	1600.5	1593.5	1595.9	1604.0	1593.5
172.5°	1607.5	1600.5	1602.9	1611.0	1600.5
175°	1613.3	1605.1	1607.5	1615.6	1604.0
177.5°	1615.6	1607.5	1608.7	1616.8	1606.3
180°	1609.8	1609.8	1609.8	1609.8	1609.8

TEST NUMBER: P924181

CATALOG NUMBER: DFN2DIP-4P4F0-060D050US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.73	9.56	9.68	10.53	11.79	4.69	5.52	5.65	6.49	7.76
	3H	10.41	11.16	11.38	12.14	13.42	5.88	6.63	6.85	7.60	8.89
	4H	11.02	11.73	12.01	12.71	14.01	6.33	7.04	7.31	8.02	9.31
	6H	11.45	12.10	12.44	13.09	14.39	6.65	7.30	7.65	8.29	9.60
	8H	11.58	12.20	12.58	13.20	14.50	6.75	7.36	7.74	8.37	9.67
	12H	11.64	12.23	12.65	13.23	14.56	6.79	7.38	7.79	8.37	9.70
4H	2H	8.75	9.45	9.73	10.43	11.73	5.29	5.99	6.28	6.98	8.27
	3H	10.58	11.17	11.58	12.18	13.49	6.64	7.23	7.64	8.24	9.55
	4H	11.28	11.82	12.28	12.82	14.15	7.19	7.73	8.20	8.73	10.06
	6H	11.80	12.26	12.82	13.29	14.62	7.61	8.07	8.63	9.10	10.43
	8H	11.98	12.41	13.00	13.43	14.77	7.74	8.17	8.76	9.19	10.54
	12H	12.08	12.47	13.11	13.50	14.85	7.81	8.20	8.84	9.23	10.58
8H	4H	11.25	11.68	12.27	12.70	14.04	7.47	7.90	8.49	8.92	10.27
	6H	11.82	12.17	12.86	13.24	14.58	8.00	8.35	9.04	9.41	10.75
	8H	12.04	12.35	13.09	13.40	14.76	8.19	8.50	9.24	9.55	10.91
	12H	12.18	12.46	13.24	13.50	14.90	8.31	8.58	9.36	9.63	11.03
12H	4H	11.20	11.59	12.24	12.62	13.97	7.48	7.87	8.52	8.90	10.25
	6H	11.80	12.11	12.84	13.16	14.52	8.05	8.36	9.10	9.41	10.77
	8H	12.02	12.30	13.07	13.34	14.74	8.26	8.53	9.31	9.58	10.98

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8