

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902429

Luminaire Tested: DFN2DIP-HX2F0-020D040US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902429
REPORT IS A COMBINATION OF REPORTS P900692 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-020D040US830-RLLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5334.8 lumens
Efficiency: N/A
Efficacy: 119.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 44.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902429

CATALOG NUMBER: DFN2DIP-HX2F0-020D040US830-RLLONL

Luminous Intensity Polar Plot

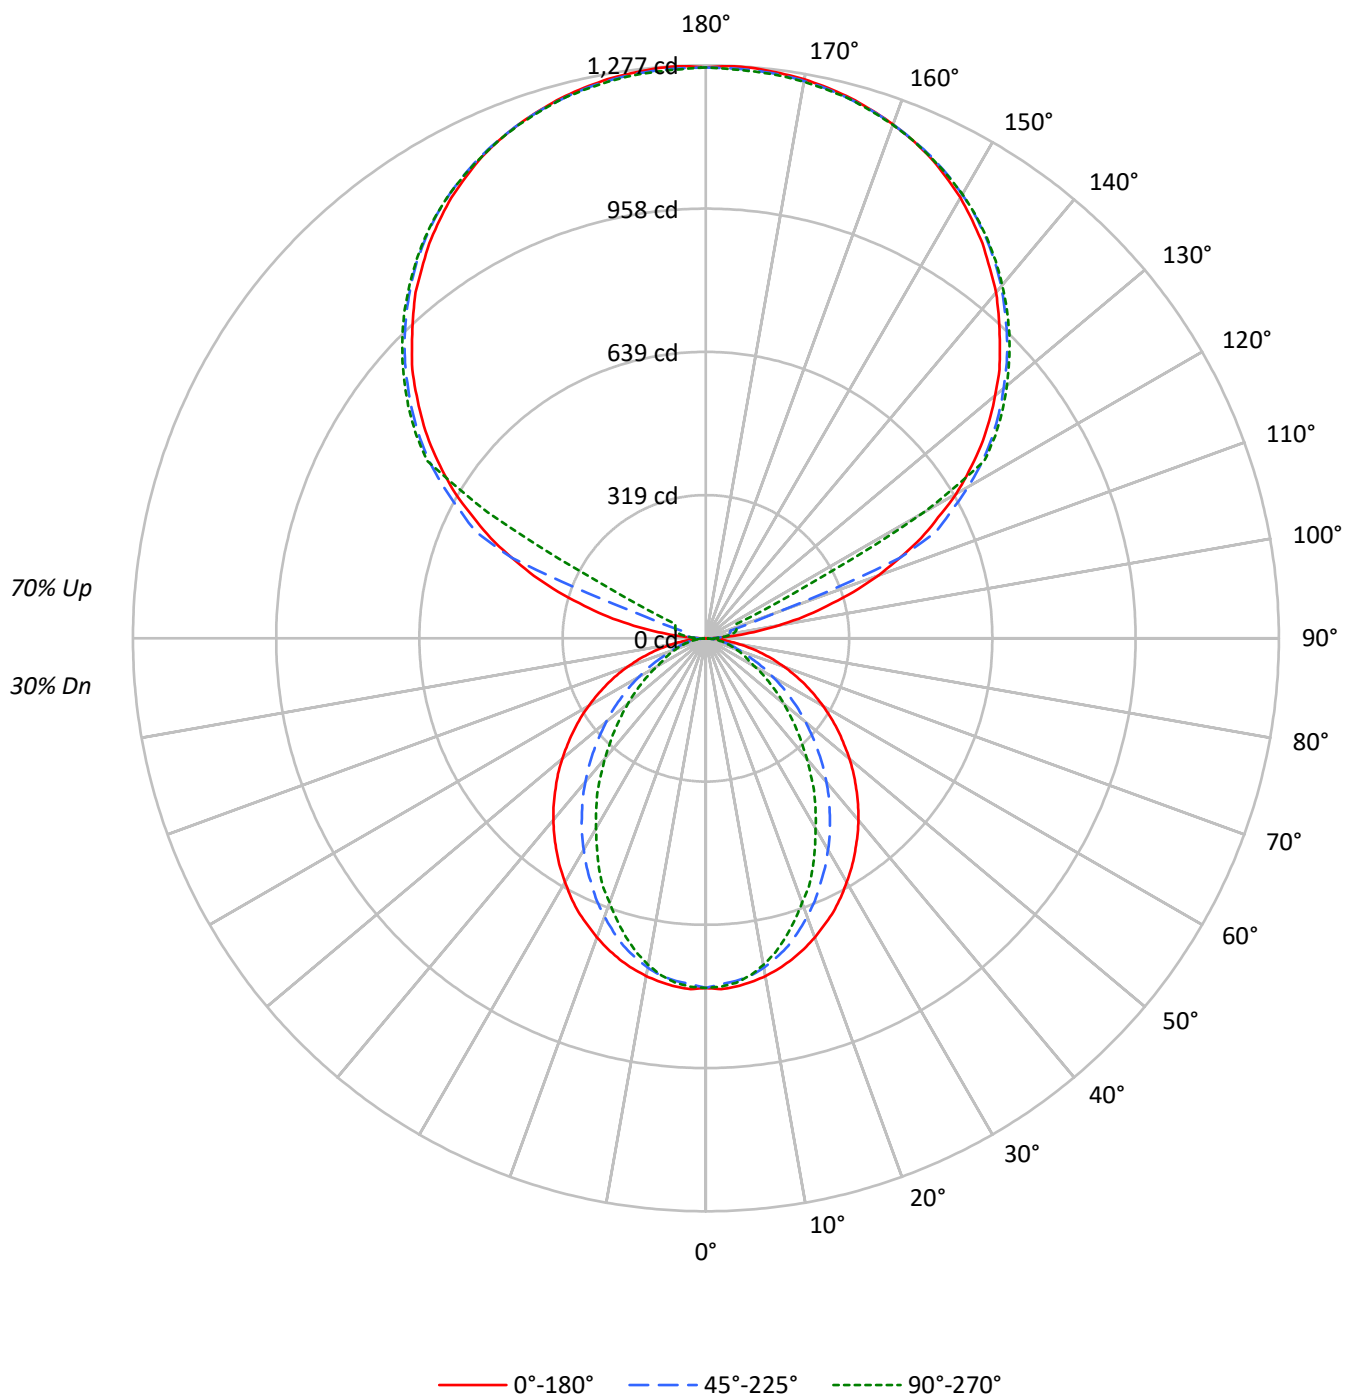

TEST NUMBER: P902429

CATALOG NUMBER: DFN2DIP-HX2F0-020D040US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	38	38	38
1	94	90	86	83	84	81	77	75	64	62	60	48	47	46	34	33	32
2	85	78	73	68	76	71	66	62	56	53	50	43	40	39	30	29	28
3	78	69	62	57	70	62	57	52	50	46	42	38	35	33	27	25	24
4	71	61	54	48	64	55	49	44	44	40	36	34	31	28	24	22	21
5	66	55	47	41	59	49	43	38	40	35	31	30	27	25	22	20	18
6	60	49	41	36	54	44	38	33	36	31	27	28	24	22	20	18	16
7	56	44	37	31	50	40	34	29	32	28	24	25	22	19	18	16	15
8	52	40	33	28	46	36	30	25	29	25	21	23	20	17	17	15	13
9	48	37	29	25	43	33	27	23	27	22	19	21	18	15	16	13	12
10	45	33	27	22	40	30	24	20	25	20	17	20	16	14	14	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1836	1836	1836
5°	1836	1802	1815
10°	1815	1763	1753
15°	1787	1700	1658
20°	1751	1616	1543
25°	1714	1522	1433
30°	1665	1426	1294
35°	1618	1324	1171
40°	1569	1218	1032
45°	1513	1102	906
50°	1455	984	783
55°	1393	860	665
60°	1322	730	544
65°	1241	599	486
70°	1141	476	435
75°	1016	412	389
80°	836	333	327
85°	547	206	230

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1513 cd/sqm

TEST NUMBER: P902429

CATALOG NUMBER: DFN2DIP-HX2F0-020D040US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	73.0	1.4
10°-20°	200.4	3.8
20°-30°	281.4	5.3
30°-40°	306.8	5.8
40°-50°	282.0	5.3
50°-60°	221.4	4.2
60°-70°	144.1	2.7
70°-80°	74.2	1.4
80°-90°	21.2	0.4
90°-100°	41.9	0.8
100°-110°	156.4	2.9
110°-120°	414.8	7.8
120°-130°	688.0	12.9
130°-140°	730.8	13.7
140°-150°	679.2	12.7
150°-160°	546.1	10.2
160°-170°	351.9	6.6
170°-180°	121.1	2.3
0°-30°	554.9	10.4
0°-40°	861.7	16.2
0°-60°	1365.1	25.6
0°-90°	1604.6	30.1
90°-120°	613.2	11.5
90°-150°	2711.2	50.8
90°-180°	3730.0	69.9
0°-180°	5334.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	779	779	779	779	779	
5°	779	776	766	773	771	74
15°	741	733	709	696	689	209
25°	673	650	604	575	564	309
35°	580	544	482	437	422	363
45°	474	426	353	302	286	366
55°	360	305	229	187	173	322
65°	243	186	123	99	97	241
75°	130	80	56	52	51	137
85°	30	16	13	13	13	35
90°	1	11	18	23	25	5
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P902429

CATALOG NUMBER: DFN2DIP-HX2F0-020D040US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	779.1	779.1	779.1	779.1	779.1
2.5°	782.6	779.1	771.3	778.4	777.0
5°	779.1	775.6	766.4	772.8	770.6
7.5°	772.8	768.5	758.7	761.5	757.9
10°	764.3	759.3	745.3	743.1	739.0
12.5°	753.8	747.3	728.3	724.2	716.3
15°	741.0	733.2	709.3	695.9	688.9
17.5°	726.2	714.9	685.3	669.8	658.6
20°	709.3	695.1	660.0	642.3	626.8
22.5°	691.0	674.8	633.9	609.9	599.4
25°	672.7	650.1	603.5	574.7	564.0
27.5°	650.8	626.8	575.3	542.2	525.9
30°	627.5	600.7	544.3	508.4	489.3
32.5°	604.9	572.5	514.7	472.4	454.8
35°	579.6	543.7	481.6	437.2	421.6
37.5°	554.9	516.0	450.5	401.9	384.3
40°	528.8	486.5	418.1	368.1	349.7
42.5°	502.0	456.9	385.7	333.5	315.9
45°	473.8	426.5	352.6	302.5	285.5
47.5°	447.0	397.0	320.8	270.7	255.2
50°	417.5	367.4	289.8	241.1	226.4
52.5°	388.4	335.5	260.1	213.7	200.3
55°	360.2	305.3	229.1	186.9	173.4
57.5°	331.4	274.9	201.7	162.2	150.9
60°	301.8	245.3	172.8	136.9	125.5
62.5°	272.9	216.5	148.1	114.2	108.6
65°	243.3	186.2	122.7	98.8	96.6
67.5°	215.1	157.9	98.8	86.7	84.6
70°	185.4	130.4	81.7	74.7	71.9
72.5°	157.2	105.0	68.3	62.8	61.4
75°	129.7	80.3	56.4	51.5	50.8
77.5°	102.3	57.1	44.4	41.6	40.2
80°	76.8	40.9	33.8	31.0	31.0
82.5°	53.5	27.5	23.3	21.9	21.9
85°	30.3	15.5	13.4	13.4	13.4
87.5°	11.3	5.7	5.7	4.9	4.9
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P902429

CATALOG NUMBER: DFN2DIP-HX2F0-020D040US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P902429

CATALOG NUMBER: DFN2DIP-HX2F0-020D040US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.90	7.59	8.01	8.70	10.23	2.88	3.57	4.00	4.68	6.21
	3H	8.54	9.16	9.66	10.27	11.82	4.04	4.66	5.17	5.78	7.32
	4H	9.12	9.71	10.26	10.83	12.38	4.48	5.06	5.61	6.18	7.73
	6H	9.52	10.06	10.66	11.18	12.74	4.77	5.31	5.92	6.43	8.00
	8H	9.63	10.14	10.78	11.28	12.83	4.85	5.37	6.00	6.50	8.06
	12H	9.68	10.16	10.83	11.29	12.87	4.89	5.37	6.03	6.50	8.08
4H	2H	6.89	7.48	8.04	8.60	10.15	3.45	4.03	4.59	5.15	6.70
	3H	8.68	9.17	9.83	10.31	11.88	4.76	5.25	5.91	6.39	7.96
	4H	9.35	9.80	10.50	10.93	12.51	5.29	5.74	6.44	6.87	8.46
	6H	9.83	10.22	10.99	11.37	12.95	5.69	6.07	6.84	7.22	8.80
	8H	9.99	10.35	11.15	11.49	13.09	5.80	6.16	6.96	7.31	8.90
	12H	10.07	10.39	11.24	11.55	13.15	5.85	6.18	7.02	7.33	8.93
8H	4H	9.30	9.66	10.46	10.81	12.40	5.55	5.90	6.70	7.05	8.64
	6H	9.84	10.13	11.01	11.32	12.91	6.04	6.33	7.21	7.52	9.11
	8H	10.04	10.29	11.22	11.46	13.07	6.21	6.47	7.39	7.64	9.25
	12H	10.15	10.38	11.33	11.54	13.18	6.31	6.54	7.50	7.70	9.35
12H	4H	9.25	9.57	10.42	10.73	12.33	5.54	5.86	6.71	7.02	8.62
	6H	9.81	10.07	10.99	11.23	12.84	6.08	6.34	7.26	7.50	9.11
	8H	10.01	10.23	11.19	11.40	13.04	6.27	6.49	7.45	7.66	9.30

END OF REPORT