

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902465

Luminaire Tested: DFN2DIP-HX2F0-040D030US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902465
REPORT IS A COMBINATION OF REPORTS P900686 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-040D030US830-RLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6004.0 lumens
Efficiency: N/A
Efficacy: 103.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 57.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902465

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US830-RLLONL

Luminous Intensity Polar Plot

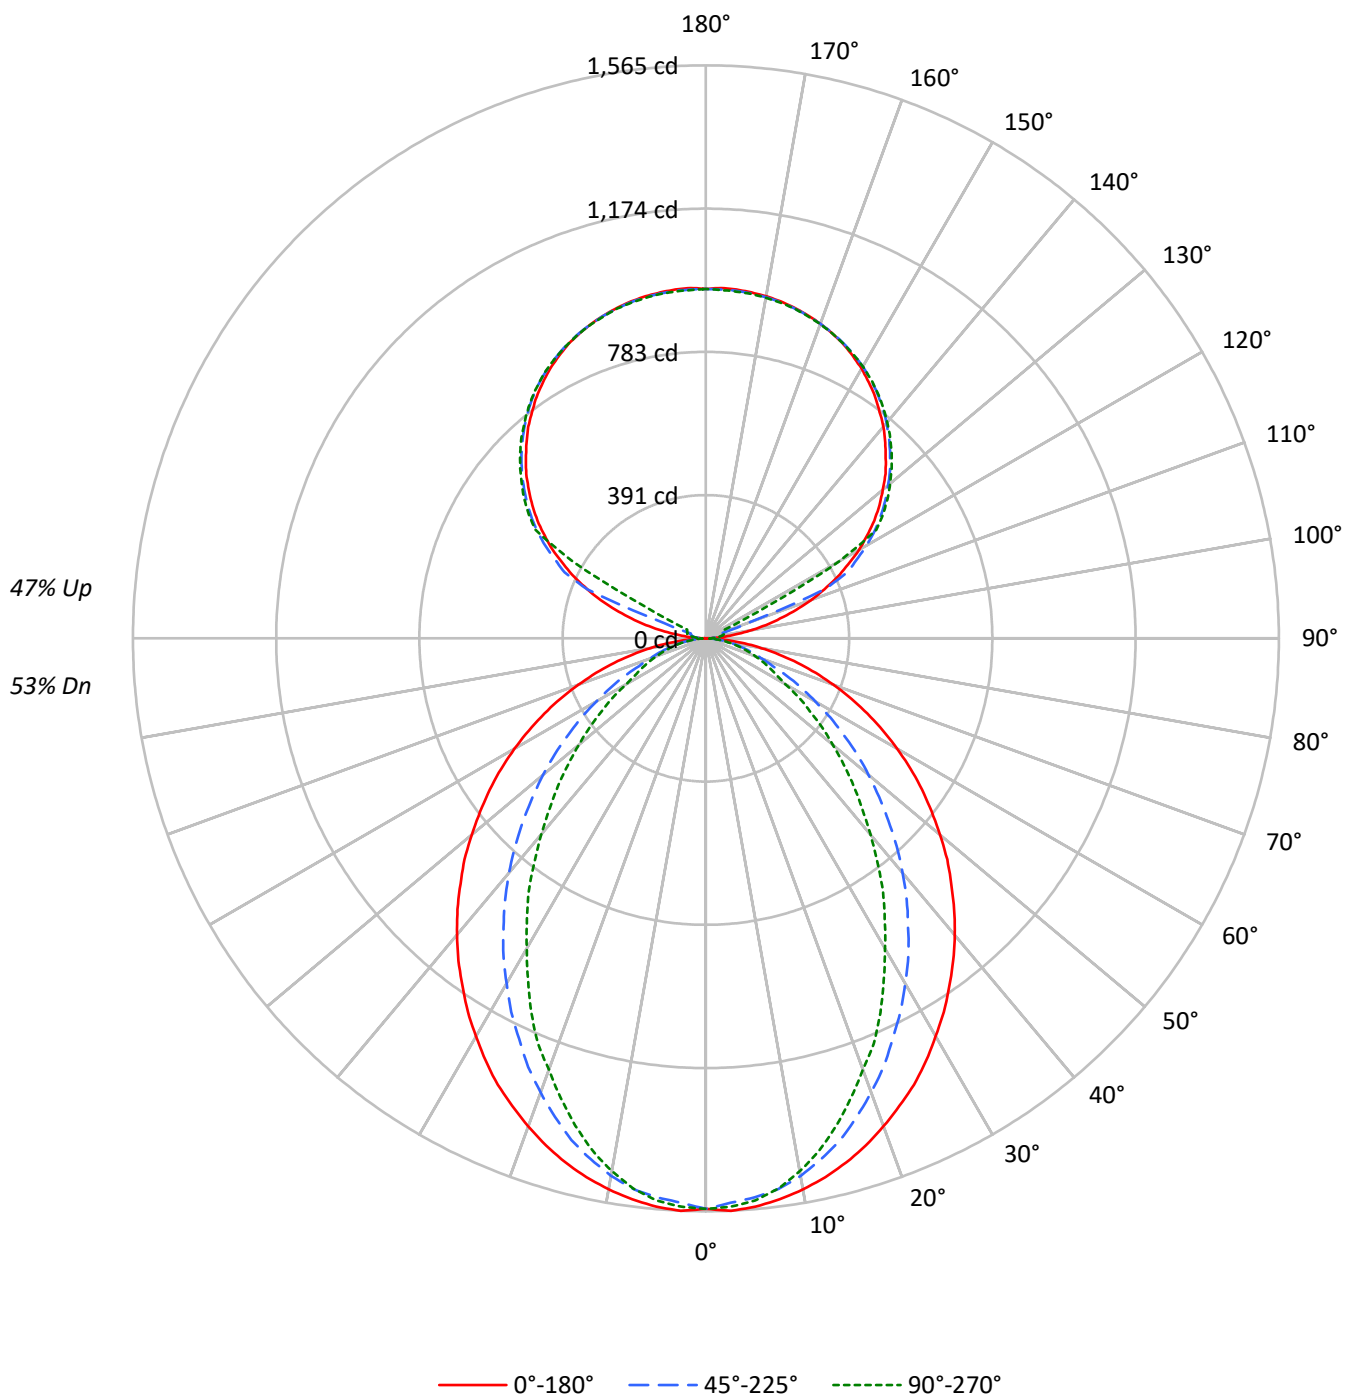

TEST NUMBER: P902465

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	108	108	108	108		100	100	100	100		85	85	85		72	72	72		59	59	59
1	99	95	91	88		92	88	85	82		76	73	71		64	62	61		53	52	51
2	91	83	78	73		84	78	73	68		67	63	60		57	54	52		47	45	44
3	83	74	67	61		77	69	63	58		59	55	51		51	47	44		42	40	38
4	76	66	58	52		70	61	55	49		53	48	44		45	42	38		38	35	33
5	70	59	51	45		65	55	48	43		48	42	38		41	37	34		35	32	29
6	65	53	45	39		60	50	43	37		43	38	34		37	33	30		32	28	26
7	60	48	40	35		56	45	38	33		39	34	30		34	30	26		29	26	23
8	56	44	36	31		52	41	34	29		36	31	27		31	27	24		27	24	21
9	52	40	33	28		48	38	31	26		33	28	24		29	25	22		25	22	19
10	49	37	30	25		45	35	28	24		31	25	22		27	23	20		23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3671	3671	3671
5°	3671	3604	3629
10°	3629	3525	3505
15°	3574	3400	3316
20°	3501	3231	3087
25°	3428	3044	2865
30°	3331	2852	2587
35°	3236	2647	2343
40°	3138	2436	2064
45°	3026	2203	1812
50°	2909	1969	1566
55°	2787	1720	1330
60°	2644	1460	1088
65°	2481	1197	972
70°	2282	953	870
75°	2031	823	779
80°	1671	666	656
85°	1094	412	460

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3026 cd/sqm

TEST NUMBER: P902465

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.0	2.4
10°-20°	400.9	6.7
20°-30°	562.8	9.4
30°-40°	613.5	10.2
40°-50°	563.9	9.4
50°-60°	442.9	7.4
60°-70°	288.3	4.8
70°-80°	148.4	2.5
80°-90°	39.6	0.7
90°-100°	31.5	0.5
100°-110°	117.3	2.0
110°-120°	311.1	5.2
120°-130°	516.0	8.6
130°-140°	548.1	9.1
140°-150°	509.4	8.5
150°-160°	409.6	6.8
160°-170°	263.9	4.4
170°-180°	90.8	1.5
0°-30°	1109.8	18.5
0°-40°	1723.3	28.7
0°-60°	2730.1	45.5
0°-90°	3206.3	53.4
90°-120°	459.9	7.7
90°-150°	2033.4	33.9
90°-180°	2798.0	46.6
0°-180°	6004.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1558	1558	1558	1558	1558	
5°	1558	1551	1533	1546	1541	148
15°	1482	1466	1419	1392	1378	418
25°	1345	1300	1207	1149	1128	619
35°	1159	1087	963	874	843	726
45°	948	853	705	605	571	732
55°	721	611	458	374	347	644
65°	486	372	245	198	193	482
75°	259	161	113	103	102	274
85°	61	31	27	27	27	70
90°	1	8	14	17	19	6
95°	45	22	27	30	30	53
105°	210	231	42	50	52	224
115°	397	409	426	106	57	391
125°	561	570	584	588	590	501
135°	695	706	712	719	718	537
145°	806	805	817	822	818	504
155°	887	881	889	894	888	409
165°	935	931	933	938	933	264
175°	956	952	953	958	951	91
180°	954	954	954	954	954	

TEST NUMBER: P902465

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1558.2	1558.2	1558.2	1558.2	1558.2
2.5°	1565.3	1558.2	1542.7	1556.9	1554.0
5°	1558.2	1551.1	1532.8	1545.5	1541.3
7.5°	1545.5	1537.1	1517.4	1522.9	1515.9
10°	1528.6	1518.7	1490.5	1486.2	1477.9
12.5°	1507.5	1494.8	1456.6	1448.2	1432.7
15°	1482.1	1466.5	1418.6	1391.9	1377.8
17.5°	1452.5	1429.8	1370.6	1339.6	1317.0
20°	1418.6	1390.3	1319.8	1284.7	1253.6
22.5°	1382.0	1349.5	1267.6	1219.7	1198.7
25°	1345.3	1300.1	1207.0	1149.3	1128.0
27.5°	1301.7	1253.6	1150.7	1084.4	1051.9
30°	1255.1	1201.4	1088.5	1016.7	978.6
32.5°	1209.9	1145.0	1029.4	944.8	909.5
35°	1159.2	1087.2	963.2	874.3	843.2
37.5°	1109.8	1032.2	901.1	803.7	768.5
40°	1057.6	973.1	836.2	736.1	699.5
42.5°	1004.0	913.8	771.4	666.9	631.8
45°	947.6	853.1	705.1	604.9	571.1
47.5°	894.1	794.0	641.7	541.5	510.5
50°	834.8	734.7	579.6	482.2	452.7
52.5°	776.9	671.2	520.4	427.3	400.5
55°	720.6	610.6	458.3	373.7	346.9
57.5°	662.8	550.0	403.3	324.3	301.8
60°	603.5	490.7	345.4	273.6	251.1
62.5°	545.8	433.0	296.1	228.5	217.3
65°	486.5	372.2	245.3	197.5	193.1
67.5°	430.2	315.8	197.5	173.4	169.2
70°	370.9	260.9	163.5	149.5	143.7
72.5°	314.5	210.1	136.8	125.5	122.7
75°	259.4	160.7	112.8	102.9	101.6
77.5°	204.5	114.1	88.9	83.2	80.3
80°	153.6	81.8	67.6	62.1	62.1
82.5°	107.2	55.0	46.6	43.6	43.6
85°	60.6	31.0	26.8	26.8	26.8
87.5°	22.6	11.2	11.2	9.9	9.9
90°	0.7	8.3	13.8	17.3	18.6
92.5°	17.3	14.5	16.6	18.0	18.6
95°	44.9	22.1	26.9	30.4	29.7
97.5°	80.8	24.2	35.2	37.3	38.0
100°	122.2	27.6	39.4	44.9	46.3
102.5°	167.8	166.5	40.7	48.3	50.4
105°	209.9	230.6	42.1	49.7	52.5
107.5°	258.9	276.2	43.5	51.1	53.9
110°	305.9	320.4	120.8	51.8	54.6

TEST NUMBER: P902465

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	350.2	362.5	350.8	53.2	55.2
115°	397.0	408.8	426.0	106.3	56.6
117.5°	437.8	451.6	463.4	364.6	183.7
120°	483.3	493.7	506.1	514.4	421.2
122.5°	522.0	533.1	547.0	551.0	551.8
125°	561.4	570.3	583.5	588.3	590.4
127.5°	597.3	606.9	617.4	624.2	624.9
130°	631.1	642.2	649.8	657.3	656.8
132.5°	665.6	674.7	682.2	688.4	687.8
135°	694.7	705.8	711.9	718.9	717.5
137.5°	725.0	733.3	740.3	747.2	745.1
140°	754.7	760.3	767.8	774.0	770.6
142.5°	779.7	784.5	793.4	798.9	795.5
145°	805.9	805.1	816.9	821.7	818.2
147.5°	828.6	826.5	838.3	841.7	839.0
150°	850.7	845.9	857.0	861.0	857.6
152.5°	869.3	863.8	874.2	878.4	873.5
155°	887.3	881.2	889.4	893.5	888.1
157.5°	901.8	896.4	902.6	907.4	901.8
160°	914.3	910.1	914.3	918.4	913.5
162.5°	925.3	921.1	924.6	929.4	923.2
165°	934.9	930.9	932.9	937.7	932.9
167.5°	942.5	938.4	940.5	945.4	939.1
170°	948.8	944.6	946.0	950.8	944.6
172.5°	952.9	948.8	950.2	955.0	948.8
175°	956.3	951.5	952.9	957.7	950.8
177.5°	957.7	952.9	953.7	958.5	952.3
180°	954.3	954.3	954.3	954.3	954.3

TEST NUMBER: P902465

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.84	12.70	12.78	13.65	14.87	7.82	8.68	8.76	9.63	10.85
	3H	13.50	14.26	14.44	15.22	16.47	9.00	9.77	9.94	10.72	11.97
	4H	14.09	14.81	15.05	15.78	17.03	9.44	10.16	10.40	11.12	12.38
	6H	14.49	15.16	15.46	16.13	17.39	9.75	10.41	10.72	11.38	12.65
	8H	14.61	15.24	15.59	16.23	17.49	9.83	10.46	10.81	11.45	12.71
	12H	14.66	15.26	15.64	16.24	17.53	9.87	10.47	10.85	11.45	12.74
4H	2H	11.86	12.58	12.83	13.55	14.80	8.41	9.13	9.37	10.09	11.35
	3H	13.66	14.27	14.64	15.26	16.53	9.74	10.34	10.72	11.33	12.61
	4H	14.34	14.89	15.32	15.87	17.17	10.28	10.83	11.26	11.81	13.11
	6H	14.83	15.30	15.83	16.31	17.60	10.68	11.15	11.67	12.16	13.45
	8H	14.99	15.43	15.99	16.43	17.74	10.80	11.24	11.80	12.24	13.55
	12H	15.07	15.47	16.09	16.49	17.80	10.85	11.25	11.87	12.27	13.58
8H	4H	14.30	14.74	15.30	15.74	17.05	10.54	10.98	11.54	11.99	13.29
	6H	14.84	15.21	15.86	16.25	17.55	11.04	11.40	12.06	12.45	13.75
	8H	15.04	15.36	16.07	16.39	17.72	11.22	11.54	12.25	12.57	13.89
	12H	15.16	15.45	16.20	16.47	17.84	11.32	11.61	12.36	12.63	14.00
12H	4H	14.25	14.65	15.27	15.67	16.98	10.55	10.94	11.56	11.96	13.27
	6H	14.82	15.14	15.85	16.17	17.49	11.08	11.40	12.11	12.43	13.76
	8H	15.02	15.30	16.05	16.33	17.70	11.28	11.56	12.31	12.58	13.95

END OF REPORT