

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902475

Luminaire Tested: DFN2DIP-HX2F0-040D060US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902475
REPORT IS A COMBINATION OF REPORTS P900715 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-040D060US830-FLLONL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9331.2 lumens
Efficiency: N/A
Efficacy: 110.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 84.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902475

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US830-FLLONL

Luminous Intensity Polar Plot

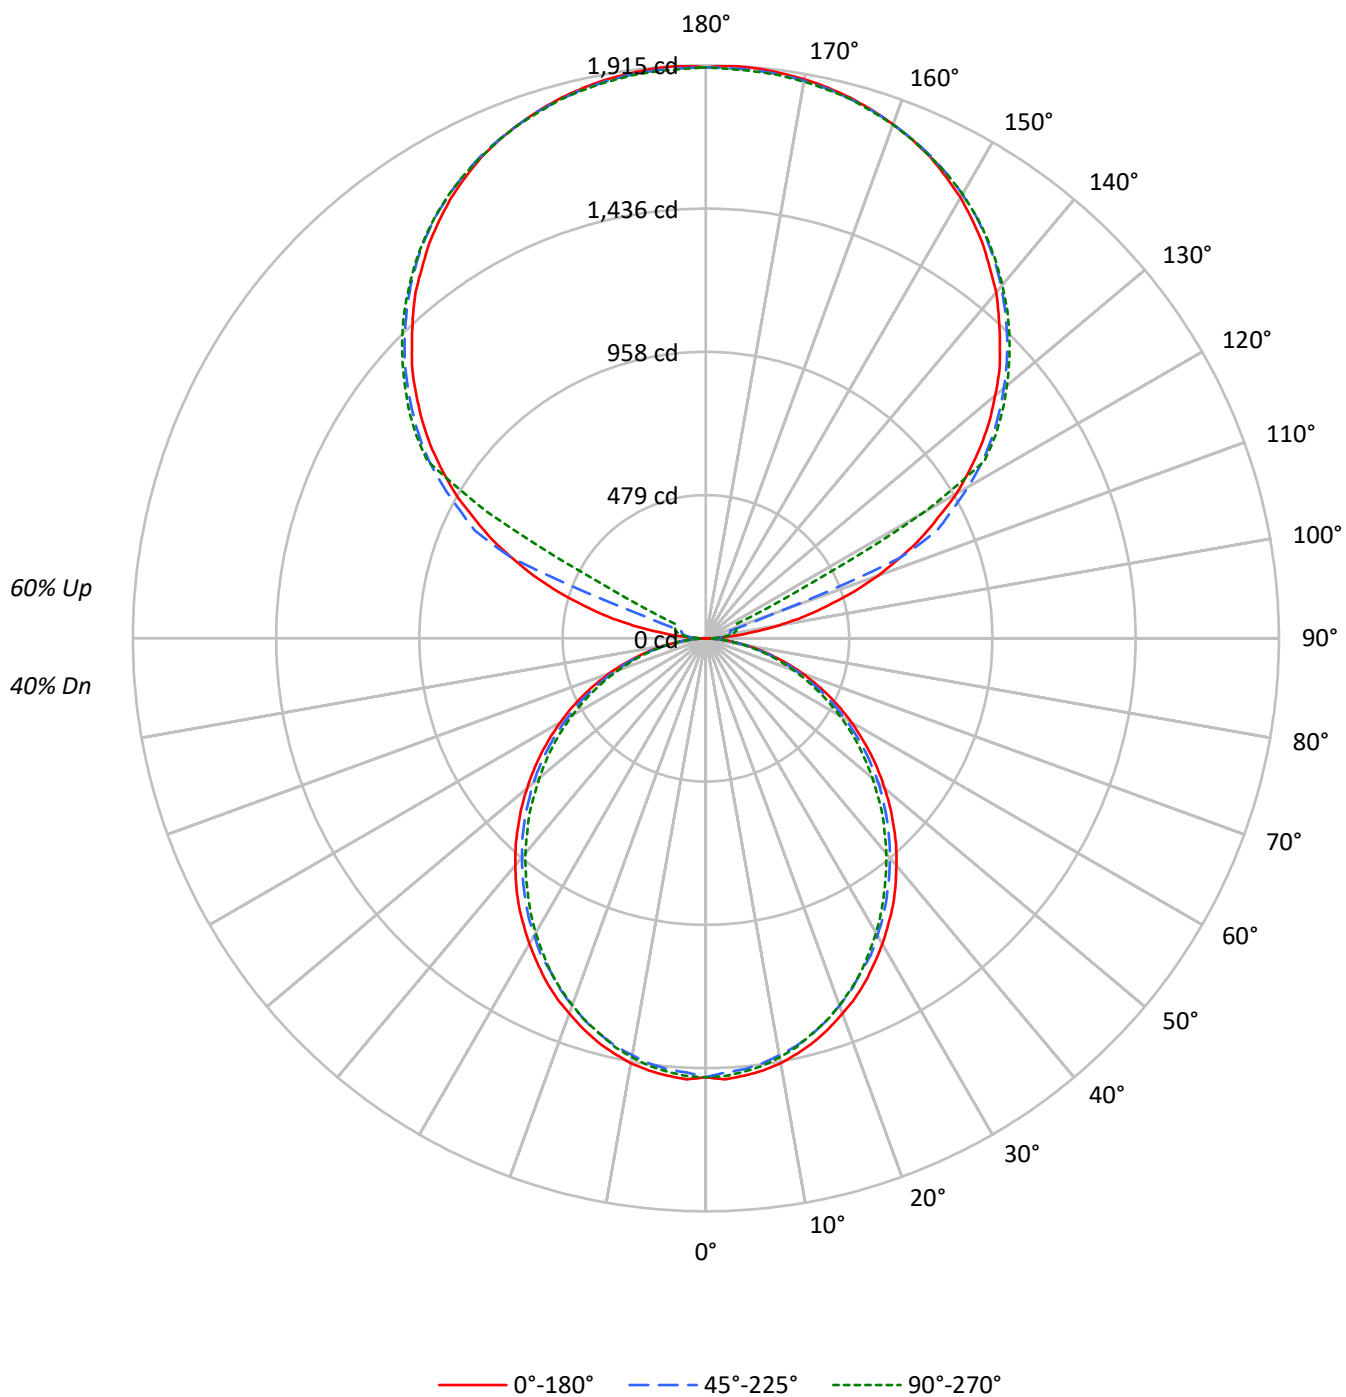

TEST NUMBER: P902475

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3456	3456	3456
5°	3456	3400	3425
10°	3423	3346	3372
15°	3367	3283	3294
20°	3294	3198	3213
25°	3220	3098	3121
30°	3130	3005	3006
35°	3044	2897	2885
40°	2939	2786	2769
45°	2833	2675	2649
50°	2718	2559	2512
55°	2597	2424	2385
60°	2460	2266	2238
65°	2309	2100	2066
70°	2118	1898	1879
75°	1856	1657	1698
80°	1535	1349	1370
85°	1043	846	848

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2833 cd/sqm

TEST NUMBER: P902475

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.1	1.5
10°-20°	388.5	4.2
20°-30°	570.9	6.1
30°-40°	663.1	7.1
40°-50°	662.3	7.1
50°-60°	577.5	6.2
60°-70°	426.9	4.6
70°-80°	241.5	2.6
80°-90°	67.1	0.7
90°-100°	62.9	0.7
100°-110°	234.6	2.5
110°-120°	622.2	6.7
120°-130°	1032.0	11.1
130°-140°	1096.2	11.7
140°-150°	1018.8	10.9
150°-160°	819.1	8.8
160°-170°	527.8	5.7
170°-180°	181.7	1.9
0°-30°	1097.5	11.8
0°-40°	1760.6	18.9
0°-60°	3000.3	32.2
0°-90°	3735.8	40.0
90°-120°	919.8	9.9
90°-150°	4066.8	43.6
90°-180°	5595.0	60.0
0°-180°	9331.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1461	1446	1457	1454	139
15°	1396	1388	1370	1375	1368	393
25°	1264	1253	1229	1231	1229	582
35°	1090	1076	1054	1045	1038	681
45°	887	878	856	841	835	685
55°	672	663	646	629	622	600
65°	453	444	430	418	411	448
75°	237	234	227	219	222	253
85°	58	56	55	51	49	64
90°	1	17	28	35	37	9
95°	90	44	54	61	59	106
105°	420	461	84	99	105	449
115°	794	818	852	213	113	782
125°	1123	1141	1167	1177	1181	1001
135°	1389	1412	1424	1438	1435	1073
145°	1612	1610	1634	1643	1636	1008
155°	1775	1762	1779	1787	1776	818
165°	1870	1862	1866	1876	1866	528
175°	1913	1903	1906	1915	1902	182
180°	1909	1909	1909	1909	1909	

TEST NUMBER: P902475

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1475.5	1468.5	1452.9	1467.0	1464.3
5°	1467.0	1461.4	1445.9	1457.1	1454.4
7.5°	1457.1	1448.7	1433.1	1444.5	1441.7
10°	1441.7	1431.8	1414.9	1426.2	1421.9
12.5°	1420.4	1412.0	1395.2	1402.2	1399.3
15°	1396.5	1388.1	1369.7	1375.4	1368.4
17.5°	1366.9	1358.5	1340.1	1347.1	1340.1
20°	1334.4	1326.0	1306.3	1310.4	1304.9
22.5°	1302.0	1289.3	1270.9	1270.9	1268.1
25°	1263.9	1252.6	1228.7	1231.4	1228.7
27.5°	1221.5	1211.6	1193.4	1189.2	1182.2
30°	1179.3	1168.0	1146.9	1142.6	1137.0
32.5°	1134.2	1125.8	1103.2	1094.7	1088.9
35°	1090.4	1076.4	1053.8	1045.3	1038.2
37.5°	1041.0	1028.3	1005.7	995.9	988.8
40°	990.3	978.9	956.3	943.8	938.1
42.5°	940.9	929.5	907.1	892.9	884.5
45°	887.3	877.5	856.2	840.8	835.1
47.5°	835.1	825.2	802.7	787.1	778.7
50°	780.0	773.0	753.3	733.5	726.4
52.5°	726.4	716.6	698.3	682.8	672.9
55°	671.6	663.0	646.1	629.1	622.2
57.5°	616.4	609.4	591.0	574.1	568.4
60°	561.4	555.8	536.1	520.6	516.3
62.5°	507.8	497.9	483.9	469.8	464.1
65°	452.9	444.3	430.3	417.5	410.6
67.5°	396.4	389.3	376.7	366.8	361.2
70°	344.2	338.6	325.8	315.9	310.4
72.5°	290.7	284.9	278.0	268.1	263.8
75°	237.0	234.2	227.1	218.7	221.5
77.5°	189.0	183.3	180.5	176.3	172.1
80°	141.1	139.6	136.8	132.6	129.8
82.5°	96.0	96.0	94.6	88.9	88.9
85°	57.8	56.5	55.0	50.7	49.4
87.5°	25.4	22.6	19.8	15.6	14.0
90°	1.3	16.6	27.5	34.6	37.2
92.5°	34.6	29.0	33.1	35.9	37.2
95°	89.7	44.1	53.8	60.9	59.4
97.5°	161.6	48.4	70.3	74.6	76.0
100°	244.5	55.2	78.7	89.7	92.5
102.5°	335.5	332.9	81.5	96.6	100.9
105°	419.8	461.3	84.3	99.3	105.0
107.5°	517.9	552.3	87.1	102.2	107.7
110°	611.9	640.7	241.8	103.7	109.1

TEST NUMBER: P902475

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	700.2	725.0	701.5	106.2	110.6
115°	794.1	817.6	852.2	212.7	113.3
117.5°	875.5	903.1	926.7	729.2	367.3
120°	966.8	987.4	1012.4	1028.9	842.4
122.5°	1044.0	1066.1	1093.8	1102.0	1103.5
125°	1122.8	1140.8	1167.0	1176.7	1180.7
127.5°	1194.6	1213.9	1234.7	1248.5	1249.8
130°	1262.3	1284.4	1299.5	1314.8	1313.4
132.5°	1331.3	1349.3	1364.4	1376.9	1375.5
135°	1389.4	1411.6	1423.8	1437.8	1434.9
137.5°	1450.0	1466.6	1480.5	1494.3	1490.3
140°	1509.4	1520.6	1535.7	1548.1	1541.2
142.5°	1559.2	1569.0	1586.9	1597.8	1590.9
145°	1611.7	1610.2	1633.7	1643.4	1636.5
147.5°	1657.2	1653.0	1676.5	1683.4	1678.0
150°	1701.5	1691.8	1713.9	1722.1	1715.2
152.5°	1738.7	1727.7	1748.3	1756.7	1747.0
155°	1774.6	1762.3	1778.9	1787.1	1776.0
157.5°	1803.6	1792.6	1805.1	1814.8	1803.6
160°	1828.5	1820.1	1828.5	1836.7	1827.1
162.5°	1850.5	1842.3	1849.2	1858.9	1846.4
165°	1869.9	1861.7	1865.8	1875.5	1865.8
167.5°	1885.1	1876.8	1881.0	1890.7	1878.2
170°	1897.6	1889.2	1892.1	1901.7	1889.2
172.5°	1905.8	1897.6	1900.4	1910.1	1897.6
175°	1912.7	1903.0	1905.8	1915.4	1901.7
177.5°	1915.4	1905.8	1907.2	1916.9	1904.5
180°	1908.6	1908.6	1908.6	1908.6	1908.6

TEST NUMBER: P902475

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.45	11.23	11.48	12.27	13.68	10.02	10.80	11.06	11.85	13.25
	3H	12.08	12.77	13.12	13.83	15.25	11.62	12.31	12.66	13.37	14.79
	4H	12.64	13.30	13.70	14.36	15.79	12.18	12.85	13.24	13.90	15.33
	6H	13.02	13.63	14.09	14.69	16.13	12.56	13.17	13.63	14.23	15.67
	8H	13.11	13.69	14.19	14.77	16.21	12.65	13.23	13.73	14.31	15.75
	12H	13.15	13.70	14.23	14.77	16.23	12.69	13.24	13.76	14.31	15.77
4H	2H	10.89	11.55	11.95	12.61	14.04	10.55	11.21	11.62	12.27	13.70
	3H	12.72	13.27	13.79	14.35	15.80	12.33	12.89	13.41	13.97	15.41
	4H	13.41	13.91	14.49	14.99	16.46	13.01	13.52	14.09	14.59	16.06
	6H	13.90	14.33	14.98	15.43	16.89	13.50	13.94	14.59	15.03	16.49
	8H	14.03	14.44	15.12	15.53	17.00	13.63	14.04	14.72	15.13	16.61
	12H	14.09	14.46	15.20	15.56	17.04	13.68	14.05	14.79	15.15	16.64
8H	4H	13.59	13.99	14.68	15.08	16.56	13.24	13.64	14.33	14.73	16.21
	6H	14.19	14.52	15.30	15.65	17.13	13.83	14.17	14.95	15.30	16.78
	8H	14.39	14.68	15.51	15.80	17.29	14.03	14.33	15.15	15.44	16.93
	12H	14.50	14.76	15.62	15.87	17.40	14.13	14.39	15.25	15.50	17.03
12H	4H	13.57	13.93	14.67	15.04	16.52	13.22	13.59	14.33	14.69	16.18
	6H	14.21	14.50	15.33	15.62	17.11	13.87	14.16	14.99	15.28	16.77
	8H	14.43	14.69	15.55	15.80	17.33	14.08	14.34	15.21	15.45	16.98

END OF REPORT