

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902491

Luminaire Tested: DFN2DIP-HX2F0-050D050US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902491
REPORT IS A COMBINATION OF REPORTS P900707 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-050D050US830-FLLONL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9331.2 lumens
Efficiency: N/A
Efficacy: 108.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902491

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US830-FLLONL

Luminous Intensity Polar Plot

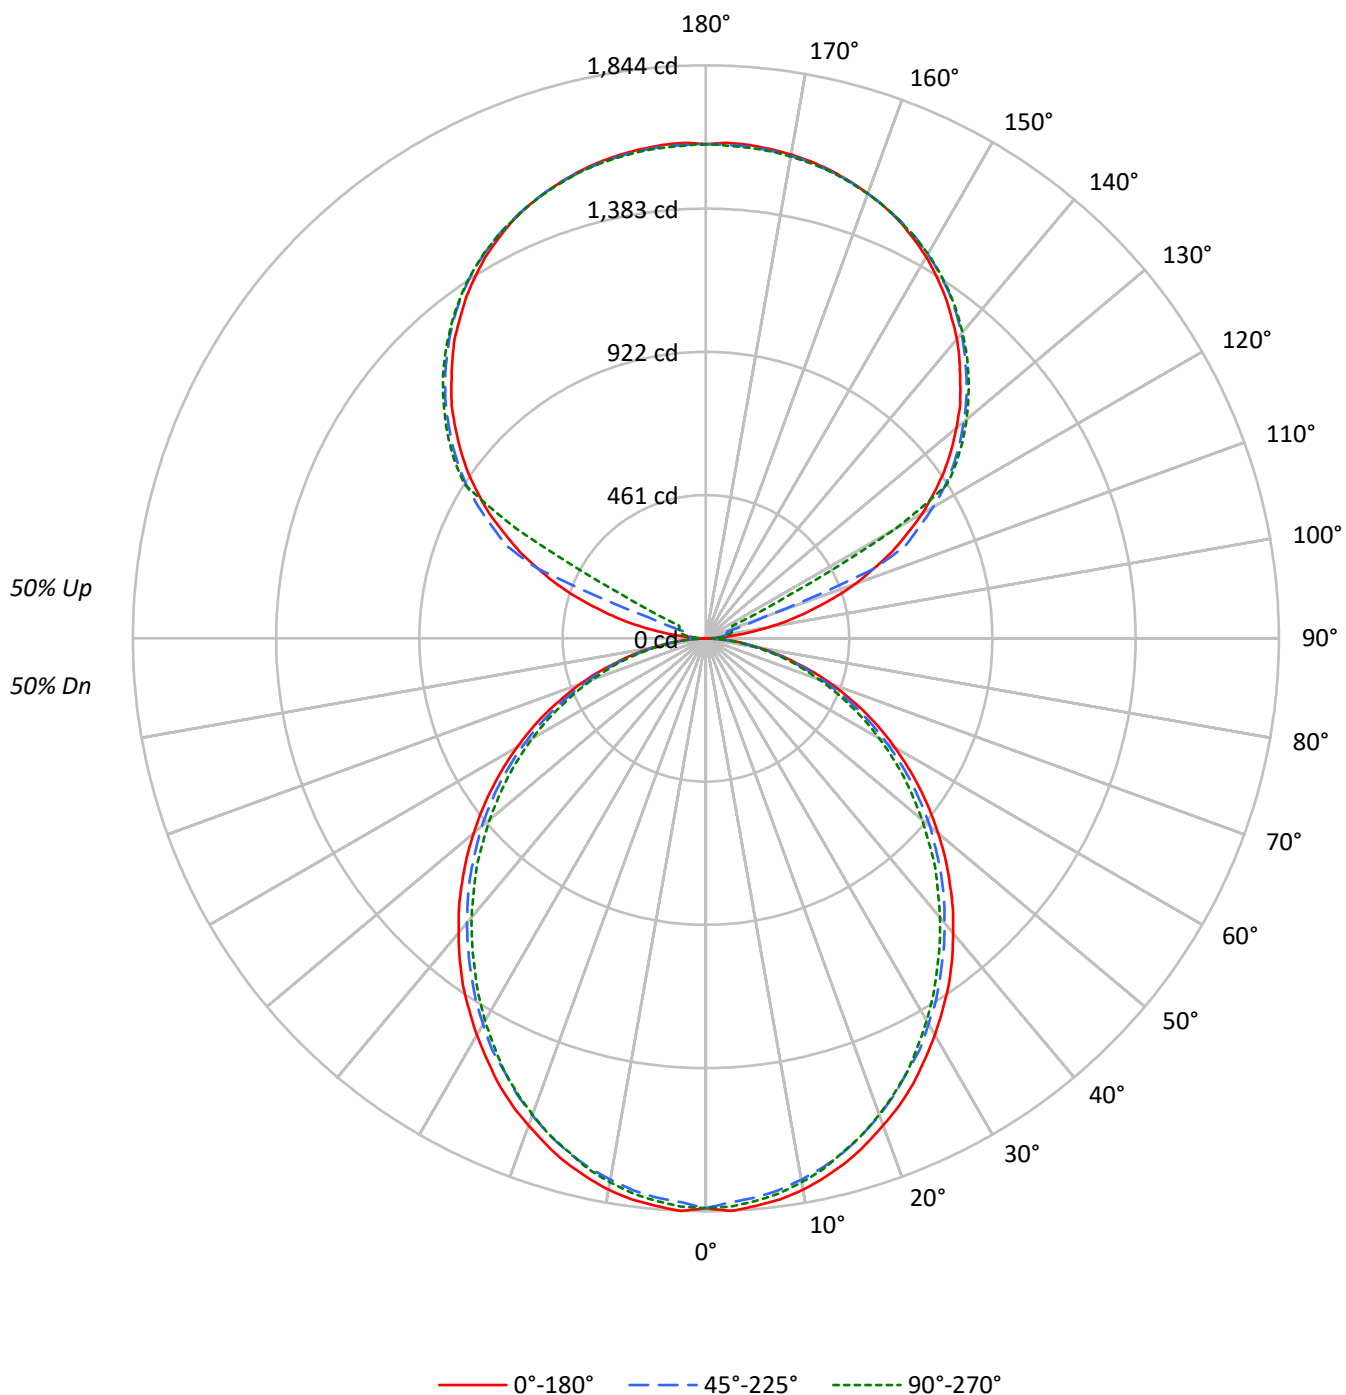

TEST NUMBER: P902491

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4320	4320	4320
5°	4320	4250	4281
10°	4279	4183	4215
15°	4209	4103	4117
20°	4117	3998	4017
25°	4026	3873	3901
30°	3912	3756	3758
35°	3804	3621	3606
40°	3673	3483	3461
45°	3542	3344	3312
50°	3398	3199	3140
55°	3246	3030	2981
60°	3075	2832	2798
65°	2887	2625	2582
70°	2648	2373	2349
75°	2319	2071	2123
80°	1919	1686	1713
85°	1303	1058	1059

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3542 cd/sqm

TEST NUMBER: P902491

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	1.8
10°-20°	485.6	5.2
20°-30°	713.7	7.6
30°-40°	828.9	8.9
40°-50°	827.8	8.9
50°-60°	721.8	7.7
60°-70°	533.6	5.7
70°-80°	301.9	3.2
80°-90°	82.5	0.9
90°-100°	52.5	0.6
100°-110°	195.5	2.1
110°-120°	518.5	5.6
120°-130°	860.0	9.2
130°-140°	913.5	9.8
140°-150°	849.0	9.1
150°-160°	682.6	7.3
160°-170°	439.8	4.7
170°-180°	151.4	1.6
0°-30°	1371.9	14.7
0°-40°	2200.7	23.6
0°-60°	3750.4	40.2
0°-90°	4668.4	50.0
90°-120°	766.5	8.2
90°-150°	3389.0	36.3
90°-180°	4663.0	50.0
0°-180°	9331.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1346	1317	1307	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P902491

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.7	1833.7	1833.7	1833.7	1833.7
2.5°	1844.4	1835.6	1816.2	1833.7	1830.4
5°	1833.7	1826.8	1807.3	1821.4	1818.1
7.5°	1821.4	1810.9	1791.5	1805.7	1802.1
10°	1802.1	1789.8	1768.7	1782.6	1777.4
12.5°	1775.6	1765.1	1744.0	1752.8	1749.2
15°	1745.6	1735.1	1712.1	1719.3	1710.4
17.5°	1708.5	1698.1	1675.1	1683.9	1675.1
20°	1668.0	1657.6	1632.9	1638.0	1631.2
22.5°	1627.6	1611.7	1588.7	1588.7	1585.1
25°	1579.9	1565.8	1535.9	1539.3	1535.9
27.5°	1526.9	1514.6	1491.8	1486.5	1477.7
30°	1474.1	1460.0	1433.6	1428.3	1421.3
32.5°	1417.7	1407.2	1378.9	1368.3	1361.2
35°	1363.0	1345.5	1317.2	1306.6	1297.8
37.5°	1301.3	1285.4	1257.2	1244.8	1236.0
40°	1237.9	1223.7	1195.4	1179.7	1172.6
42.5°	1176.2	1162.0	1133.9	1116.1	1105.6
45°	1109.2	1096.8	1070.3	1051.0	1043.9
47.5°	1043.9	1031.5	1003.3	983.8	973.4
50°	975.1	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.9	853.5	841.1
55°	839.4	828.8	807.6	786.5	777.7
57.5°	770.5	761.8	738.8	717.7	710.5
60°	701.7	694.8	670.1	650.6	645.5
62.5°	634.8	622.5	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.4	356.2	347.4	335.1	329.8
75°	296.1	292.8	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9

TEST NUMBER: P902491

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P902491

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.22	13.08	13.18	14.06	15.33	11.80	12.66	12.76	13.63	14.90
	3H	13.86	14.63	14.83	15.61	16.91	13.40	14.17	14.37	15.15	16.44
	4H	14.43	15.16	15.41	16.15	17.45	13.97	14.70	14.95	15.69	16.99
	6H	14.81	15.48	15.80	16.47	17.79	14.35	15.02	15.34	16.01	17.33
	8H	14.90	15.55	15.90	16.55	17.86	14.45	15.09	15.45	16.10	17.41
	12H	14.94	15.55	15.95	16.55	17.89	14.48	15.09	15.49	16.09	17.43
4H	2H	12.67	13.41	13.66	14.39	15.69	12.34	13.07	13.32	14.05	15.35
	3H	14.51	15.12	15.51	16.14	17.45	14.13	14.74	15.12	15.75	17.07
	4H	15.21	15.76	16.21	16.77	18.11	14.81	15.37	15.82	16.38	17.72
	6H	15.70	16.18	16.71	17.21	18.54	15.30	15.78	16.32	16.81	18.15
	8H	15.83	16.28	16.85	17.31	18.66	15.44	15.89	16.46	16.91	18.26
	12H	15.90	16.30	16.93	17.34	18.70	15.49	15.90	16.53	16.94	18.29
8H	4H	15.39	15.84	16.41	16.86	18.22	15.04	15.49	16.06	16.51	17.86
	6H	15.99	16.36	17.04	17.43	18.78	15.64	16.01	16.68	17.08	18.43
	8H	16.20	16.52	17.25	17.58	18.94	15.84	16.17	16.89	17.22	18.59
	12H	16.31	16.60	17.37	17.65	19.06	15.94	16.23	17.00	17.28	18.69
12H	4H	15.37	15.78	16.41	16.82	18.18	15.03	15.44	16.07	16.48	17.83
	6H	16.02	16.35	17.07	17.40	18.76	15.68	16.00	16.73	17.06	18.42
	8H	16.24	16.53	17.30	17.57	18.99	15.90	16.18	16.95	17.23	18.64